

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001**


No. F.6 DFS/MS/School/2017/SZ/ 1545

Dated: 27/10/17

FIRE SAFETY CERTIFICATE

Certified that **K.C. Convent School** located at **E-1/52, Jaitpur Extn., Badarpur, New Delhi-110044**, comprised of basement (sealed), ground and first floor was granted Fire Safety Certificate by this department vide letter No. F.6/DFS/MS/School/2014/WZ/879 dated 17/07/2014. The premises was re-inspected by officer concerned of this department on 28/09/2017 in presence of Mr. Adesh Goel (Manager) of the school and found that the said School building have deemed complied with the fire prevention and fire safety requirements in accordance with Directorate of Education circular F.16//Estate/CC/Fire Safety/2011/ 3298 to 3398 dated 01.03.2011 issued by Director of Education, Govt. of NCT of Delhi and that the building/premises is fit for occupancy class "**Educational Building**" Group-B, with effect from the date of issue of this certificate for a period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 27/10/17 at New Delhi by


(Vipin Kental)
Chief Fire Officer
Ph. 11-23412225

Copy to: -

1. The Manager, K.C. Convent School, E-1/52, Jaitpur Extn., Badarpur, New Delhi-110044
2. The Director of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi.

Conditions for the validity of Fire Safety Certificate

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of firefighting system.
4. This Certificate cannot be treated as regularization of unauthorized construction, if any.
5. The Owner/Occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules, 2010. The form is available on www.dfs.delhigovt.nic.in.
6. The Owner/Occupier shall apply for renewal of this Fire Safety Certificate to the Director in the form 'J' [sub rule (1) of rule 37] along with copy of this certificate, six months prior to its expiry. The form is available on www.dfs.delhigovt.nic.in.

INSPECTION REPORT				
1	Name & Address of the Building	K.C. CONVENT SCHOOL, E-1/52, JAITPUR EXTN., PART-1, BADARPUR, NEW DELHI-110044		
2	Type of Occupancy	Educational Building "Group-B" (School)		
3	Building Comprised of	Basement (Sealed), Ground + one upper floor.		
4	Type of Case	Renewal		
5	Details of Previous NOC	F.6/DFS/MS/School/2014/WZ/879 Dated 17/07/2014		
6	Fire Safety Directives Letter No	F.16//Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011		
7	Date of Inspection	28.09.2017		
8	Name of the Inspecting Officers	ADO R.N. Singh		
9	Name & Designation of Officers from the building side	Mr. Adesh Goel (Principal)		
10	Year of construction	2012-13 School running at ground & first floor only		
11	Applicant letter No.	KCCS/01/2017-18 dated 30-08-2017		
S. No	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC requirement	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	• Road width	Required	6 m	MR
	• Gate width	N/A	3 m	N/A
	• Width of internal road	N/A	N/A	N/A
2	Number, width, type & arrangement of exits			
	a) Number of Staircase			
	1. Upper floors	2 No's	2 No's	MR
	2. Basement floor	N/A	Basement sealed	N/A
	b) Width of Staircase			
	1. Upper floors	1.50 / 0.75m	0.75-1.0m (2 nos)	MR
	2. Basement floor	N/A	N/A	N/A
	c) Protection of exits			
	1. Fire check door	N/A	N/A	N/A
	2. Pressurization	N/A	N/A	N/A
	d) No. of continuous staircase to terrace	Required	Two	MR
	e) Width of corridor	N/A	N/A	N/A
	f) Door size	N/A	N/A	N/A
3	Compartmentation.			
	• Fire check door.	N/A	N/A	N/A
	• Sealing of electrical shafts.	N/A	N/A	N/A
	• Fire rating of shaft door.	N/A	N/A	N/A
	• Water curtain	N/A	N/A	N/A
	• Fire dampers.	NA	NA	NA
4.	Smoke Management system.			
	• Basement	30 ACPH	N/A	N/A
	• Upper floors	12 ACPH	N/A	N/A
5.	Fire Extinguishers.			
	• Total numbers	5 No's	5 No's	MR
	• Types	ABC / Co2	ABC-5	MR
	• ISI Marking	ISI marked	Provided	MR
6.	First Aid Hose Reels.			
	• Total numbers on each floor.	N/A	N/A	N/A
	• Length of hose-reel hose.	N/A	N/A	N/A
	• Nozzle Diameter	N/A	N/A	N/A

K.C. Convent School at E-1/52, Jaitpur Extn Part-I, Badarpur, New Delhi


7	Automatic fire detection & alarming system			
	<ul style="list-style-type: none"> • Type of detectors • Location of Main Panel • Location of Repeater Panel • Alternate source of power • Hooter's location 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
8.	MOEFA	N/A	N/A	N/A
9.	Public Address System	N/A	N/A	N/A
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> • Basement • Upper floors • Sprinkler above false ceiling 	N/A	Area 36 m ² (sealed)	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
11.	Internal Hydrants.			
	<ul style="list-style-type: none"> • Size of Riser/Down-comer • Number of Hydrant per floor • Hose box. 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
12.	Yard Hydrants.			
	<ul style="list-style-type: none"> • Total number of hydrants. • Hose box. 	N/A	N/A	N/A
		N/A	N/A	N/A
13.	Pumping arrangements.			
	<ul style="list-style-type: none"> • Ground Level 			
	➤ Discharge of main pump.	N/A	N/A	N/A
	➤ Head of main pump.	N/A	N/A	N/A
	➤ Number of main pumps.	N/A	N/A	N/A
	➤ Jockey Pump output.	N/A	N/A	N/A
	➤ Jockey Pump head.	N/A	N/A	N/A
	➤ Standby Pump output.	N/A	N/A	N/A
	➤ Standby pump head.	N/A	N/A	N/A
	➤ Auto Starting/Manual Stopping.	N/A	N/A	N/A
	<ul style="list-style-type: none"> • Terrace Level 			
	➤ Discharge of pump.	N/A	N/A	N/A
	➤ Head of pump.	N/A	N/A	N/A
	➤ Power supply.	N/A	N/A	N/A
	➤ Auto starting of pump.	N/A	N/A	N/A
14.	Captive water storage for Fire Fighting.			
	<ul style="list-style-type: none"> • Underground tank capacity. ➤ Draw-off connection. ➤ Fire Service Inlet. ➤ Access to tank. • Overhead tank capacity. 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
15.	Exit Signage.	Required	Provided	MR
16.	Provisions of Lifts.			
	<ul style="list-style-type: none"> • Pressurization of lift shaft. • Pressurization of lift lobby. • Communication in lift car. • Fireman's switch. • Lift signage. 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
17	Standby Power Supply	N/A	N/A	N/A
18.	Refuge Area			
	<ul style="list-style-type: none"> • Total area • Location 	N/A	N/A	N/A
		N/A	N/A	N/A

19.	Fire Control Room.			
	• Detector System Panel.	N/A	N/A	N/A
	• Flow Switch Panel.	N/A	N/A	N/A
	• PA system Panel.	N/A	N/A	N/A
	• Battery backup	N/A	N/A	N/A
	• Building floor plan	N/A	N/A	N/A
20.	Special Fire Protection System for the Protection of special Risk, if any.	Required	ABC type fire extinguisher provided near electrical panel	MR

The Fire protection systems provided in the building were checked / operated and found functional at the time of inspection.

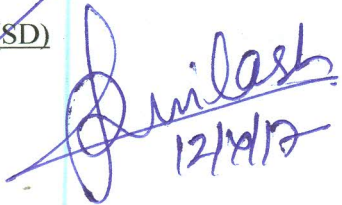
Keeping in view the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under the rule, FSC issued vide letter No. F.6/DFS/MS/School/2014/WZ/879 dated 17/07/2014, renewal under rule 37 of the Delhi Fire Service rules, 2010 is recommended.

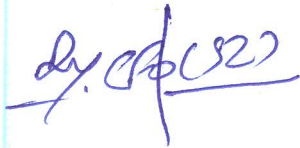
Accordingly, DFA is put up for approval and signature please.



 Signature of the Inspecting Officer
 Name: R.N. Singh
 Designation: ADO

K.C. Convent School at E-1/52, Jaitpur Extn Part-I, Badarpur, New Delhi

D.O. (SD)


12/10/17






1302/CF 82
18/X, 23/17



m.s.dell FT 10.


17/10.

