

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI-110001**

No. F.6 DFS/MS/School/2017/SZ/ 1658

Dated: 16/11/17

FIRE SAFETY CERTIFICATE

Certified that **Ryan International School** located at **Sector-C, Pocket-8, Vasant Kunj, New Delhi-110070** comprised of **Ground plus three upper floors** was issued Fire Safety Certificate by this department vide letter No. F.6/MS/DFS/School/2014/SZ/1229 Dated 19/09/2014. The school building was re-inspected by officer concerned of this department on 25/10/2017 in presence of Mr. Joseph Rodrigues (Admin) of the school and found that the said School building have deemed complied with the fire prevention and fire safety requirements in accordance with Directorate of Education circular No 262-362 dated 17/01/2005 issued by Director of Education, Govt. of NCT of Delhi and that the building/premises is fit for occupancy class "**Educational Building**" Group-B, with effect from the date of issue of this certificate for a period of **Three years** in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 16/11/17 at New Delhi by


Chief Fire Officer
Tel: 011-23412225

*for
o/c*

Copy to: -

1. The Principal, Ryan International School, Sec-C, Pocket-8, Vasant Kunj, New Delhi-110070
2. The Director of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi.

Conditions for the validity of Fire Safety Certificate

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of firefighting system.
4. The owner/ occupier shall submit a declaration every year in Form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in.
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL-2016), if any.
6. "The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry."

INSPECTION REPORT				
1	Name & Address of the Building	RYAN INTERNATIONAL SCHOOL, SECTOR-C, POCKET-8, VASANT KUNJ, NEW DELHI-110070		
2	Type of Occupancy	Educational Building "Group-B" (School)		
3	Building Comprised of	Ground plus three upper floors.		
4	Type of Case	Renewal		
5	Details of Previous NOC	F.6/MS/DFS/School/2014/SZ/1229 Dt. 19/09/2014		
6	Fire Safety Directives Letter No	DOE circular No 262-362 dated 17/01/2005		
7	Date of Inspection	25-10-2017		
8	Name of the Inspecting Officers	R.N. Singh, ADO (BCP)		
9	Name & Designation of Officers from the building side	Mr. Joseph Rodrigues (Admin)		
10	Year of construction	1994		
11	Applicant letter No.	RIS/VK/Fire/2017/02 dated 26/09/2017		
S. No	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC requirement	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	• Road width	Required	6 mtr	MR
	• Gate width	Required	4.50, 3.60 & 3.53 mtr	MR
	• Width of internal road	N/A	N/A	N/A
2	Number, width, type & arrangement of exits			
	a) Number of Staircase			
	➤ Upper floors	Required	6 No's	MR
	➤ Basement floor	N/A	N/A	N/A
	b) Width of Staircase			
	➤ Upper floors	Required	1.50m, 1.46m, 1.30m, 1.47m, 1.50m & 1.50m	MR
	➤ Basement floor	N/A	N/A	N/A
	c) Protection of exits			
	➤ Fire check door	N/A	N/A	N/A
	➤ Pressurization	N/A	N/A	N/A
	d) No. of continuous staircase to terrace	Required	05 Nos	MR
	e) Width of corridor	N/A	N/A	N/A
	f) Door size	1.0 mtr	Provided	MR
3	Compartmentation.			
	• Fire check door.	N/A	N/A	N/A
	• Sealing of electrical shafts.	N/A	N/A	N/A
	• Fire rating of shaft door.	N/A	N/A	N/A
	• Water curtain	N/A	N/A	N/A
	• Fire dampers.	NA	NA	NA
4.	Smoke Management system.			
	• Basement	30 ACPH	NA	NA
	• Upper floors	12 ACPH	NA	NA
5.	Fire Extinguishers.			
	• Total numbers	32 No's	40 No's	MR
	• Types	ABC / Co2	ABC-26 & Co2-14	MR
	• ISI Marking	ISI marked	Provided	MR
6.	First Aid Hose Reels.			
	• Total numbers on each floor.	3 No's	4 No's	MR
	• Length of hose-reel hose.	30 m	30 m	MR
	• Nozzle Diameter	5 mm	5 mm	MR


7	Automatic fire detection & alarming system			
	• Type of detectors	N/A	N/A	N/A
	• Location of Main Panel	N/A	N/A	N/A
	• Location of Repeater Panel	N/A	N/A	N/A
	• Alternate source of power	N/A	N/A	N/A
	• Hooter's location	N/A	N/A	N/A
8.	MOEFA.	Required	Provided	MR
9.	Public Address System	N/A	N/A	N/A
10.	Automatic Sprinkler System			
	• Basement	N/A	N/A	N/A
	• Upper floors	N/A	N/A	N/A
	• Sprinkler above false ceiling	N/A	N/A	N/A
11.	Internal Hydrants.			
	• Size of Riser/Down-comer	N/A	100 mm	N/A
	• Number of Hydrant per floor	N/A	4 Nos	N/A
	• Hose box.	N/A	4 Nos	N/A
12.	Yard Hydrants.			
	• Total number of hydrants.	N/A	N/A	N/A
	• Hose box.	N/A	N/A	N/A
13.	Pumping arrangements.			
	• Ground Level			
	➤ Discharge of main pump.	N/A	N/A	N/A
	➤ Head of main pump.	N/A	N/A	N/A
	➤ Number of main pumps.	N/A	N/A	N/A
	➤ Jockey Pump output.	N/A	N/A	N/A
	➤ Jockey Pump head.	N/A	N/A	N/A
	➤ Standby Pump output.	N/A	N/A	N/A
	➤ Standby pump head.	N/A	N/A	N/A
	➤ Auto Starting/Manual Stopping.	N/A	N/A	N/A
	• Terrace Level			
	➤ Discharge of pump.	Required	1234 LPM (2 No's)	MR
	➤ Head of pump.	Required	36 mtr each	MR
	➤ Power supply.	Required	Provided	MR
	➤ Auto starting of pump.	Required	Provided	MR
14.	Captive water storage for Fire Fighting.			
	• Underground tank capacity.	N/A	N/A	N/A
	➤ Draw-off connection.	N/A	N/A	N/A
	➤ Fire Service Inlet.	Required	Provided	MR
	➤ Access to tank.	N/A	N/A	N/A
	• Overhead tank capacity.	10,000 ltrs	40,000 ltrs	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provisions of Lifts.			
	• Pressurization of lift shaft.	N/A	N/A	N/A
	• Pressurization of lift lobby.	N/A	N/A	N/A
	• Communication in lift car.	N/A	N/A	N/A
	• Fireman's switch.	N/A	N/A	N/A
	• Lift signage.	N/A	N/A	N/A
17	Standby Power Supply	Required	Provided	MR
18.	Refuge Area			
	• Total area	N/A	N/A	N/A
	• Location	N/A	N/A	N/A

19.	Fire Control Room.	• Detector System Panel.	N/A	N/A	N/A
		• Flow Switch Panel.	N/A	N/A	N/A
		• PA system Panel.	N/A	N/A	N/A
		• Battery backup	N/A	N/A	N/A
		• Building floor plan	N/A	N/A	N/A
20.	Special Fire Protection System for the Protection of special Risk, if any.	N/A	N/A	N/A	

The Fire protection systems provided in the building were checked / operated at random and found functional at the time of inspection.


Keeping in view the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under DOE circular, FSC issued vide letter No. F.6/MS/DFS/School/2014/SZ/1229 Dated 19/09/2014, renewal under rule 37 of the Delhi Fire Service rules, 2010 is recommended.

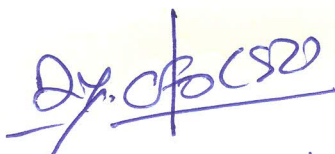
Accordingly, DFA is put up for approval and signature please.



 Signature of the Inspecting Officer
 Name: R.N. Singh
 Designation: ADO (BCP)

Ryan International School, Sector-C, Pocket-8, Vasant Kunj, New Delhi-110070


DO (SD)


 8/11/12



 Dy. CPO CS2



 Ramp
 9/11

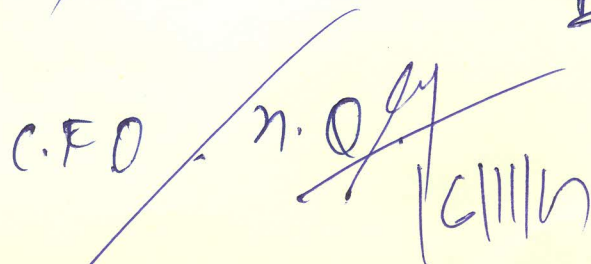



 CPO (S/M)


 m.s. yell


 FTR
 14/11

F.T letter is put up for sign. ple.
 CSO/S2 on leave  15/11


 C.F.O. n.o. gy
 16/11/17