

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI-110001**

No. F.6 DFS/MS/School/2017/SZ/ 1659

Dated: 16/11/17

FIRE SAFETY CERTIFICATE

Certified that the **S.D.M.C. Primary School No-2, Dr. Ambedkar Nagar, Sector-3, New Delhi-110062**, comprised of **Ground plus two upper floors** Owned/Occupied by South Delhi Municipal Corporation was inspected by officer concerned of this department on 28/10/2017 in presence of Ms. Mary Bibiana (Principal) and found that the School building have complied with fire prevention and fire safety requirements in accordance with Directorate of Education circular No 262-362 dated 17/01/2005 issued by Director of Education, Govt. of NCT of Delhi and that the school building is fit for occupancy class "**Educational Building**" Group-B, with effect from the date of issue of this certificate for a period of **Three years**, in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 16/11/17 at New Delhi by


**Chief Fire Officer
Ph. 011-23412225**

Copy to: -

1. The Principal, SDMC Primary School No-2, Dr. Ambedkar Nagar, Sector-3, N. Delhi-62
2. Directorate of Education, South MCD, Civic Centre, Minto Road, New Delhi- 110002


Conditions for the validity of Fire Safety Certificate

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of firefighting system.
4. The owner/ occupier shall submit a declaration every year in Form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in.
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL-2016), if any.
6. "The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry."

INSPECTION REPORT

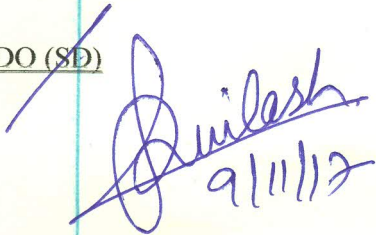
1	Name & Address of the Building	S.D.M.C. PRIMARY SCHOOL No-2, Dr. AMBEDKAR NAGAR, SECTOR-3, NEW DELHI- 110062		
2	Type of Occupancy	Group-B, "Educational Building" (School)		
3	Building Comprised of	Ground plus two upper floors.		
4	Type of Case	New		
5	Details of Previous NOC	Nil		
6	Fire Safety Directives Letter No	Dte of Education circular No 262-362 dated 17/01/2005		
7	Date of Inspection	28-10-2017		
8	Name of the Inspecting Officers	R.N. Singh, ADO (BCP)		
9	Name & Designation of Officers from the building side	Ms. Mary Biniana (Principal)		
10	Year of construction	2006		
11	Applicant letter No.	Nil Dated 04.08.2017, ODD No-10284 Dt. 23-08-2017		
S. No	Minimum standards on Fire Prevention and Fire Safety U/R 33	DOE circular requirement	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	• Road width	Accessible	6 mtr	MR
	• Gate width	-NA-	-NA-	MR
	• Width of internal road	-NA-	-NA-	-NA-
2	Number, width, type & arrangement of exits.			
	a) Number of Staircase			
	• Upper floors	One	Two	MR
	• Basement floor	-NA-	-NA-	-NA-
	b) Width of Staircase			
	• Upper floors	1.50m / 0.75m	1.37m & 1.33m	MR
	• Basement floor	-NA-	-NA-	-NA-
	c) Protection of exits			
	• Fire check door	-NA-	-NA-	-NA-
	• Pressurization	-NA-	-NA-	-NA-
	d) No. of continuous staircase to terrace	One	Two	MR
	e) Width of corridor	-NA-	-NA-	-NA-
	f) Door size	1m	Provided	MR
3	Compartmentation.			
	• Fire check door.	-NA-	-NA-	-NA-
	• Sealing of electrical shafts.	-NA-	-NA-	-NA-
	• Fire rating of shaft door.	-NA-	-NA-	-NA-
	• Water curtain	-NA-	-NA-	-NA-
	• Fire dampers.	-NA-	-NA-	-NA-
4.	Smoke Management system.			
	• Basement.	-NA-	-NA-	-NA-
	• Upper floors	-NA-	-NA-	-NA-
5.	Fire Extinguishers.			
	• Total numbers	7 No's	7 No's	MR
	• Types	ABC/Co2	ABC-07	MR
	• ISI Marking	ISI marked	Yes	MR
6.	First Aid Hose Reels.			
	• Total numbers on each floor.	One	One	MR
	• Length of hose-reel hose.	30 m	30 m	MR
	• Nozzle Diameter	5 mm	5 mm	MR

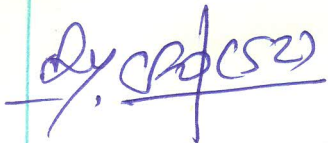
7	Automatic fire detection & alarming system.			
	<ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooter's location 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
8.	MOEFA	-NA-	Provided	-NA-
9.	Public Address System	-NA-	-NA-	-NA-
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> Basement. Upper floors Sprinkler above false ceiling 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
11.	Internal Hydrants.			
	<ul style="list-style-type: none"> Size of Riser / Down-comer Number of Hydrant per floor Hose box. 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
12.	Yard Hydrants.			
	<ul style="list-style-type: none"> Total number of hydrants. Hose box. 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
13.	Pumping arrangements.			
	<ul style="list-style-type: none"> Ground Level Discharge of main pump. Head of main pump Number of main pumps. Jockey Pump output. Jockey Pump head. Standby Pump output. Standby Pump head. Auto Starting / Manual Stopping. 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Terrace Level Discharge of pump. Head of pump. Power supply. Auto starting of pump. 	450 LPM	450 LPM	MR
		40 mtr	40 mtr	MR
		Required	Required	MR
		Required	Required	MR
14.	Captive water storage for Fire Fighting.			
	<ul style="list-style-type: none"> Underground tank capacity. <ul style="list-style-type: none"> Draw-off connection. Fire Service Inlet. Access to tank. Overhead tank capacity. 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		10,000 ltrs	10,000 ltrs	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			
	<ul style="list-style-type: none"> Pressurization of lift shaft. Pressurization of lift lobby. Communication in lift car. Fireman's switch. Lift signage. 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
17	Standby Power Supply	-NA-	-NA-	-NA-
18.	Refuge Area			
	<ul style="list-style-type: none"> Total area Location 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-


19.	Fire Control Room. <ul style="list-style-type: none"> • Detector System Panel. • Flow Switch Panel. • PA system Panel. • Battery backup • Building floor plan 	-NA-	-NA-	-NA-
20.	Special Fire Protection System for the Protection of special Risk, if any.	-NA-	-NA-	-NA-
<p>The Fire protection systems provided in the building were checked/ operated at random and found functional at the time of inspection. Shortcomings communicated vide letter dated 12/01/2014 & 01/04/2015 found complied.</p> <p>Keeping in view the substantially satisfactory compliance of the minimum standards on fire prevention and fire safety measures required under the Directorate of Education circular dated 17/01/2005, it is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules, 2010</p> <p>Accordingly DFA is put up for perusal and signature, if approved please.</p> <div style="text-align: right;">  Signature of the Inspecting Officer Name : R.N. Singh Designation: ADO (BCP) </div>				

S.D.M.C. Primary School No-2, Dr. Ambedkar Nagar, Sector-3, New Delhi-110062

DO (SD)


9/11/17





9/11


CFO (S.F.)

M. S. Pell

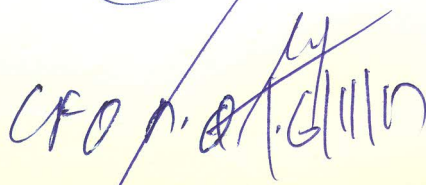
FT 101.


13/11

1391/CF-82
16/11

FT letter is put up for signature 
15/11

CFO (on leave)


16/11


16/11

