

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEAD QUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE  
NEW DELHI-110001**

Fax No. 011-23412593, Ph. 011-23412225

No. F.6 DFS/MS/School/2018/SZ/ 73

Dated: 10/01/18

**FIRE SAFETY CERTIFICATE**

Certified that **Baba Neem Karuli Sarvodaya Kanya Vidyalaya** located at **Jonapur, New Delhi-110047**, comprised of **Single storey** was issued Fire Safety Certificate by this department vide letter No. F.6/DFS/MS/School/2013/109 dated 22/03/2013. The premises was re-inspected by officer concerned of this department on 28/12/2017 in presence of Ms. Sushma Prakash (Vice Principal) and observed that a new building block, comprised of ground plus one upper floors have been constructed within the compound. The old & new school block have complied with the fire prevention and fire safety requirements in accordance with Directorate of Education circular F.16//Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011 issued by Director of Education, Govt. of NCT of Delhi and that the school building is fit for occupancy class "**Educational Building**" Group-B, as above with effect from the date of issue of this certificate for a period of **Three years** in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 10/01/18 at New Delhi by

  
(Vipin Kental)  
Chief Fire Officer

Copy to: -

1. The Vice Principal, BNK Sarvodaya Kanya Vidyalaya, Jonapur, New Delhi-110047
2. The Director of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi.


**Conditions for the validity of Fire Safety Certificate**

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of firefighting system.
4. The owner/ occupier shall submit a declaration every year in Form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in).
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL-2016), if any.
6. "The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry."

## INSPECTION REPORT

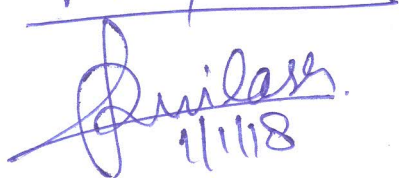
1	Name & Address of the Building	BABA NEEM KARALI SARVODAYA KANYA VIDYALAYA, JONAPUR, N. DELHI-47 (ID-1923003)		
2	Type of Occupancy	Educational Building "Group-B" (School)		
3	Building Comprised of	Old Block- Ground floor only. New Block- Ground + One upper floor		
4	Type of Case	Renewal & Addition of bldg block		
5	Details of Previous NOC	F.6/DFS/MS/School/2013/109 Dated 22-03-2013		
6	Fire Safety Directives Letter No	F.16//Estate/CC/Fire Safety/2011/3298 to 3398 Dt. 01/03/2011		
7	Date of Inspection	28-12-2017		
8	Name of the Inspecting Officers	R.N. Singh, ADO (BCP)		
9	Name & Designation of Officers from the building side	Ms. Sushma Prakash (Vice Principal)		
10	Year of construction	1988 & 2013		
11	Applicant letter No.	BNK/SKV/3006B Dated 01/12/2017		
S. No	Minimum standards on Fire Prevention and Fire Safety U/R 33	DOE circular requirement	Provided at Site	Remarks MR/NMR
1	<b>Access to Building.</b>			
	• Road width	Required	6 mtr	MR
	• Gate width	-NA-	4 mtr	-NA-
	• Width of internal road	-NA-	-NA-	-NA-
2	<b>Number, width, type arrangement of exits.</b>			
	<b>a) Number of Staircase</b>			
	➤ Upper floors	Two	Two	MR
	➤ Basement floor	-NA-	-NA-	-NA-
	<b>b) Width of Staircase</b>			
	➤ Upper floors	1.5m / 0.75m	1.79m & 1.80m	MR
	➤ Basement floor	-NA-	-NA-	-NA-
	<b>c) Protection of exits</b>			
	➤ Fire check door	-NA-	-NA-	-NA-
	➤ Pressurization	-NA-	-NA-	-NA-
	<b>d) No. of continuous staircase to terrace</b>	-NA-	-NA-	-NA-
	<b>e) Width of corridor</b>	-NA-	-NA-	-NA-
	<b>f) Door size</b>	1 mtr	Provided	MR
3	<b>Compartmentation.</b>			
	• Fire check door.	-NA-	-NA-	-NA-
	• Sealing of electrical shafts.	-NA-	-NA-	-NA-
	• Fire rating of shaft door.	-NA-	-NA-	-NA-
	• Water curtain	-NA-	-NA-	-NA-
	• Fire dampers.	-NA-	-NA-	-NA-
4.	<b>Smoke Management system.</b>			
	• Basement	-NA-	-NA-	-NA-
	• Upper floors	-NA-	-NA-	-NA-
5.	<b>Fire Extinguishers.</b>			
	• Total numbers		26 No's	MR
	• Types	ISI Marked	ABC-13, Co2-13	MR
	• ISI Marking		Provided	MR
6.	<b>First Aid Hose Reels.</b>			
	• Total numbers on each floor.	-NA-	-NA-	-NA-
	• Length of hose-reel hose.	-NA-	-NA-	-NA-
	• Nozzle Diameter	-NA-	-NA-	-NA-


7	<b>Automatic fire detection &amp; alarming system.</b>			
	• Type of detectors	-NA-	-NA-	-NA-
	• Location of Main Panel	-NA-	-NA-	-NA-
	• Location of Repeater Panel	-NA-	-NA-	-NA-
	• Alternate source of power	-NA-	-NA-	-NA-
	• Hooter's location	-NA-	-NA-	-NA-
8.	<b>MOEFA</b>	-NA-	-NA-	-NA-
9.	<b>Public Address System</b>	-NA-	-NA-	-NA-
10.	<b>Automatic Sprinkler System</b>	-NA-	-NA-	-NA-
	• Basement.	-NA-	-NA-	-NA-
	• Upper floors	-NA-	-NA-	-NA-
	• Sprinkler above false ceiling	-NA-	-NA-	-NA-
11.	<b>Internal Hydrants.</b>			
	• Size of Riser / Down-comer	-NA-	-NA-	-NA-
	• Number of Hydrant per floor	-NA-	-NA-	-NA-
	• Hose box.	-NA-	-NA-	-NA-
12.	<b>Yard Hydrants.</b>			
	• Total number of hydrants.	-NA-	-NA-	-NA-
	• Hose box.	-NA-	-NA-	-NA-
13.	<b>Pumping arrangements.</b>			
	• <b>Ground Level</b>			
	➤ Discharge of main pump.	-NA-	-NA-	-NA-
	➤ Head of main pump.	-NA-	-NA-	-NA-
	➤ Number of main pumps.	-NA-	-NA-	-NA-
	➤ Jockey Pump output.	-NA-	-NA-	-NA-
	➤ Jockey Pump head.	-NA-	-NA-	-NA-
	➤ Standby Pump output.	-NA-	-NA-	-NA-
	➤ Standby Pump head.	-NA-	-NA-	-NA-
	➤ Auto Starting / Manual Stopping.	-NA-	-NA-	-NA-
	• <b>Terrace Level</b>			
	➤ Discharge of pump.	-NA-	-NA-	-NA-
	➤ Head of pump.	-NA-	-NA-	-NA-
	➤ Power supply.	-NA-	-NA-	-NA-
	➤ Auto starting of pump.	-NA-	-NA-	-NA-
14.	<b>Captive water storage for Fire Fighting.</b>			
	• Underground tank capacity.	-NA-	-NA-	-NA-
	➤ Draw-off connection.	-NA-	-NA-	-NA-
	➤ Fire Service Inlet.	-NA-	-NA-	-NA-
	➤ Access to tank.	-NA-	-NA-	-NA-
	• Overhead tank capacity.	-NA-	-NA-	-NA-
15.	<b>Exit Signage.</b>	-NA-	-NA-	-NA-
16.	<b>Provision of Lifts.</b>			
	• Pressurization of lift shaft.	-NA-	-NA-	-NA-
	• Pressurization of lift lobby.	-NA-	-NA-	-NA-
	• Communication in lift car.	-NA-	-NA-	-NA-
	• Fireman's switch.	-NA-	-NA-	-NA-
	• Lift signage.	-NA-	-NA-	-NA-
17	<b>Standby Power Supply</b>	-NA-	-NA-	-NA-
18.	<b>Refuge Area</b>			
	• Total area	-NA-	-NA-	-NA-
	• Location	-NA-	-NA-	-NA-

19.	<b>Fire Control Room.</b>	-NA-	-NA-	-NA-
	• Detector System Panel.	-NA-	-NA-	-NA-
	• Flow Switch Panel.	-NA-	-NA-	-NA-
	• PA system Panel.	-NA-	-NA-	-NA-
	• Battery backup	-NA-	-NA-	-NA-
	• Building floor plan	-NA-	-NA-	-NA-
20.	<b>Special Fire Protection System for the Protection of special Risk, if any.</b>	-NA-	-NA-	-NA-
<p>The old building block comprised of Ground floor only was issued FSC by this department vide letter No. F.6/DFS/MS/School/2013/109 dated 22/03/2013, an additional building block comprised of ground plus one upper floor has been constructed in the existing compound by PWD, Govt. of NCT of Delhi.</p> <p>The Fire protection systems provided in the building were checked / operated and found functional at the time of inspection.</p> <p>Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety measures as required under the rules, it is recommended to issue Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules, 2010.</p> <p>Accordingly DFA is put up for approval and signature please.</p> <p style="text-align: right;">               Signature of the Inspecting Officer              Name : R.N. Singh              Designation: ADO (BCP)         </p>				

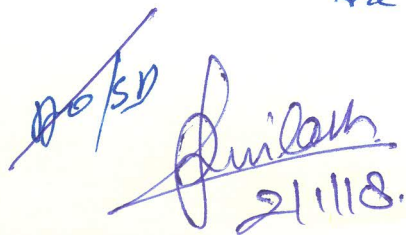
BNK Sarvodaya Kanya Vidyalaya, Jonapur, New Delhi-110047


DO (SD)

fl Speak  
  
 11/11/18

ADO  


Spoken with DO/SD and necessary  
 corrections as per DOFC have been made  
 in the inspection report and  
 re-submitted for

DO/SD  
  
 21/11/18.

  
 02/11/18

1517/CF-52  
 8/11/18

DO (SD)  
 and leave.

FT/ST

M.Scell