

FORM 'H'  
FORM FOR ISSUING FIRE SAFETY CERTIFICATE

[Refer sub - rule (1) of rule 35]

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE**  
**NEW DELHI**

No. F6/Dfs/MS/EH/2018/W2/189

Dated: 01/02/18

**FIRE SAFETY CERTIFICATE**

Certified that the Carl's Junior located at 26, NWA, Club Road, Punjabi Bagh Extension, New Delhi-110026, operating on upper ground floor only in a building comprising of Basement, Stilt Floor, Upper Ground Floor + Three Upper Floors owned / occupied by Cybiz Bright Star Restaurants Pvt. Ltd. have complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rule, 2010 and verified by officers concerned of Fire Service on dated 18/01/2018 in the presence of Sh. Manoj and that the premises is fit for occupancy class "Assembly" Restaurant (Group-D) with effect from 01/02/18 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 01/02/18 at New Delhi by.

  
(ATUL GARG)  
CHIEF FIRE OFFICER.

Copy to :-

1. Dy. Health Officer (West Zone), South Delhi Municipal Corporation, Rajouri Garden, New Delhi-110027.
2. Akash Singh (Legal & Compliance Manager), 309-310, Udyog Vihar, Phase-4, Gurugram, Haryana-122015.

**Conditions for the validity of Fire Safety Certificate:**

1. All the fire safety arrangement provided their in shall be maintained in good working conditions at all times.
2. Loss of life or property due to non functional fire safety measure shall be at the responsibility of the management.
3. The trained fire fighting staff should be available round the clock.
4. Any deviation with regard to the construction etc shall be verified by the concerned building sanctioning agency.
5. The Basement shall be used strictly as per the provision of building bye laws.
6. This certificate cannot be treated in any case for regularizations of unauthorized construction.
7. "The owner / Occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule37] along with a copy of this Certificate, six months prior to its expiry".
8. The owner / occupier shall submit a declaration every year in form "K" provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on [WWW.dfs.Delhigovt.nic.in](http://WWW.dfs.Delhigovt.nic.in)

## INSPECTION REPORT

1. Name & address of the building: **Carl's Junior at 26, NWA, Club Road, Punjabi Bagh Extension, New Delhi-26.**
2. Type of Occupancy : **Assembly (Restaurant at upper Ground Floor)**
3. Type of Case : New
4. Details of previous NOC : Nil
5. Fire Safety directives Letter No. : NBC (Part-IV)
6. Date of inspection : 18/01/2018
7. Name of the Inspecting Officer : D.W. (West) & A.D.O. (Jwala Puri)
8. Name and designation of Officer  
from the building side : Mr. Manoj
9. Year of Construction : ----
10. Applicant's letter No. : - Nil Dated 01/12/2017

Basement, Stilt Floor, Ground Floor + Three Upper Floors Total Area -164 m <sup>2</sup>
--------------------------------------------------------------------------------------------------

S. No	Minimum standards on fire prevention and fire safety U/R 33	NBC (Part (IV) Requirements	Provided at site	Remarks MR/NMR
1.	Access of building			
	• Road width	09 mtr	09 mtr	MR
	• Gate width	On Road	On Road	MR
	• Width of internal road	N/A	N/A	N/A
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	• Upper floors	2	2	MR
	• Basements	NA	NA	NA
	b. Width of staircases			
	• Upper floors	1.50 mtr	2.00 mtr x 1, 1.25 mtr x 1 1.00 mtr x 1, 0.85 mtr x 1	MR
	• Basements	NA	NA	NA
	c. Protection of exits			
	• Fire check door	N/A	N/A	N/A
	• Pressurization	N/A	N/A	N/A
	d. No of continuous staircase to terrace	1	1	MR
	e. Width Of Corridor	N/A	N/A	N/A
	f. Door Size	2 mtr	2.00 mtr x 1, 1.50 mtr x 1 1.20 mtr x 1, 0.85 mtr x 1	MR
3.	Compartmentation			
	• Fire check door	N/A	N/A	N/A
	• Sealing of electrical shafts	N/A	N/A	N/A
	• Fire Rating of shaft door	N/A	N/A	N/A
	• Water Curtain	N/A	N/A	N/A
	• Fire Dampers	N/A	N/A	N/A
4.	Smoke managements System			
	• Basements	NA	NA	NA
	• Upper floors	Required	Provided	MR
5.	Fire Extinguishers			
	• Total numbers	4	5	MR
	• Types	ISI marked ABC/CO <sub>2</sub>	Provided	MR
	• IS marking	Required	Provided	MR



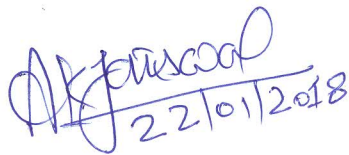
6.	First – Aid Hose Reels			
	• Total numbers on each floor	1	Provided	MR
	• Length of hose reel hose	30 Mtr.	Provided	MR
	• Nozzle diameter	5mm	Provided	MR
7.	Automatic fire detection and alarming system			
	• Type of detector	NA	Smoke	NA
	• Location of Main Panel	NA	NA	NA
	• Location of Repeater Panel	NA	NA	NA
	• Alternate source of power	NA	NA	NA
	• Hooters' Location	NA	NA	NA
8.	MOEFA	NA	NA	NA
9.	Public Address System	N/A	N/A	N/A
10.	Automatic Sprinkler System			
	• Basements	NA	NA	NA
	• Upper Floor	NA	Provided	NA
	• Sprinkler above false ceiling	NA	NA	NA
11.	Internal Hydrants			
	• Size of riser/down-comer	Required	Provided	MR
	• Number of hydrants per floor	NA	NA	NA
	• Hose Box	NA	NA	NA
12.	Yard Hydrants			
	• Total number of hydrants	N/A	N/A	N/A
	• Hose Box	N/A	N/A	N/A
13.	Pumping Arrangements			
	• Ground Level			
	• Discharge of main pump	N/A	N/A	N/A
	➤ Head of main pump	N/A	N/A	N/A
	➤ Number of main pumps	N/A	N/A	N/A
	➤ Jockey pump out put	N/A	N/A	N/A
	➤ Jockey pump head	N/A	N/A	N/A
	➤ Standby Pump out put	N/A	N/A	N/A
	➤ Standby Pump Head	N/A	N/A	N/A
	➤ Auto Starting/Manual stopping	N/A	N/A	N/A
	➤ Pump House Access	N/A	N/A	N/A
	• Terrace level			
	➤ Discharge of pump	450 LPM	450 LPM	MR
	➤ Head of the pump	40 Meter Head	40 Meter Head	MR
	➤ Power supply	Required	Provided	MR
	➤ Auto starting of pump	Required	Provided	MR
14.	Captive water Storage for fire fighting			
	• Underground tank capacity	N/A	N/A	N/A
	➤ Draw of connection	N/A	N/A	N/A
	➤ Fire service inlet	N/A	N/A	N/A
	➤ Access to tank	N/A	N/A	N/A
	• Overhead Tank	20,000 ltr	20,000 ltr	MR

2/10


15	Exit Signage	Required	Provided	M/R
16.	Provision of Lifts			
	➤ Pressurization of Lift Shaft	N/A	N/A	N/A
	➤ Pressurization of lift lobby	N/A	N/A	N/A
	➤ Communication in lift Car	N/A	N/A	N/A
	➤ Fireman's Grounding Switch	N/A	N/A	N/A
	➤ Lift Signage	N/A	N/A	N/A
17.	Standby power supply	Required	Provided	MR
18.	Refuge Area			
	➤ Total area	N/A	N/A	N/A
	➤ Location	N/A	N/A	N/A
19.	Fire control room			
	➤ Detector system panel	N/A	N/A	N/A
	➤ Flow Switch Panel	N/A	N/A	N/A
	➤ PA System Panel	N/A	N/A	N/A
	➤ Battery backup	N/A	N/A	N/A
	➤ Building Floor Plans	N/A	N/A	N/A
20.	Special Fire Protection Systems for Protection of special Risks, if any;	N/A	N/A	N/A

The fire protection systems provided in the building were tested, checked and found functional at the time of inspection.


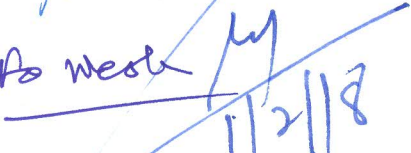
Keeping in view of the substantial compliance of the minimum standards on fire prevention and fire safety measures as required under the rules it is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service rules 2010.


  
22/01/2018

Signature of the Inspecting Officer  
Name : Ashok Kumar Jaiswal  
Designation : A.D.O. (Jwala Puri)

  
30/1/18

Signature of the Inspecting Officer  
Name : Mukesh Verma  
Designation : D.O. (West)

  
D. O. (W 2)  
  
A. D. O. (Jwala Puri)  
11/2/18  
K T PLS

  
11/2/18