

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI-110001**

Fax No. 011-23412593, Ph. 011-23412225

No. F.6 DFS/MS/School/2018/SZ/ 273

Dated: 21/2/18

FIRE SAFETY CERTIFICATE

Certified that **Lalit Mahajan SVM School** located at Vasant Vihar, New Delhi-110057 comprised of **Ground and three upper floors**, having total 38 rooms (class-room-33, office-01, staff room-04) owned/occupied by Samarth Shiksha Samiti Delhi was issued Fire Safety Certificate by this department vide letter No. F.6/MS/DFS/School/2014/SZ/1051 Dated 21/08/2014. The school building was re-inspected by officer concerned of this department on 01/02/2018 in presence of Mr. Chander Prakash (Admin) and found that the said School building have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of Delhi Fire Service Rules, 2010 and that the building/premises is fit for occupancy class "**Educational**" Group-B (School) with effect from the date of issue of this certificate for a period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 21/2/18 at New Delhi by


(Vipin Kental)
Chief Fire Officer

Copy to: -

1. The Principal, Lalit Mahajan SVM School, Vasant Vihar, New Delhi-110057
2. The Director of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi.

Conditions for the validity of Fire Safety Certificate

1. All the means of escape/entry/exit shall be kept unlocked and free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of firefighting system.
4. The owner/ occupier shall submit a declaration every year in Form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in.
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL-2016), if any.
6. "The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry."

INSPECTION REPORT				
1	Name & Address of the Building	LALIT MAHAJAN SVM SCHOOL, VASANT VIHAR, NEW DELHI-110057		
2	Type of Occupancy	Educational Building "Group-B"		
3	Building Comprised of	Ground + 3 Upper Floors.		
4	Type of Case	Renewal		
5	Details of Previous NOC	F.6/DFS/MS/School/2014/SZ/1051 dated 21/08/2014		
6	Fire Safety Directives Letter No	F.6/DFS/MS/BP/2003/313 Dated 07-02-2003		
7	Date of Inspection	01-02-2018		
8	Name of the Inspecting Officers	R.N. Singh, ADO (BCP)		
9	Name & Designation of Officers from the building side	Mr. Chander Prakash (Admin)		
10	Year of construction	2003		
11	Applicant letter No.	Nil Dated 13-01-2018, ODD. No. 677 dated 15-01-18		
S. No	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC requirement	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	• Road width	Required	9 mtr	MR
	• Gate width	Required	5 mtr	MR
	• Width of internal road	N/A	N/A	N/A
2	Number, width, type & arrangement of exits			
	a) Number of Staircase			
	➤ Upper floors	03 Nos	03 Nos	MR
	➤ Basement floor	N/A	N/A	N/A
	b) Width of Staircase			
	➤ Upper floors	1.5 mtr	1.8m, 1.5m & 1.5m	MR
	➤ Basement floor	N/A	N/A	N/A
	c) Protection of exits			
	➤ Fire check door	N/A	N/A	N/A
	➤ Pressurization	N/A	N/A	N/A
	d) No. of continuous staircase to terrace	Required	03 Nos	MR
	e) Width of corridor	N/A	1.5m	N/A
	f) Door size	N/A	N/A	N/A
3	Compartmentation.			
	• Fire check door.	N/A	N/A	N/A
	• Sealing of electrical shafts.	N/A	N/A	N/A
	• Fire rating of shaft door.	N/A	N/A	N/A
	• Water curtain	N/A	N/A	N/A
	• Fire dampers.	N/A	N/A	N/A
4.	Smoke Management system.			
	• Basement	30 ACPH	N/A	N/A
	• Upper floors	12 ACPH	N/A	N/A
5.	Fire Extinguishers.			
	• Total numbers		40 Nos	MR
	• Types	ISI marked	ABC, Co2, W.Co2	MR
	• ISI Marking		Provided	MR
6.	First Aid Hose Reels.			
	• Total numbers on each floor.		01 No	MR
	• Length of hose-reel hose.	Hose-reels	30 m	MR
	• Nozzle Diameter		5 mm	MR

Lalit Mahajan SVM School, Vasant Vihar, New Delhi-110057


7	Automatic fire detection & alarming system			
	<ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooter's location 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
8.	MOEFA	N/A	Provided	N/A
9.	Public Address System	N/A	N/A	N/A
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> Basement Upper floors Sprinkler above false ceiling 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
11.	Internal Hydrants.			
	<ul style="list-style-type: none"> Size of Riser/Down-comer Number of Hydrant per floor Hose box. 	Required	100 mm	N/A
		Required	One	N/A
		Required	One	N/A
12.	Yard Hydrants.			
	<ul style="list-style-type: none"> Total number of hydrants. Hose box. 	N/A	N/A	N/A
		N/A	N/A	N/A
13.	Pumping arrangements.			
	<ul style="list-style-type: none"> Ground Level <ul style="list-style-type: none"> Discharge of main pump. Head of main pump. Number of main pumps. Jockey Pump output. Jockey Pump head. Standby Pump output. Standby pump head. Auto Starting/Manual Stopping. Terrace Level <ul style="list-style-type: none"> Discharge of pump. Head of pump. Power supply. Auto starting of pump. 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		450 LPM	900 & 180 LPM	MR
		40m	40m each	MR
		Required	Provided	MR
		Required	Provided	MR
14.	Captive water storage for Fire Fighting.			
	<ul style="list-style-type: none"> Underground tank capacity. <ul style="list-style-type: none"> Draw-off connection. Fire Service Inlet. Access to tank. Overhead tank capacity. 	50,000 Ltr	50,000 Ltr	MR
		Required	Provided	MR
		Required	Provided	MR
		Required	Provided	MR
		Required	Provided	MR
		10,000 Ltr	10,000 Ltr	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provisions of Lifts.			
	<ul style="list-style-type: none"> Pressurization of lift shaft. Pressurization of lift lobby. Communication in lift car. Fireman's switch. Lift signage. 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
17	Standby Power Supply	N/A	Provided	N/A
18.	Refuge Area			
	<ul style="list-style-type: none"> Total area Location 	N/A	N/A	N/A
		N/A	N/A	N/A

19.	Fire Control Room.	• Detector System Panel.	N/A	N/A	N/A
		• Flow Switch Panel.	N/A	N/A	N/A
		• PA system Panel.	N/A	N/A	N/A
		• Battery backup	N/A	N/A	N/A
		• Building floor plan	N/A	N/A	N/A
20.	Special Fire Protection System for the Protection of special Risk, if any.	N/A	ABC type fire extinguishers provided near electric panel	N/A	

The Fire protection systems provided in the building were test checked at random and found functional at the time of inspection.

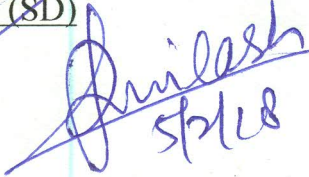
Keeping in view the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under the rule, FSC issued vide letter No. F.6/DFS/MS/School/2014/SZ/1051 dated 21/08/2014, renewal under rule 37 of the Delhi Fire Service rules, 2010 is recommended.

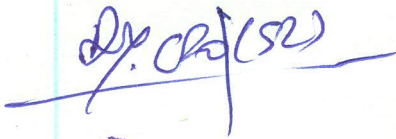
Accordingly, DFA is put up for approval and signature please.



 Signature of the Inspecting Officer
 Name: R.N. Singh
 Designation: ADO (BCP)

Lalit Mahajan SVM School, Vasant Vihar, New Delhi-110057

DO (SD)


sp/18


CFO (S2)


M.S. Cell




1608 CFO S2

2/2

CFO (S2)

M.S. Cell


FTM.



2/2

F.T letter is put up for signature.

CFO/S2

M.S. Cell


2/2


15/2