

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI-110001**

Fax No. 011-23412593, Ph. 011-23412225

No. F.6 DFS/MS/School/2018/SZ/ 328

Dated: 27/2/17

FIRE SAFETY CERTIFICATE

Certified that **The Shri Ram School** located at **D-3 Street, Vasant Vihar, New Delhi-110057** comprised of Basement, Ground plus two upper floors (01 block) and Ground plus three upper floors (01 block) both interconnected blocks, was issued Fire Safety Certificate by this department vide letter No. F.6/MS/DFS/School/2015/SZ/68 Dated 14/01/2015. The school premises was re-inspected by officer concerned of this department on 29/01/2018 in presence of Mr. Chitra Singh (Administrator) and found that the said School building have deemed complied with the fire prevention and fire safety requirements in accordance with Directorate of Education Circular No. F.16//Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011 issued by Director of Education, Govt. of NCT of Delhi and that the building/premises is fit for occupancy class "**Educational Building**" Group-B, with effect from the date of issue of this certificate for a period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 27/2/17 at New Delhi by

27/2
(Vipin Kental)
Chief Fire Officer

Copy to: -

1. The Administrator, The Shri Ram School, D-3 Street, Vasant Vihar, New Delhi-110057
2. The Director of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi.

Conditions for the validity of Fire Safety Certificate

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of firefighting system.
4. The owner/ occupier shall submit a declaration every year in Form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in.
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL-2016), if any.
6. "The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry."

INSPECTION REPORT

1	Name & Address of the Building	THE SHRI RAM SCHOOL, D-3 STREET, VASANT VIHAR, NEW DELHI-110057		
2	Type of Occupancy	Educational Building "Group-B"		
3	Building Comprised of	B+G+2 (one side), G+3 (other side) Interconnected block		
4	Type of Case	Renewal		
5	Details of Previous NOC	F.6/MS/DFS/School/2015/SZ/68 Dt. 14/01/2015		
6	Fire Safety Directives Letter No	DOE Circular No 262-362 dated 17/01/2005		
7	Date of Inspection	29-01-2018		
8	Name of the Inspecting Officers	R.N. Singh, ADO (BCP)		
9	Name & Designation of Officers from the building side	Mr. Chitra Singh (Administrator)		
10	Year of construction	1995		
11	Applicant letter No.	Nil Dated 04/01/2018		
S. No	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC requirement	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	• Road width	Required	9 mtr	MR
	• Gate width	Required	4 mtr	MR
	• Width of internal road	N/A	N/A	N/A
2	Number, width, type & arrangement of exits			
	a) Number of Staircase			
	➤ Upper floors	02 Nos	02 Nos	MR
	➤ Basement floor	02 Nos	02 Nos	N/A
	b) Width of Staircase			
	➤ Upper floors	1.5 mtr	1.5 mtr each	MR
	➤ Basement floor	N/A	N/A	N/A
	c) Protection of exits			
	➤ Fire check door	N/A	N/A	N/A
	➤ Pressurization	N/A	N/A	N/A
	d) No. of continuous staircase to terrace	Required	One	MR
	e) Width of corridor	N/A	1.5m	N/A
	f) Door size	1m	Provided	MR
3	Compartmentation.			
	• Fire check door.	N/A	N/A	N/A
	• Sealing of electrical shafts.	N/A	N/A	N/A
	• Fire rating of shaft door.	N/A	N/A	N/A
	• Water curtain	N/A	N/A	N/A
	• Fire dampers.	N/A	N/A	N/A
4.	Smoke Management system.			
	• Basement	30 ACPH	Exhaust fan provided	MR
	• Upper floors	12 ACPH	N/A	N/A
5.	Fire Extinguishers.			
	• Total numbers		30 Nos	MR
	• Types	ISI marked	ABC type	MR
	• ISI Marking		Provided	MR
6.	First Aid Hose Reels.			
	• Total numbers on each floor.		02 Nos	MR
	• Length of hose-reel hose.	Hose-reels	30 m	MR
	• Nozzle Diameter		5 mm	MR

The Shri Ram School, D-3 Street, Vasant Vihar, New Delhi-110057


R.

7	Automatic fire detection & alarming system			
	<ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooter's location 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
8.	MOEFA	N/A	N/A	N/A
9.	Public Address System	Required	Provided	MR
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> Basement Upper floors Sprinkler above false ceiling 	Required	Provided	MR
		N/A	N/A	N/A
		N/A	N/A	N/A
11.	Internal Hydrants.			
	<ul style="list-style-type: none"> Size of Riser/Down-comer Number of Hydrant per floor Hose box. 	N/A	100 mm	N/A
		N/A	02 Nos	N/A
		N/A	02 Nos	N/A
12.	Yard Hydrants.			
	<ul style="list-style-type: none"> Total number of hydrants. Hose box. 	N/A	N/A	N/A
		N/A	N/A	N/A
13.	Pumping arrangements.			
	<ul style="list-style-type: none"> Ground Level <ul style="list-style-type: none"> Discharge of main pump. Head of main pump. Number of main pumps. Jockey Pump output. Jockey Pump head. Standby Pump output. Standby pump head. Auto Starting/Manual Stopping. Terrace Level <ul style="list-style-type: none"> Discharge of pump. Head of pump. Power supply. Auto starting of pump. 	N/A	900 LPM	N/A
		N/A	40 mtr	N/A
		N/A	One	N/A
		N/A	180 LPM	N/A
		N/A	40 mtr	N/A
		N/A	900 LPM	N/A
		N/A	40 mtr	N/A
		N/A	Provided	N/A
		450 LPM	450 & 180 LPM	MR
		40m	40m each	MR
		Required	Provided	MR
		Required	Provided	MR
14.	Captive water storage for Fire Fighting.			
	<ul style="list-style-type: none"> Underground tank capacity. <ul style="list-style-type: none"> Draw-off connection. Fire Service Inlet. Access to tank. Overhead tank capacity. 	N/A	50,000 Ltr	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		5,000 Ltr	10,000 Ltr	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provisions of Lifts.			
	<ul style="list-style-type: none"> Pressurization of lift shaft. Pressurization of lift lobby. Communication in lift car. Fireman's switch. Lift signage. 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
17	Standby Power Supply	N/A	Provided	N/A
18.	Refuge Area			
	<ul style="list-style-type: none"> Total area Location 	N/A	N/A	N/A
		N/A	N/A	N/A

19.	Fire Control Room.	• Detector System Panel.	N/A	N/A	N/A
		• Flow Switch Panel.	N/A	N/A	N/A
		• PA system Panel.	N/A	N/A	N/A
		• Battery backup	N/A	N/A	N/A
		• Building floor plan	N/A	N/A	N/A
20.	Special Fire Protection System for the Protection of special Risk, if any.	N/A	N/A	N/A	

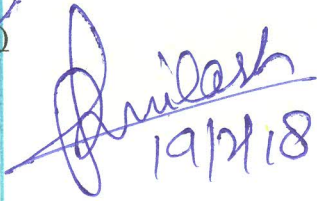
The Fire protection systems provided in the building were test checked at random and found functional at the time of inspection. Keeping in view the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under Directorate of Education circular, Fire Safety Certificate issued vide letter No. F.6/DFS/MS/School/2015/SZ/68 dated 14/01/2015, renewal under rule 37 of the Delhi Fire Service rules, 2010 is recommended.

Accordingly, DFA is put up for approval and signature please.


 Signature of the Inspecting Officer
 Name: R.N. Singh
 Designation: ADO (BCP)

The Shri Ram School, D-3 Street, Vasant Vihar, New Delhi-110057


DO (SD)


19/2/18



1633/CFSE
22/2/2018




19/2

ifo (sp)

m.scell


FT 101

FT letter is put up for sign. ple

ifo/sp

m.scell


20/2


20/2