

FORM 'H'
FORM FOR ISSUING FIRE SAFETY CERTIFICATE
[Refer sub - rule (1) of rule 35]
GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE
NEW DELHI

No. F6/DFS/MS/2018/ WZ/ 381

Dated: 9 /03/2018

FIRE SAFETY CERTIFICATE

Certified that the **Vidya Jyoti Memorial School**, located at **WZ-1272,Rani Bagh, Delhi-34** comprised of Ground + 03 Upper Floors was issued FSC vide Letter No. F6/DFS/MS/2015/ WZ/168 Dated 05/02/2015. The premises was re inspected by the officers concerned of this department on 21-02-2018 in the presence of **Smt Krishna Chhibber (Principal)** and observed that all the fire prevention and fire safety arrangements provided in the premises found in good working condition. The premises have therefore deem complied with the fire prevention and fire safety requirements in accordance DOE Circular 262-362 Dated 17-01-2005 and that the premises is fit for occupancy class "Educational" Group B with effect from 9/3/18 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on ... 9/3/18 at New Delhi by.


(Atul Garg)
Chief Fire Officer
Delhi Fire Service.

Copy to:

1. The Principal, Vidya Jyoti Memorial School, WZ-1272, Rani Bagh, Delhi-34

Following fire safety directives must be adhered to:-

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
3. The trained staff should be available round the clock.
4. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
5. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
6. The basement shall be used strictly as per building bye laws.
7. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.

INSPECTION REPORT

1. Name & address of the building: Vidya Jyoti Memorial School, WZ-1272, Rani Bagh, Delhi-34
2. Type of Occupancy : Educational Total one Blocks (Ground + 3 Upper Floor)
3. Type of Case : Renewal
4. Details of previous NOC : F-6/DFS/MS/School/2015/WZ/168 Dated 05/02/2015
5. Fire Safety directives Letter No. : DOE circular 262-362 dated 17-01-2005
6. Date of inspection : 21-02-2018
7. Name of the Inspecting Officer : ADO (WP)
8. Name and designation of Officer
from the building side : Smt Krishna Chhibber (Principal)
9. Year of Construction : 1987
10. Applicant's letter No. : No. VJM/2018 Dated Nil

Plot Area - 150 M²
 Covered Area - 150 M²
 No. or Class Rooms - 10
 No. of Student - 167

S No	Minimum standards on fire prevention and fire safety U/R 33	Cr.No.262-362 dated 17-1-05	Provided at site	Remarks MR/NMR
1.	Access of building			
	• Road width	Accessible	Provided (Accessible for small Tender with one length hose)	Old case
	• Gate width	Accessible	Old case	Old case
	• Width of internal road	NA	NA	NA
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	• Upper floors	2	Provided	MR
	• Basements	NA	NA	NA
	b. Width of staircases			
	• Upper floors	1.5mtrs	1x varies from 72cm to 92cm & 1x 63cm	MR Old case
	• Basements	NA	NA	NA
	c. Protection of exits			
	• Fire check door	NA	NA	NA
	• Pressurization	NA	NA	NA
	d. No of continuous staircase to terrace	1	Provided	MR
	e. Width Of Corridor	NA	NA	NA
	f. Door Size	1mtr	Provided (Including door frame)	MR

3.	Compartmentation			
	• Fire check door	NA	NA	NA
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4.	Smoke managements System			
	• Basements	NA	NA	NA
	• Upper floors	NA	NA	NA
5.	Fire Extinguishers			
	• Total numbers	8nos.	Provided	MR
	• Types	ABC & CO ₂	Provided	MR
	• IS marking	ISI marked	Provided	MR
6.	First – Aid Hose Reels			
	• Total numbers on each floor	1	Provided	MR
	• Length of hose reel hose	30m	Provided	MR
	• Nozzle diameter	5mm	Provided	MR
7.	Automatic fire detection and alarming system			
	• Type of detectors	NA	NA	NA
	• Location of Main Panel	NA	NA	NA
	• Location of Repeater Panel	NA	NA	NA
	• Alternate source of power	NA	NA	NA
	• Hooters' Location	NA	NA	NA
8.	MOEFA	Required	Provided	MR
9.	Public Address System	Required	Provided	MR
10.	Automatic Sprinkler System			
	• Basements	NA	NA	NA
	• Upper Floor	NA	NA	NA
	• Sprinkler above false ceiling	NA	NA	NA
11.	Internal Hydrants:			
	• Size of riser/down-comer	100mm	Provided	NA
	• Number of hydrants per floor	NA	Provided	NA
	• Hose Box	NA	Provided	MR
12.	Yard Hydrants			
	• Total number of hydrants	NA	NA	NA
	• Hose Box	NA	NA	NA

13.	Pumping Arrangements:			
	• Ground Level			
	• Discharge of main pump	NA	NA	NA
	➤ Head of main pump	NA	NA	NA
	➤ Number of main pumps	NA	NA	NA
	➤ Jockey pump out put	NA	NA	NA
	➤ Jockey pump head	NA	NA	NA
	➤ Standby Pump out put	NA	NA	NA
	➤ Standby Pump Head	NA	NA	NA
	➤ Auto Starting/Manual stopping	NA	NA	NA
	➤ Pump House Access	NA	NA	NA
	• Terrace level			
	➤ Discharge of pump	450 lpm	Provided	MR
	➤ Head of the pump	40Mtr	Provided	MR
	➤ Power supply	Required	Provided	MR
	➤ Auto starting of pump	Required	Provided	MR
14.	Captive water Storage for fire fighting:			
	• Under ground tank capacity	NA	NA	NA
	➤ Draw off connection	NA	NA	NA
	➤ Fire service inlet	NA	NA	NA
	➤ Access to tank	NA	NA	NA
	• Overhead Tank capacity	5,000Ltr	Provided	MR
15	Exit Signage	Required	Provided	MR
16.	Provision of Lifts			
	➤ Pressurization of Lift Shaft	NA	NA	NA
	➤ Pressurization of lift lobby	NA	NA	NA
	➤ Communication in lift Car	NA	NA	NA
	➤ Fireman's Grounding Switch	NA	NA	NA
	➤ Lift Signage	NA	NA	NA
17.	Standby power supply	NA	NA	NA
18.	Refuge Area			
	➤ Total area	NA	NA	NA
	➤ Location	NA	NA	NA
19.	Fire control room			
	➤ Detector system panel	NA	NA	NA
	➤ Flow Switch Panel	NA	NA	NA
	➤ PA System Panel	NA	NA	NA
	➤ Battery backup	NA	NA	NA
	➤ Building Floor Plans	NA	NA	NA

20.	Special Fire Protection Systems for Protection of special Risks, if any;	NA	NA	NA
-----	--	----	----	----


The fire protection systems provided in the building were test checked and found functional at the time of inspection.



In view of the deemed compliance of minimum standards on fire prevention and fire safety as required under the rules the NOC issued vide letter no. F-6/DFS/MS/School/2015/WZ/168 Dated 05/02/2015 renewal under rule 35 of the Delhi Fire Service Rules 2010 is recommended.

Signature of the Inspecting Officer


 Officer

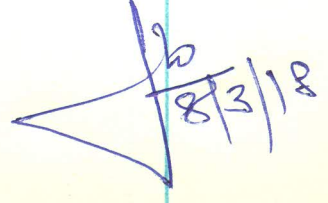
Name Uday Vir Singh
 Designation ADO/w p

Signature of the Inspecting

 Name
 Designation

DO/w  27/2/18
 27/2/18
~~DO/w~~
~~CFD work~~
~~FIPs~~
~~ADO/w p~~
 5/3/18

Sir FY letter is put up for sig. ple.

CFD  1/3/18

 8/3/18