

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEAD QUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE  
NEW DELHI-110001**

Fax No. 011-23412593, Ph. 011-23412225

No. F.6/DFS/MS/School/2018/SZ/ 628

Dated: 06/04/18

**FIRE SAFETY CERTIFICATE**

Certified that **Kautilya Govt. Sarvodaya Bal Vidyalaya** Chirag Enclave, Distt.-South East, New Delhi-110018, comprised of **Ground and one upper floor** Owned/Occupied by Directorate of Education was issued FSC by this department vide letter No. F.6/DFS/MS/SZ/School/2015/13 dated 02/01/2015. The premises was re-inspected by officer concern of this department on 20-03-2018 in presence of Dr. C.S. Verma (Principal) and found that the school building have deemed complied with the fire prevention and fire safety requirements in accordance with Directorate of Education Circular No. F.16//Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011 issued by Director of Education, Govt. of NCT of Delhi and that the building/premises is fit for occupancy class "**Educational**" (School), with effect from the date of issue of this certificate for a period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 06/04/18 at New Delhi by

  
(Vipin Kental)  
Chief Fire Officer

Copy to: -

1. The Principal, Kautilya Govt. Sarvodaya Bal Vidyalaya, Chirag Enclave, Distt.- South East, New Delhi-110018
2. The Director of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi.

**Conditions for the validity of Fire Safety Certificate**

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of firefighting system.
4. The owner/ occupier shall submit a declaration every year in Form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in)
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL-2016), if any.
6. "The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry."

7	<b>Automatic fire detection &amp; alarming system</b>			
	<ul style="list-style-type: none"> <li>Type of detectors</li> <li>Location of Main Panel</li> <li>Location of Repeater Panel</li> <li>Alternate source of power</li> <li>Hooter's location</li> </ul>	N/A	N/A	N/A
8.	<b>MOEFA</b>	N/A	N/A	N/A
9.	<b>Public Address System</b>	N/A	N/A	N/A
10.	<b>Automatic Sprinkler System</b>			
	<ul style="list-style-type: none"> <li>Basement</li> <li>Upper floors</li> <li>Sprinkler above false ceiling</li> </ul>	N/A	N/A	N/A
11.	<b>Internal Hydrants.</b>			
	<ul style="list-style-type: none"> <li>Size of Riser/Down-comer</li> <li>Number of Hydrant per floor</li> <li>Hose box.</li> </ul>	N/A	N/A	N/A
12.	<b>Yard Hydrants.</b>			
	<ul style="list-style-type: none"> <li>Total number of hydrants.</li> <li>Hose box.</li> </ul>	N/A	N/A	N/A
13.	<b>Pumping arrangements.</b>			
	<ul style="list-style-type: none"> <li><b>Ground Level</b></li> <li>➤ Discharge of main pump.</li> <li>➤ Head of main pump.</li> <li>➤ Number of main pumps.</li> <li>➤ Jockey Pump output.</li> <li>➤ Jockey Pump head.</li> <li>➤ Standby Pump output.</li> <li>➤ Standby pump head.</li> <li>➤ Auto Starting/Manual Stopping.</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li><b>Terrace Level</b></li> <li>➤ Discharge of pump.</li> <li>➤ Head of pump.</li> <li>➤ Power supply.</li> <li>➤ Auto starting of pump.</li> </ul>	N/A	N/A	N/A
14.	<b>Captive water storage for Fire Fighting.</b>			
	<ul style="list-style-type: none"> <li>Underground tank capacity. <ul style="list-style-type: none"> <li>➤ Draw-off connection.</li> <li>➤ Fire Service Inlet.</li> <li>➤ Access to tank.</li> </ul> </li> <li>Overhead tank capacity.</li> </ul>	N/A	N/A	N/A
15.	<b>Exit Signage.</b>	N/A	N/A	N/A
16.	<b>Provisions of Lifts.</b>			
	<ul style="list-style-type: none"> <li>Pressurization of lift shaft.</li> <li>Pressurization of lift lobby.</li> <li>Communication in lift car.</li> <li>Fireman's switch.</li> <li>Lift signage.</li> </ul>	N/A	N/A	N/A
17	<b>Standby Power Supply</b>	N/A	N/A	N/A
18.	<b>Refuge Area</b>			
	<ul style="list-style-type: none"> <li>Total area</li> <li>Location</li> </ul>	N/A	N/A	N/A
		N/A	N/A	N/A


N/

19.	<b>Fire Control Room.</b>			
	• Detector System Panel.	N/A	N/A	N/A
	• Flow Switch Panel.	N/A	N/A	N/A
	• PA system Panel.	N/A	N/A	N/A
	• Battery backup	N/A	N/A	N/A
	• Building floor plan	N/A	N/A	N/A
20.	<b>Special Fire Protection System for the Protection of special Risk, if any.</b>	N/A	N/A	N/A

The Fire protection systems provided in the building were test checked at random and found functional at the time of inspection.

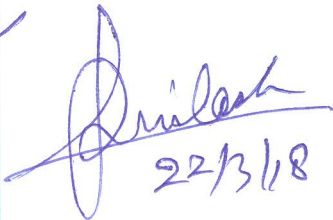
Keeping in view the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under DOE circular, FSC issued vide letter No. F.6/DFS/MS/SZ/School/2015/13 dated 02/01/2015, renewal under rule 37 of the Delhi Fire Service Rules, 2010 is recommended.

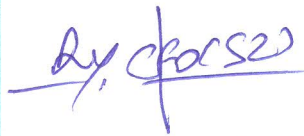
Accordingly, DFA is put up for approval and signature please.


  
 Signature of the Inspecting Officer  
 Name: R.N. Singh  
 Designation: ADO (BCP)

Kautilya Govt. Sarvodaya Bal Vidyalaya, Chirag Enclave, New Delhi-110018

DO (SD)

  
22/3/18




  
2/3

F T M

CFO s/sf M. scell

  
28/3.

F T letter is put up for sign. ple.   
31/3

CFO/s/sf M. scell,

1137/CBS  
28/2/18

