

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI-110001**

Fax No. 011-23412593, Ph. 011-23412225

No. F.6 DFS/MS/School/2018/SZ/ 742

Dated: 20/4/18

FIRE SAFETY CERTIFICATE

Certified that **Tagore International School** located at E-Block, East of Kailash, New Delhi-110065 comprised of Basement, Ground and three upper floors was issued FSC by this department vide letter No. F.6/MS/DFS/School/2014/SZ/1328 Dated 22/10/2014. The school premises was re-inspected by officer concerned of this department on 06/04/2018 in the presence of Sh. R.P. Singh (Asst. Admin Officer) and found that the school premises have deemed complied with the fire prevention and fire safety requirements in accordance with Directorate of Education circular No. 262-362 dated 17.01.2005 issued by Director of Education, Govt. of NCT of Delhi and that the building is fit for occupancy class "**Educational**" Group-B, as above with effect from the date of issue of this certificate for a period of **Three years** subject to compliance of the conditions mentioned below.

Issued on 20/4/18 at New Delhi by

Vk
20/4
(Vipin Kental)
Chief Fire Officer
OC

Copy to: -

1. Principal, Tagore International School, E-Block, East of Kailash, New Delhi-110065
2. Directorate of Education, South MCD, Civic Centre, Minto Road, New Delhi-110002

Conditions for the validity of Fire Safety Certificate

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of firefighting system.
4. The owner/ occupier shall submit a declaration every year in Form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in.
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL-2016), if any.
6. "The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry."


INSPECTION REPORT				
1	Name & Address of the Building	TAGORE INTERNATIONAL SCHOOL, E-Block, East of Kailash, New Delhi-110065		
2	Type of Occupancy	Educational 'Group-B' (School)		
3	Building Comprised of	Basement (02 Bks), Ground + 03 upper floors.		
4	Type of Case	Renewal		
5	Details of Previous NOC	F.6/DFS/MS/School/2014/SZ/1328 dated 22/10/2014		
6	Fire Safety Directives Letter No	DOE circular No 262-362 dated 17-01-2005		
7	Date of Inspection	06-04-2018		
8	Name of the Inspecting Officers	R.N. Singh, ADO (BCP)		
9	Name & Designation of Officers from the building side	Sh. RP Singh (Asst. Admin Officer)		
10	Year of construction	1986		
11	Applicant letter No.	Nil dated 15-03-2018		
S. No	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC requirement	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	• Road width	Required	12 mtr	MR
	• Gate width	Required	4.5 mtr	MR
	• Width of internal road	N/A	N/A	N/A
2	Number, width, type & arrangement of exits			
	a) Number of Staircase			
	➤ Upper floors	04 Nos	06 No's	MR
	➤ Basement floor	03 + 05 Nos	1 st Bt-03 Nos, 2 nd Bt-05 Nos	MR
	b) Width of Staircase			
	➤ Upper floors	1.5m	1.30, 1.05, 1.05, 1.10 & 1.45, 1.30m (Iron)	MR (old case)
	➤ Basement floor	1.5m	1st-1.5, 1.5 & 1.18m, 1 nd - 1.3, 1.7 & 1m x 3	MR (old case)
	c) Protection of exits			
	➤ Fire check door	N/A	N/A	N/A
	➤ Pressurization	N/A	N/A	N/A
	d) No. of continuous staircase to terrace	One	Provided	MR
	e) Width of corridor	N/A	N/A	N/A
	f) Door size	1m	Provided	MR
3	Compartmentation.			
	• Fire check door.	N/A	N/A	N/A
	• Sealing of electrical shafts.	N/A	N/A	N/A
	• Fire rating of shaft door.	N/A	N/A	N/A
	• Water curtain	N/A	N/A	N/A
	• Fire dampers.	NA	NA	NA
4.	Smoke Management system.			
	• Basement	30 ACPH	Exhaust fan provided	MR
	• Upper floors	12 ACPH	N/A	N/A
5.	Fire Extinguishers.			
	• Total numbers	Required	40 No's	MR
	• Types	ABC / Co2	ABC8 & W.Co2	MR
	• ISI Marking	ISI marked	Provided	MR
6.	First Aid Hose Reels.			
	• Total numbers on each floor.	04 Nos	Provided	MR
	• Length of hose-reel hose.	30 m	Provided	MR
	• Nozzle Diameter	5 mm	Provided	MR

7	Automatic fire detection & alarming system			
	• Type of detectors	N/A	N/A	N/A
	• Location of Main Panel	N/A	N/A	N/A
	• Location of Repeater Panel	N/A	N/A	N/A
	• Alternate source of power	N/A	N/A	N/A
	• Hooter's location	N/A	N/A	N/A
8.	MOEFA	N/A	N/A	N/A
9.	Public Address System	N/A	Provided	N/A
10.	Automatic Sprinkler System			
	• Basement	Required	Provided	MR
	• Upper floors	N/A	N/A	N/A
	• Sprinkler above false ceiling	N/A	N/A	N/A
11.	Internal Hydrants.			
	• Size of Riser/Down-comer	Required	100 mm	MR
	• Number of Hydrant per floor	Required	04 Nos	MR
	• Hose box.	Required	04 Nos	MR
12.	Yard Hydrants.			
	• Total number of hydrants.	N/A	N/A	N/A
	• Hose box.	N/A	N/A	N/A
13.	Pumping arrangements.			
	• Ground Level			
	➤ Discharge of main pump.	N/A	N/A	N/A
	➤ Head of main pump.	N/A	N/A	N/A
	➤ Number of main pumps.	N/A	N/A	N/A
	➤ Jockey Pump output.	N/A	N/A	N/A
	➤ Jockey Pump head.	N/A	N/A	N/A
	➤ Standby Pump output.	N/A	N/A	N/A
	➤ Standby pump head.	N/A	N/A	N/A
	➤ Auto Starting/Manual Stopping.	N/A	N/A	N/A
	• Terrace Level			
	➤ Discharge of pump.	450 LPM & 180 LPM (03 Nos each)	Provided	MR
	➤ Head of pump.	40 mtr each	Provided	MR
	➤ Power supply.	Required	Provided	MR
	➤ Auto starting of pump.	Required	Provided	MR
14.	Captive water storage for Fire Fighting.			
	• Underground tank capacity.	N/A	N/A	N/A
	➤ Draw-off connection.	N/A	N/A	N/A
	➤ Fire Service Inlet.	N/A	N/A	N/A
	➤ Access to tank.	N/A	N/A	N/A
	• Overhead tank capacity.	10,000 Ltr x 3 Nos	Provided	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provisions of Lifts.			
	• Pressurization of lift shaft.	N/A	N/A	N/A
	• Pressurization of lift lobby.	N/A	N/A	N/A
	• Communication in lift car.	N/A	N/A	N/A
	• Fireman's switch.	N/A	N/A	N/A
	• Lift signage.	N/A	N/A	N/A
17	Standby Power Supply	Required	Provided	MR
18.	Refuge Area			
	• Total area	N/A	N/A	N/A
	• Location	N/A	N/A	N/A

19.	Fire Control Room.	• Detector System Panel.	N/A	N/A	N/A
		• Flow Switch Panel.	N/A	N/A	N/A
		• PA system Panel.	N/A	N/A	N/A
		• Battery backup	N/A	N/A	N/A
		• Building floor plan	N/A	N/A	N/A
		20.	Special Fire Protection System for the Protection of special Risk, if any.	N/A	N/A

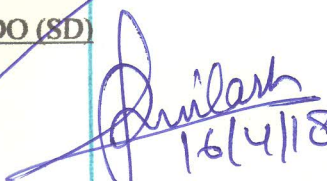
The Fire protection systems provided in the building were test checked at random and found functional at the time of inspection. Keeping in view the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under Directorate of Education circular, Fire Safety Certificate issued vide letter No. F.6/DFS/MS/School/2014/SZ/1328 dated 22/10/2014, renewal under rule 37 of the Delhi Fire Service rules, 2010 is recommended.


Accordingly, DFA is put up for approval and signature please.


 Signature of the Inspecting Officer
 Name: R.N. Singh
 Designation: ADO (BCP)

Tagore International School, E-Block, East of Kailash, New Delhi

DO (SD)


 16/4/18
 Dy. CP (SD)


 19/4



CFO SP M.scell FTM.

FT letter is put up for sign please
 19/4.
 20/4/18
 ADO (P/W)

CFO (SZ)
 M.scell
 20/4.

1253/CFO
 20/4.