

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE  
NEW DELHI- 110001**

Fax No. 011-23412593, Ph. 011-23412225

No. F.6/DFS/MS/Petrol/2018/SZ/ 778

Dated: 20/4/18

**FIRE SAFETY CERTIFICATE**

Certified that M/s **Kailash Service Station** (Retail outlet of I.O.C.L. Petroleum's class A & B) located at East of Kailash, Opp. Amar Colony Police Station, New Delhi-110065, comprised of Ground floor only was issued FSC by this department vide letter No. F.6/DFS/MS/2015/SZ/699 dated 08/05/2015. The premises was re-inspected by the officer concerned of this department on 06/04/2018 in the presence of Mr. Sandeep (Manager) and observed installed CNG dispensing units and that the said premises have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the premises is fit for occupancy class 'Mixed' (Petrol Pump, CNG and Service Station) as above with effect from date of issue of this certificate for a period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 20/4/18 at New Delhi by

  
(Vipin Kental)  
Chief Fire Officer

Copy to: -

1. M/s Kailash Service Station, East of Kailash, Opp. P.S. Amar Colony, N.Delhi-110065
2. The Addl. Comm. of Police (Lic.), 1<sup>st</sup> Floor, PS Defence Colony, New Delhi-110049

**Conditions for the validity of Fire Safety Certificate**

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of firefighting system.
4. The owner/ occupier shall submit a declaration every year in Form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in)
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL-2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry.

INSPECTION REPORT				
1	Name & Address of the Building	M/s Kailash Service Station, (Retail outlet of I.O.C.L Petroleum's Class A, B & CNG) at East of Kailash, Opp. Amar Colony Police Station, ND- 110065		
2	Type of Occupancy	Mixed Occupancy (Petrol Pump, CNG & Service Stn.)		
3	Building Comprised of	Ground floor only.		
4	Type of Case	Renewal		
5	Details of Previous NOC	F.6/DFS/MS/2015/SZ/699 dated 08-05-2015		
6	Fire Safety Directives Letter No	Nil		
7	Date of Inspection	06-04-2018		
8	Name of the Inspecting Officers	R.N. Singh, ADO (BCP)		
9	Name & Designation of Officers from the building side	Mr. Sandeep (Manager)		
10	Year of construction	1990		
11	Applicant letter No.	No. Nil dated 01-03-2018		
S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC requirement	Provided at Site	Remarks MR/NMR
1	<b>Access to Building.</b>			
	• Road width	9 mtr	12 mtr	MR
	• Gate width	N/A	N/A	N/A
	• Width of internal road	N/A	N/A	N/A
2	<b>Number, width, type &amp; arrangement of exits.</b>			
	<b>a. Number of Staircase</b>			
	➤ Upper floors.	N/A	N/A	N/A
	➤ Basement.	N/A	N/A	N/A
	<b>b. Width of Staircase</b>			
	➤ Upper floors	N/A	N/A	N/A
	➤ Basement	N/A	N/A	N/A
	<b>c. Protection of exits</b>			
	➤ Fire check door	N/A	N/A	N/A
	➤ Pressurization	N/A	N/A	N/A
	<b>d. No. of continuous staircase to terrace</b>	N/A	N/A	N/A
	<b>e. Width of corridor</b>	N/A	N/A	N/A
	<b>f. Door size</b>	1m	1m	MR
3	<b>Compartmentation.</b>			
	• Fire check door.	N/A	N/A	N/A
	• Sealing of electrical shafts.	N/A	N/A	N/A
	• Fire rating of shaft door.	N/A	N/A	N/A
	• Water curtain	N/A	N/A	N/A
	• Fire dampers.	N/A	N/A	N/A
4.	<b>Smoke Management system.</b>			
	• Basement	N/A	N/A	N/A
	• Upper floors	N/A	N/A	N/A
5.	<b>Fire Extinguishers.</b>			
	• Total numbers	15 No's	20 No's	MR
	• Types	ABC, CO2, DCP	CO2, DCP ABC, AFFF	MR
	• ISI Marking	ISI Marked	Provided	MR
6.	<b>First Aid Hose Reels.</b>			
	• Total numbers on each floor.	N/A	N/A	N/A
	• Length of hose-reel hose.	N/A	N/A	N/A
	• Nozzle Diameter	N/A	N/A	N/A


M/s Kailash Service Station, East of Kailash, Opp. Amar Colony Police Station, New Delhi

7	<b>Automatic fire detection &amp; alarming system.</b>			
	<ul style="list-style-type: none"> <li>Type of detectors</li> <li>Location of Main Panel</li> <li>Location of Repeater Panel</li> <li>Alternate source of power</li> <li>Hooter's location</li> </ul>	Gas & flame	Provided in compressor	MR
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		Required	Control room	MR
8.	<b>MOEFA</b>	N/A	N/A	N/A
9.	<b>Public Address System</b>	N/A	N/A	N/A
10.	<b>Automatic Sprinkler System</b>			
	<ul style="list-style-type: none"> <li>Basement</li> <li>Upper floors</li> <li>Sprinkler above false ceiling</li> </ul>	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
11.	<b>Internal Hydrants.</b>			
	<ul style="list-style-type: none"> <li>Size of Riser/Down-comer</li> <li>Number of Hydrant per floor</li> <li>Hose box.</li> </ul>	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
12.	<b>Yard Hydrants.</b>			
	<ul style="list-style-type: none"> <li>Total number of hydrants.</li> <li>Hose box.</li> </ul>	N/A	N/A	N/A
		N/A	N/A	N/A
13.	<b>Pumping arrangements.</b>			
	<ul style="list-style-type: none"> <li><b>Ground Level</b> <ul style="list-style-type: none"> <li>Discharge of main pump.</li> <li>Head of main pump.</li> <li>Number of main pumps.</li> <li>Jockey Pump output.</li> <li>Jockey Pump head.</li> <li>Standby Pump output.</li> <li>Standby Pump head.</li> <li>Auto Starting / Manual Stopping.</li> <li>Pump house access.</li> </ul> </li> <li><b>Terrace Level</b> <ul style="list-style-type: none"> <li>Discharge of pump.</li> <li>Head of pump.</li> <li>Power supply.</li> <li>Auto starting of pump.</li> </ul> </li> </ul>	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
14.	<b>Captive water storage for Fire Fighting.</b>			
	<ul style="list-style-type: none"> <li>Underground tank capacity. <ul style="list-style-type: none"> <li>Draw-off connection.</li> <li>Fire Service Inlet.</li> <li>Access to tank.</li> </ul> </li> <li>Overhead tank capacity.</li> </ul>	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
15.	<b>Exit Signage/ No Smoking Signage</b>	Required	Provided in Hindi & English	MR
16.	<b>Provision of Lifts.</b>			
	<ul style="list-style-type: none"> <li>Pressurization of lift shaft.</li> <li>Pressurization of lift lobby.</li> <li>Communication in lift car.</li> <li>Fireman's switch.</li> <li>Lift signage.</li> </ul>	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
17.	<b>Standby Power Supply</b>	Required	Provided (DG Set)	MR
18.	<b>Refuge Area</b>			
	<ul style="list-style-type: none"> <li>Total area</li> <li>Location</li> </ul>	N/A	N/A	N/A
		N/A	N/A	N/A

19.	<b>Fire Control Room.</b>			
	• Detector system panel.	N/A	N/A	N/A
	• Flow switch panel.	N/A	N/A	N/A
	• PA system panel.	N/A	N/A	N/A
	• Battery backup.	N/A	N/A	N/A
	• Building floor plan.	N/A	N/A	N/A
20.	<b>Special Fire Protection System for the Protection of special Risk, if any.</b>	N/A	N/A	N/A

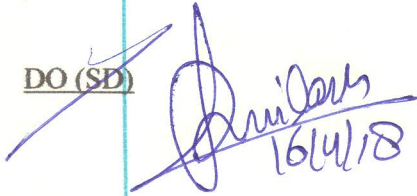
The fire protection systems provided in the retail outlet area were checked and found functional at the time of inspection. Keeping in view the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under the rules, the Fire Safety Certificate issued vide letter No. F.6/DFS/MS/2015/SZ/699 dated 08.05.2015, renewal under rule 37 of the Delhi Fire Service rules, 2010 is recommended.


Accordingly DFA is put up for approval and signature please.


  
 Signature of the Inspecting Officer  
 Name : R.N. Singh  
 Designation: ADO (BCP)

M/s Kailash Service Station, East of Kailash, Opp. Amar Colony Police Station, New Delhi

DO (SD)

  
16/4/18




  
18/4

CFOS/2/

m. sell

FTM.

  
18/4

FT letter is put up for signature.

CFOS/2/

m. sell

  
20/4

  
19/4

1244/CFOS2  
18/4/2018

