

any

FORM 'H'
FORM FOR ISSUING FIRE SAFETY CERTIFICATE
[Refer sub - rule (1) of rule 35]
GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE
NEW DELHI


No. F6/DFS/MS/EH/2018/ 855

Dated: 27/04/2018

FIRE SAFETY CERTIFICATE

Certified that the **Restaurant Castle 24** located at **TF – 01, City Square Mall, Plot No -7-8, Distt Center Shivaji Palace, Raja Garden, New Delhi – 110027.** was issued FSC vide Letter No. **F6/DFS/MS/EH/2015/271 dated 26-02-2015** and FSC to mall vide letter no. **F6/DFS/MS/2017/773 dated 30-05-2017.** The premises was re inspected by the officers concerned of this department on **10-04-2018** in the presence of **Mr. Prabhdeep Singh (Owner)** and found that the said building have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rule, 2010 and that the premises is fit for occupancy class "Assembly" Group D with effect from 27/04/2018 for a period of **three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 27/04/2018 at New Delhi by.


(Atul Garg)
Chief Fire Officer
Delhi Fire Service.

Copy to:

1. The Manager, Castle 24, TF – 01, City Square Mall, Plot No -7-8, Distt Center Shivaji Palace, Raja Garden, New Delhi – 27.
2. The Dy Health Officer, NDMC, West Zone, Rajori Garden, New Delhi 110027

Following fire safety directives must be adhered to:-

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
3. The trained staff should be available round the clock.
4. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
5. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
6. Basement shall be used as per building bye laws.
7. The owner/ occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry.
8. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.

INSPECTION REPORT

1. Name & address of the building: Restaurant Castle 24, TF – 01, City Square Mall, Plot No -7-8, Distt Center Shivaji Palace, Raja Garden, New Delhi – 27.
2. Type of Occupancy : Assembly
3. Type of Case : Renewal (Situated in Mall already issued NOC vide letter no. F6/DFS/MS/2017/773 dated 30-05-2017)
4. Details of previous NOC : Letter No. F6/DFS/MS/EH/2015/271 dated 26-02-15
5. Fire Safety directives Letter No. : FSC Issued to the mall
6. Date of inspection : 10-04-2018
7. Name of the Inspecting Officer : ADO (WP)
8. Name and designation of Officer
from the building side : Mr. Prabhdeep Singh (Owner)
9. Year of Construction : 2006
10. Applicant's letter No. : Nil Dated 26-02-2018

S No	Minimum standards on fire prevention and fire safety U/R 33	BBL Requirements	Provided at site	Remarks MR/NMR
1.	Access of building (Mall)			
	• Road width	30 m	Provided	MR
	• Gate width	6 m	Provided	MR
	• Width of internal road	6 m	Provided	MR
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	• Upper floors	6	Provided	MR
	• Basements	NA	NA	NA
	b. Width of staircases			
	• Upper floors	1.5 mtr & 1.25 mtr	117cm, 121cm, 126cm, 149cm, 123cm, 148cm	MR (Being old case)
	• Basements	NA	NA	NA
	c. Protection of exits			
	• Fire check door	NA	NA	NA
	• Pressurization	NA	NA	NA
	d. No of continuous staircase to terrace	NA	NA	NA
	e. Width Of Corridor	NA	NA	NA
	f. Door Size	Two Exit	2x111cm	MR(Old case)


3.	Compartmentation			
	• Fire check door	NA	NA	NA
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4.	Smoke managements System			
	• Basements	NA	NA	NA
	• Upper floors	12 a/c per hour	Provided	MR
5.	Fire Extinguishers			
	• Total numbers	04 nos.	05 Provided	MR
	• Types	DCP & CO ₂	Provided	MR
	• IS marking	ISI marked	Provided	MR
6.	First – Aid Hose Reels			
	• Total numbers on each floor	1	Provided	MR
	• Length of hose reel hose	30 m	Provided	MR
	• Nozzle diameter	5 mm	Provided	MR
7.	Automatic fire detection and alarming system			
	• Type of detectors	Smoke	Provided	MR
	• Location of Main Panel	Required	Provided	MR
	• Location of Repeater Panel	NA	NA	NA
	• Alternate source of power	Required	Provided	MR
	• Hooters' Location	Required	Provided	MR
8.	MOEFA	Required	Provided	MR
9.	Public Address System	NA	Provided	NA
10.	Automatic Sprinkler System			
	• Basements	NA	NA	NA
	• Upper Floor	Required	Provided	MR
	• Sprinkler above false ceiling	Required	Provided	MR
11.	Internal Hydrants: Common with the mall			
	• Size of riser/down-comer	150 mm	Provided	MR
	• Number of hydrants per floor	Required	Provided	MR
	• Hose Box	Required	Provided	MR
12.	Yard Hydrants			
	• Total number of hydrants	NA	NA	NA
	• Hose Box	NA	NA	NA

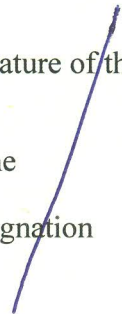
13.	Pumping Arrangements: Common with the mall			
	<ul style="list-style-type: none"> • Ground Level • Discharge of main pump ➤ Head of main pump ➤ Number of main pumps ➤ Jockey pump out put ➤ Jockey pump head ➤ Standby Pump out put ➤ Standby Pump Head ➤ Auto Staring/Manual stopping ➤ Pump House Access • Terrace level ➤ Discharge of pump 	NA	2850 lpm	NA
		NA	60 m	NA
		NA	1	NA
		NA	180 lpm	NA
		NA	60 m	NA
		NA	2850 lpm	NA
		NA	60 m	NA
		NA	Required	NA
		NA	Required	NA
		900 lpm	The capacities of Pumps provided at GF are at higher side	MR
	<ul style="list-style-type: none"> ➤ Head of the pump ➤ Power supply ➤ Auto starting of pump 	40 mDo.....	MR
		RequiredDo.....	MR
		RequiredDo.....	MR
14.	Captive water Storage for fire fighting: Common with the mall			
	<ul style="list-style-type: none"> • Under ground tank capacity ➤ Draw off connection ➤ Fire service inlet ➤ Access to tank • Overhead Tank capacity 	NA	1,00,000 litres	NA
		NA	Provided	NA
		Required	Provided	MR
		NA	Provided	NA
		10, 000 litres	30, 000 Litres Provided	MR
15	Exit Signage	Required	Provided	MR
16.	Provision of Lifts			
	<ul style="list-style-type: none"> ➤ Pressurization of Lift Shaft ➤ Pressurization of lift lobby ➤ Communication in lift Car ➤ Fireman's Grounding Switch ➤ Lift Signage 	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
17.	Standby power supply	Required	Provided	MR
18.	Refuge Area			
	<ul style="list-style-type: none"> ➤ Total area ➤ Location 	NA	NA	NA
		NA	NA	NA
19.	Fire control room			
	<ul style="list-style-type: none"> ➤ Detector system panel ➤ Flow Switch Panel ➤ PA System Panel ➤ Battery backup ➤ Building Floor Plans 	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA

20.	Special Fire Protection Systems for Protection of special Risks, if any;	NA	NA	NA
-----	--	----	----	----


The fire protection systems provided in the building were test checked and found functional at the time of inspection.

In view of the deemed compliance of minimum standards on fire prevention and fire safety as required under the rules the NOC issued vide letter no. F6/DFS/MS/EH/2015/271 dated 26-02-2015 renewal under rule 35 of the Delhi Fire Service Rules 2010 is recommended.

Signature of the Inspecting Officer 
 Name Uday Ver Singh
 Designation ADO/WP

Signature of the Inspecting Officer 
 Name
 Designation

~~D/O/W~~ ~~12/4~~
~~18/4/18~~
~~23/4/18~~
~~24/04/18~~
 C/O West
 Spoke
 DDW
 Leh Singh
 Durbet FI

Spoken, revised WPA is put up.

~~C/O/W~~
~~27/04/18~~