

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE  
NEW DELHI- 110001**

Fax No. 011-23412593, Ph. 011-23412225

No. F.6/DFS/MS/School/2018/SZ/ 920

Dated: 4.15.18

**FIRE SAFETY CERTIFICATE**

Certified that the Lord Krishna Public School, H-16/1203, Ratiya Marg, Sangam Vihar, New Delhi-110062 comprised of ground floor Owned/Occupied by School Management was granted Fire Safety Certificate by this department vide letter No. F6/DFS/MS/School/2015/SZ/616 Dated 27/04/2015. The premises was re-inspected by officer concerned of this department on 20.04.2018 in the presence of Mr. Jai Chandaran of the school and found that school building have deemed complied with the fire prevention and fire safety requirements in accordance with Directorate of Education circular No. F.16/Fire Safety/2011/13298 to 3398 dated 01.03.2011 issued by Director of Education and the premises/ building is fit for occupancy class "Educational Building Group-B" with effect from 4.15.2018 for a period of **Three years** subject to conditions as mentioned below.

Issued on 4.15.18 at New Delhi by

  
Vipin Kental  
Chief Fire Officer  
Ph.: 011-23412225

**Copy to: -**

1. The Lord Krishna Public School, H-161203, Ratiya Marg, Sangam Vihar, New Delhi-110062
2. The Director of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi.

**Conditions for the validity of Fire Safety Certificate**

1. All the fire safety and means of escape facilities shall be maintained in good working condition at all time. Any lapse rendering the fire safety or means of evacuation facilities non-functional shall be the responsibility of the management.
2. Building Sanctioning authority may verify any deviation with regard to construction/occupancy in the building. In case of any deviation, the fire safety certificate stands null & void.
3. The staff shall be trained for operating fire fighting system and mock evacuation drill be conducted at regular interval and record be maintained.
4. The basement shall be used strictly as per the provisions of Building Bye Laws.
5. The Owner/Occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules, 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in).
6. The Owner/Occupier shall apply for renewal of this Fire Safety Certificate to the Director in the form 'J' [sub rule (1) of rule 37] along with copy of this certificate, six months prior to its expiry. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in).

## INSPECTION REPORT

1	Name & Address of the Building	Lord Krishna Public School, H-161203, Ratiya Marg, Sangam Vihar, New Delhi-110062		
2	Type of Occupancy	Educational Building, Group-B		
3	Building Comprised of	Ground Floor Only		
4	Type of Case	Renewal		
5	Details of Previous NOC	F6/DFS/MS/School/2015/SZ/616 Dated 27/04/2015		
6	Fire Safety Directives Letter No	F.16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011		
7	Date of Inspection	20-04-2018		
8	Name of the Inspecting Officers	R.N. Singh, ADO (BCP)		
9	Name & Designation of Officers from the building side	Mr. jai Chandaran		
10	Year of construction	2008		
11	Applicant letter No.	LKPS/Admin/2017-18/01 Dated 03/04/2018		
<b>S. No</b>	<b>Minimum standards on Fire Prevention and Fire Safety U/R 33</b>	<b>As Per Old Noc</b>	<b>Provided at Site</b>	<b>Remarks MR/NMR</b>
1	<b>Access to Building.</b>			
	• Road width	6 mtr	6 mtr	MR
	• Gate width	4.5 mtr	Provided	MR
	• Width of internal road	-NA-	-NA-	-NA-
2	<b>Number, width, type &amp; arrangement of exits.</b>			
	<b>a) Number of Staircase</b>			
	➤ Upper floors.	-NA-	-NA-	-NA-
	➤ Basement floor.	-NA-	-NA-	-NA-
	<b>b) Width of Staircase</b>			
	➤ Upper floors	-NA-	-NA-	-NA-
	➤ Basement floor	-NA-	-NA-	-NA-
	<b>c) Protection of exits</b>			
	➤ Fire check door	-NA-	-NA-	-NA-
	➤ Pressurization	-NA-	-NA-	-NA-
	<b>d) No. of continuous staircase to terrace</b>	-NA-	-NA-	-NA-
	<b>e) Width of corridor</b>	1.5 m	Provided	MR
	<b>f) Door size</b>	1 mtr	Provided	MR
3	<b>Compartmentation.</b>			
	• Fire check door.	-NA-	-NA-	-NA-
	• Sealing of electrical shafts.	-NA-	-NA-	-NA-
	• Fire rating of shaft door.	-NA-	-NA-	-NA-
	• Water curtain	-NA-	-NA-	-NA-
	• Fire dampers.	-NA-	-NA-	-NA-
4.	<b>Smoke Management system.</b>			
	• Basement	30 ACPH	-NA-	-NA-
	• Upper floors	12 ACPH	-NA-	-NA-
5.	<b>Fire Extinguishers.</b>			
	• Total numbers	06 Nos	06 Nos	MR
	• Types	ABC & Co2	Provided	MR
	• ISI Marking	ISI marked	Provided	MR
6.	<b>First Aid Hose Reels.</b>			
	• Total numbers on each floor.	-NA-	-NA-	-NA-
	• Length of hose-reel hose.	-NA-	-NA-	-NA-
	• Nozzle Diameter	-NA-	-NA-	-NA-




7	<b>Automatic fire detection &amp; alarming system.</b>			
	• Type of detectors	-NA-	-NA-	-NA-
	• Location of Main Panel	-NA-	-NA-	-NA-
	• Location of Repeater Panel	-NA-	-NA-	-NA-
	• Alternate source of power	-NA-	-NA-	-NA-
	• Hooter's location	-NA-	-NA-	-NA-
8.	<b>MOEFA</b>	-NA-	-NA-	-NA-
9.	<b>Public Address System</b>			
10.	<b>Automatic Sprinkler System</b>			
	• Basement	-NA-	-NA-	-NA-
	• Upper floors	-NA-	-NA-	-NA-
	• Sprinkler above false ceiling	-NA-	-NA-	-NA-
11.	<b>Internal Hydrants.</b>			
	• Size of Riser/Down-comer	-NA-	-NA-	-NA-
	• Number of Hydrant per floor	-NA-	-NA-	-NA-
	• Hose box.	-NA-	-NA-	-NA-
12.	<b>Yard Hydrants.</b>			
	• Total number of hydrants.	-NA-	-NA-	-NA-
	• Hose box.	-NA-	-NA-	-NA-
13.	<b>Pumping arrangements.</b>			
	• <b>Ground Level</b>			
	➤ Discharge of main pump.	-NA-	-NA-	-NA-
	➤ Head of main pump.	-NA-	-NA-	-NA-
	➤ Number of main pumps.	-NA-	-NA-	-NA-
	➤ Jockey Pump output.	-NA-	-NA-	-NA-
	➤ Jockey Pump head.	-NA-	-NA-	-NA-
	➤ Standby Pump output.	-NA-	-NA-	-NA-
	➤ Standby Pump head.	-NA-	-NA-	-NA-
	➤ Auto Starting / Manual Stopping.	-NA-	-NA-	-NA-
	➤ Pump house access.	-NA-	-NA-	-NA-
	• <b>Terrace Level</b>			
	➤ Discharge of pump.	-NA-	-NA-	-NA-
	➤ Head of pump.	-NA-	-NA-	-NA-
	➤ Power supply.	-NA-	-NA-	-NA-
	➤ Auto starting of pump.	-NA-	-NA-	-NA-
14.	<b>Captive water storage for fire fighting.</b>			
	• Underground tank capacity.	-NA-	-NA-	-NA-
	➤ Draw-off connection.	-NA-	-NA-	-NA-
	➤ Fire Service Inlet.	-NA-	-NA-	-NA-
	➤ Access to tank.	-NA-	-NA-	-NA-
	• Overhead tank capacity.	-NA-	-NA-	-NA-
15.	<b>Exit Signage.</b>	Required	Provided	MR
16.	<b>Provision of Lifts.</b>			
	• Pressurization of lift shaft.	-NA-	-NA-	-NA-
	• Pressurization of lift lobby.	-NA-	-NA-	-NA-
	• Communication in lift car.	-NA-	-NA-	-NA-
	• Fireman's switch.	-NA-	-NA-	-NA-
	• Lift signage.	-NA-	-NA-	-NA-
17.	<b>Standby Power Supply</b>			
18.	<b>Refuge Area</b>			
	• Total area	-NA-	-NA-	-NA-
	• Location	-NA-	-NA-	-NA-
19.	<b>Fire Control Room.</b>			

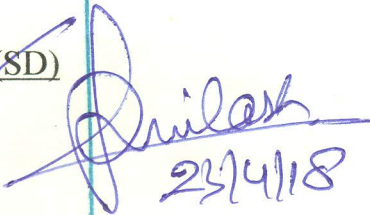
19.	<b>Fire Control Room.</b>			
	• Detector system panel.	-NA-	-NA-	-NA-
	• Flow switch panel.	-NA-	-NA-	-NA-
	• PA system panel.	-NA-	-NA-	-NA-
	• Battery backup.	-NA-	-NA-	-NA-
	• Building floor plan.	-NA-	-NA-	-NA-
20.	<b>Special Fire Protection System for the Protection of special Risk, if any.</b>	-NA-	-NA-	-NA-

The Fire Protection system provided in the school building were checked and found functional at the time of inspection.


In view of the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under the circular of Directorate of Education dated 01/03/2011, Fire Safety Certificate issued vide letter No. F6/DFS/MS/School/2015/SZ/616 Dated 27/04/2015 renewal under rule 37 of the Delhi Fire Service rules, 2010 is recommended

  
 Signature of the Inspecting Officer  
 Name : R.N. Singh  
 Designation: ADO (BCP)

DO (SD)

  
23/4/18







CFD 23/4 m-scell FT 26/4

1306/CFD S2  
27/4/18/115

F.T letter is put up for sign. jaha. fuzi  
27/4

m-scell 27/4