

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CANNAUGHT PLACE
NEW DELHI- 110 001

No. FG/DFS/MS/2018/ND2/947


Dated: 8/5/18

FIRE SAFETY CERTIFICATE

Certified that the **EDMC Primary School** at Mayur Vihar Pocket-IV, Phase-1, Delhi-91, comprised of ground plus one floor, owned/occupied by EDMC Primary School have complied with the fire prevention and fire safety requirements in accordance with the circular no. F.16/Estate/CC/FS/2011/3298 to 3398 dated 01/03/11 issued by the Director of Education and verified by the officer concerned of this department on 11/04/18 in the presence of **Mrs. Alka Duppad** (Principal) of the school and found that the building is fit for occupancy class B 'Educational Building' for with effect from 8/5/18 for a period of **three** years, in accordance with the rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010, subject to conditions printed overleaf.

Issued on 8/5/18 at New Delhi by


(Vipin Kental)
Chief Fire Officer



To,

The Principal,
EDMC Primary School,
Mayur Vihar Pocket-IV, Phase-1, Delhi-91

Copy to:-

The Director of Education,
Govt of NCT Delhi,
Old Secretariat Delhi-54.,

1. Name & address of the building : EDMC Primary School Mayur Vihar Pocket - IV, Phase-1, Delhi 91.
2. Building is comprised of : Ground plus one floor
3. Type of Occupancy : Educational
4. Type of Case : New case
5. Details of Previous NOC letter : Nil
6. Fire Safety direction letter No : F16/Estate/CC/FireSafety/2011/3298to3398
dt- 01/03/11
7. Date of Inspection : 11/04/18
8. Name of the Inspecting officers : ADO R.K. Yadav
9. Name and designation of Officer
from the building side : Smt.Alka Duppad (Principal)
10. Year of Construction : 2015-16
11. Applicant's letter No : Letter No.-Nil, Dated-22/03/18

Sr. No.	Minimum Standards on Fire Prevention and Fire Safety U/R33	Requirement <i>as per DOE Cl. 1.3.1)</i>	Provided at Site	Remarks MR/NMR
01	Access to Building			
	• Road width	06 mtr.	10 mtr.	MR
	• Gate width	4.5 mtr.	4.5 mtr.	MR
	• Width of internal road	N/A	N/A	N/A
02	Number, Width, Type and Arrangement of Exits			
	a. Number of Staircases			
	• Upper floor	02 no.	02 nos.	MR
	• Basement	N/A	N/A	N/A
	b. Width of Staircases			
	• Upper floor	1.50 mtr.	1.50 mtr.each	MR
	• Basement	N/A	N/A	N/A
	c. Protection of Exits			
	• Fire check door	N/A	N/A	N/A
	• Pressurization	N/A	N/A	N/A
	d. No. of Continuous Staircases to Terrace	01 no.	01 no.	MR
	e. Width of Corridor	1.50 mtr.	1.50 mtr.	MR
	f. Door Size	01 mtr.	01 mtr.	MR
03	Compartmentation.			
	• Fire check door	N/A	N/A	N/A
	• Sealing of electrical shafts	N/A	N/A	N/A
	• Fire rating of shaft door	N/A	N/A	N/A
	• Water curtain	N/A	N/A	N/A
	• Fire dampers	N/A	N/A	N/A
04	Smoke Management System.			
	• Basement	N/A	N/A	N/A
	• Upper floor	N/A	N/A	N/A
05.	Fire Extinguishers			
	• Total numbers	08 nos.	08 nos.	MR
	• types	ABC /CO ₂	ABC /CO ₂	MR
	• IS marking	ISI marked	ISI marked	MR

06	First-Aid-Hose Reels.			
	Total numbers on each floor	N/A	N/A	N/A
	• Length of hose reel hose	N/A	N/A	N/A
	• Nozzle diameter	N/A	N/A	N/A
07	Automatic Fire Detection and Alarming System.			
	• Type of detectors	N/A	N/A	N/A
	• Location of main panel	N/A	N/A	N/A
	• Location of repeater panel	N/A	N/A	N/A
	• Alternate source of power	N/A	N/A	N/A
	• Hooter's location	N/A	N/A	N/A
08	MOEFA	N/A	Siron	MR
09	Public Address System.	N/A	N/A	N/A
10	Automatic Sprinkler System.			
	• Basement	N/A	N/A	N/A
	• upper floor	N/A	N/A	N/A
	• sprinkler above false ceiling	N/A	N/A	N/A
11	Internal Hydrants			
	• size of riser/down-comer	N/A	N/A	N/A
	• Number of hydrants per floor	N/A	N/A	N/A
	• Hose Box	N/A	N/A	N/A
12	Yard Hydrants.			
	• Total number of hydrants	N/A	N/A	N/A
	• Hose Box	N/A	N/A	N/A
13	Pumping Arrangements.			
	➤ Ground Level			
	• Discharge of main Pump	N/A	N/A	N/A
	• Head of Main Pump	N/A	N/A	N/A
	• Number of main pumps	N/A	N/A	N/A
	• Jockey pump out put	N/A	N/A	N/A
	• Jockey pump head	N/A	N/A	N/A
	• Standby pump out put	N/A	N/A	N/A
	• Standby pump Head	N/A	N/A	N/A
	• Auto Starting /Manual stopping	N/A	N/A	N/A
	• Pump House Access	N/A	N/A	N/A
	➤ Terrace Level			
	• Discharge of pump	N/A	N/A	N/A
	• Head of the Pump	N/A	N/A	N/A
	• Power supply	N/A	N/A	N/A
	• Auto Starting of pump	N/A	N/A	N/A
14	Captive Water Storage for Fire Fighting.			
	• Underground tank capacity	N/A	N/A	N/A
	• Draw-off connection	N/A	N/A	N/A
	• Fire service inlet	N/A	N/A	N/A
	• Access to tank	N/A	N/A	N/A
	• Overhead Tank capacity	N/A	N/A	N/A
15	Exit Signage.	N/A	N/A	N/A


18

1a

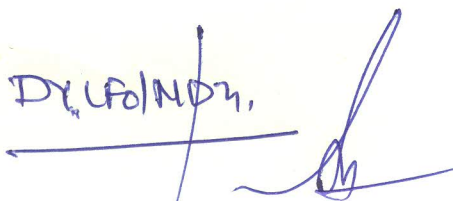
16	Provision of Lifts.			
	<ul style="list-style-type: none"> • Pressurization of Lift Shaft • Pressurization of Lift lobby • Communication in lift car • Firemen's grounding switch • Lift Signage 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
17	Standby power supply	N/A	N/A	N/A
18	Refuge Area.			
	<ul style="list-style-type: none"> • Total area • Location 	N/A	N/A	N/A
		N/A	N/A	N/A
19	Fire Control Room			
	<ul style="list-style-type: none"> • Detector system panel • Flow switch panel • PA system panel • Battery backup • Building Floor Plans 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
20	Special Fire Protection systems for protection of special Risks, if any:	N/A	N/A	N/A


The fire protection systems provided in the building were tested/checked at the time of inspection.

Keeping in view the compliance of the minimum standards on fire prevention and fire safety required under the circular no. F16/Estate/CC/FireSafety/2011/3298 to 3398 dated 01/03/11, it is recommended to grant Fire Safety Certificate.


 Signature of the Inspecting Officer 12/4/18
 Name: R. K. Yadav
 Designation: ADO(LN)


~~DO(ED)~~ Submitted for approvals plus 1


 D. L. G. / N. D. N. FTM


12/4/18


 C. F. Q. M.Scell 18/4

588/CFQ/NM
4/5


 R. K. Yadav
 1/5/2018


 M.Scell 18/4