

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE  
NEW DELHI-110001

No. F.6/DFS/MS/Petrol/2018/SZ/ 1525

Dated: 2/7/18

FIRE SAFETY CERTIFICATE

Certified that M/s **Auto Centre** (Retail outlet of BPCL Petroleum class A & B) located between D-17 & D-18, Defence Colony, New Delhi-110024, comprised of ground floor only was issued FSC by this department vide letter No. F.6/DFS/MS/2015/SZ/920 dated 04/06/2015. The premises was re-inspected by officer concerned of this department on 13/06/2018 in the presence of Sh. Hansa Sharma (Manager) and found that the said premises have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of Delhi Fire Service Rules, 2010 and that premises is fit for occupancy class "**Group 'J' Hazardous**, as above with effect from 2/7/2018 for period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued 2/7/18 at New Delhi by

  
27/6  
(Vipin Kental)  
Chief Fire Officer  
Tel: 011-23412225

Copy to: -

1. Territory Manager (Retail), B.P.C.L. Bijwasan Installation, Bijwasan, New Delhi-110061
2. Manager, M/s Auto Centre between D-17 & 18, Defence Colony, New Delhi -110024

Conditions for the validity of Fire Safety Certificate:

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire fighting system.
4. The owner/occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in)
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL- 2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry.

## INSPECTION REPORT

1	Name & Address of the Building	M/s Auto Centre (Retail outlet of Petroleum Class A&B belonging to B.P.C.L.) between D-17 & 18, Defence Colony, New Delhi-110024		
2	Type of Occupancy	Mixed Occupancy (Petrol Pump & Service Station)		
3	Building Comprised of	Ground floor only.		
4	Type of Case	Renewal		
5	Details of Previous NOC	F6/DFS/MS/2015/SZ/920 Dated 04/06/2015		
6	Fire Safety Directives Letter No	F5/(3A)/DFS/BP/2005/77 dated 01.03.2005 and F5/(3A)/BP/DFS/2006/113 dated 10.03.2006		
7	Date of Inspection	13-06-2018		
8	Name of the Inspecting Officers	Mehmood (ADO/SJ)		
9	Name & Designation of Officers from the building side	Sh. Hansa Sharma (Manager)		
10	Year of construction	2006		
11	Applicant letter No.	Outdoor Diary No. 7688 dated 22-05-2018		
<b>S. No.</b>	<b>Minimum standards on Fire Prevention and Fire Safety U/R 33</b>	<b>Old NOC requirements</b>	<b>Provided at Site</b>	<b>Remarks MR/NMR</b>
<b>1</b>	<b>Access to Building.</b>			
	• Road width	Required	12 mtr	MR
	• Gate width	N/A	N/A	N/A
	• Width of internal road	N/A	N/A	N/A
<b>2</b>	<b>Number, width, type &amp; arrangement of exits.</b>			
	<b>a. Number of Staircase</b>			
	➤ Upper floors.	01 No	Provided	MR
	➤ Basement.	N/A	N/A	N/A
	<b>b. Width of Staircase</b>			
	➤ Upper floors	90 cm	Provided	MR
	➤ Basement	N/A	N/A	N/A
	<b>c. Protection of exits</b>			
	➤ Fire check door	N/A	N/A	N/A
	➤ Pressurization	N/A	N/A	N/A
	<b>d. No. of continuous staircase to terrace</b>	N/A	N/A	N/A
	<b>e. Width of corridor</b>	N/A	N/A	N/A
	<b>f. Door size</b>	1m	Provided	MR
<b>3</b>	<b>Compartmentation.</b>			
	• Fire check door.	N/A	N/A	N/A
	• Sealing of electrical shafts.	N/A	N/A	N/A
	• Fire rating of shaft door.	N/A	N/A	N/A
	• Water curtain	N/A	N/A	N/A
	• Fire dampers.	N/A	N/A	N/A
<b>4.</b>	<b>Smoke Management system.</b>			
	• Basement	N/A	N/A	N/A
	• Upper floors	N/A	N/A	N/A
<b>5.</b>	<b>Fire Extinguishers.</b>			
	• Total numbers	Required	10 Nos + 06 fire buckets	MR
	• Types	CO2, ABC, DCP	CO2, DCP, ABC & AFFF	MR
	• ISI Marking	ISI marked	Provided	MR
<b>6.</b>	<b>First Aid Hose Reels.</b>			
	• Total numbers on each floor.	N/A	N/A	N/A
	• Length of hose-reel hose.	N/A	N/A	N/A
	• Nozzle Diameter	N/A	N/A	N/A




7	<b>Automatic fire detection &amp; alarming system.</b>			
	<ul style="list-style-type: none"> <li>Type of detectors</li> <li>Location of Main Panel</li> <li>Location of Repeater Panel</li> <li>Alternate source of power</li> <li>Hooter's location</li> </ul>	N/A	N/A	N/A
8.	<b>MOEFA</b>	N/A	N/A	N/A
9.	<b>Public Address System</b>	N/A	N/A	N/A
10.	<b>Automatic Sprinkler System</b>			
	<ul style="list-style-type: none"> <li>Basement</li> <li>Upper floors</li> <li>Sprinkler above false ceiling</li> </ul>	N/A	N/A	N/A
11.	<b>Internal Hydrants.</b>			
	<ul style="list-style-type: none"> <li>Size of Riser/Down-comer</li> <li>Number of Hydrant per floor</li> <li>Hose box.</li> </ul>	N/A	N/A	N/A
12.	<b>Yard Hydrants.</b>			
	<ul style="list-style-type: none"> <li>Total number of hydrants.</li> <li>Hose box.</li> </ul>	N/A	N/A	N/A
13.	<b>Pumping arrangements.</b>			
	<ul style="list-style-type: none"> <li><b>Ground Level</b> <ul style="list-style-type: none"> <li>Discharge of main pump.</li> <li>Head of main pump.</li> <li>Number of main pumps.</li> <li>Jockey Pump output.</li> <li>Jockey Pump head.</li> <li>Standby Pump output.</li> <li>Standby Pump head.</li> <li>Auto Starting / Manual Stopping.</li> <li>Pump house access.</li> </ul> </li> <li><b>Terrace Level</b> <ul style="list-style-type: none"> <li>Discharge of pump.</li> <li>Head of pump.</li> <li>Power supply.</li> <li>Auto starting of pump.</li> </ul> </li> </ul>	N/A	N/A	N/A
14.	<b>Captive water storage for Fire Fighting.</b>			
	<ul style="list-style-type: none"> <li>Underground tank capacity.</li> <li>Draw-off connection.</li> <li>Fire Service Inlet.</li> <li>Access to tank.</li> <li>Overhead tank capacity.</li> </ul>	N/A	N/A	N/A
15.	<b>'No Smoking' Signage.</b>	Required	Displayed in Hindi & English	MR
16.	<b>Provision of Lifts.</b>			
	<ul style="list-style-type: none"> <li>Pressurization of lift shaft.</li> <li>Pressurization of lift lobby.</li> <li>Communication in lift car.</li> <li>Fireman's switch.</li> <li>Lift signage.</li> </ul>	N/A	N/A	N/A
17.	<b>Standby Power Supply</b>	N/A	Provided (DG Set)	N/A
18.	<b>Refuge Area</b>			
	<ul style="list-style-type: none"> <li>Total area</li> <li>Location</li> </ul>	N/A	N/A	N/A

19.	<b>Fire Control Room.</b>			
	• Detector system panel.	N/A	N/A	N/A
	• Flow switch panel.	N/A	N/A	N/A
	• PA system panel.	N/A	N/A	N/A
	• Battery backup.	N/A	N/A	N/A
	• Building floor plan.	N/A	N/A	N/A
20.	<b>Special Fire Protection System for the Protection of special Risk, if any.</b>	N/A	N/A	N/A

The fire protection system provided at suitable places in the retail outlet area were checked/operated at random and found functional at the time of inspection. "No Smoking" sign boards were found displayed both in Hindi & English at conspicuous places. No loose electrical wiring seen in the premises at the time of inspection.

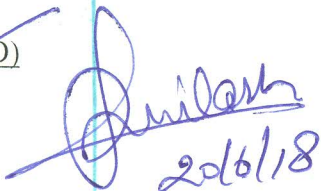
Keeping in view of the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under the rules, the Fire Safety Certificate issued vide letter No. F6/DFS/MS/2015/SZ/920 dated 04/06/2015, renewal under rule 37 of the Delhi Fire Service Rules, 2010 is recommended.


Accordingly DFA is put up for approval and signature please.


  
 Signature of the Inspecting Officer  
 Name: Mehmood  
 Design: ADO (SJ)

M/s Auto Centre located between D-17 & 18, Defence Colony, New Delhi-110024

DO (SD)

  
20/6/18

  
20/6/18

  
21/6

CAO (S/P)

M.Scell


FT/ST.

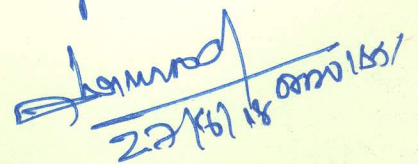
  
22/6

A.P.T. letter sent us for signature leave

CAO CS2P

M.Scell

  
27/6

  
22/6/18



1565/CAO S/P  
28/6