

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI-110001

No. F.6/DFS/MS/EH/2018/SZ/ 1469

Dated: 22/6/18

FIRE SAFETY CERTIFICATE

Certified that **Barbeque Nation Restaurant** (A Unit of Barbeque Nation Hospitality Ltd) located at Shop No-4 & 5, Eros Cinema Building, Jangpura Extn, New Delhi-110014 comprised of two tiers basement, Ground plus two upper floors. The restaurant running at ground floor was issued Fire Safety Certificate by this department vide letter No. F6/DFS/MS/EH/2015/SZ/1000 dated 12/06/2015. The premises was re-inspected by officer concerned of this department on 07/06/2018 in the presence of Mr. Manoj Sharma (Manager) of the restaurant and found that the said premises have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of Delhi Fire Service Rules, 2010 and that building is fit for occupancy class "**Assembly, Group-A**" (Eating House) as above with effect from the date of issue of this certificate for period of **Three years** in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued 22/6/18 at New Delhi by


(Vipin Kental)
Chief Fire Officer
Tel. 011-23412225


Copy to: -

1. M/s Barbeque Nation Restt., Shop No- 4 & 5, Eros Cinema Bldg, Jangpura Extn, N. D.-14
2. The Addl. Comm. of Police (Lic.), First Floor, P.S. Defense Colony, New Delhi-110049

Conditions for the validity of Fire Safety Certificate:

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire fighting system.
4. The owner/occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL- 2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry.
7. This FSC shall become null & void if, FSC of main building is not renewed under rule 37 of DFS Rules, 2010

INSPECTION REPORT

1	Name & Address of the Building	M/s Barbeque Nation Restt at Shop No-4 & 5, GF, Eros Cinema Building Jangpura Extn, New Delhi-14		
2	Type of Occupancy	Assembly, "Group-D" (Eating House)		
3	Building Comprised of	02 Basements, Ground + 02 upper floors.		
4	Type of Case	Renewal		
5	Details of Previous NOC	F.6/DFS/MS/EH/2015/SZ/1000 Dated 12-06-2015		
6	Fire Safety Directives Letter No	Nil		
7	Date of Inspection	07-06-2018		
8	Name of the Inspecting Officers	Mehmood, ADO (SJ)		
9	Name & Designation of Officers from the building side	Mr. Manoj Sharma (Restt. Manager)		
10	Year of construction	2011	Restt running at ground floor of the building.	
11	Applicant letter No.	NIL dated 09-04-2018		
S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC requirements	Provided at Site	Remarks MR/NMR
1	Access to Building.	F6/DFS/MS/Mixed/2017/SZ/1388 dated 19-09-2017		
	• Road width	Restt located in Eros Cinema Building	As above	MR
	• Gate width		As above	-NA-
	• Width of internal road		As above	-NA-
2	Number, width, type & arrangement of exits.			
	a) Number of Staircase	Provided & Maintained By Building Management		
	➤ Upper floors.	-NA-	Restt. at GF	-NA-
	➤ Basement floor.	-NA-	-NA-	-NA-
	b) Width of Staircase	Provided & Maintained By Building Management		
	➤ Upper floors	-NA-	-NA-	-NA-
	➤ Basement floor	-NA-	-NA-	-NA-
	c) Protection of exits	Provided & Maintained By Building Management		
	➤ Fire check door	-NA-	As above	-NA-
	➤ Pressurization	-NA-	As above	-NA-
	d) No. of continuous staircase to terrace	-NA-	As above	-NA-
	e) Width of corridor	-NA-	As above	-NA-
	f) Door size	2.0 mtr	2m, 1.32m & 1.15m	MR
3	Compartmentation.	Provided & Maintained By Building Management		
	• Fire check door.	-NA-	As above	-NA-
	• Sealing of electrical shafts.	-NA-	As above	-NA-
	• Fire rating of shaft door.	-NA-	As above	-NA-
	• Water curtain	-NA-	As above	-NA-
	• Fire dampers.	-NA-	As above	-NA-
4.	Smoke Management system.	Provided & Maintained By Building Management		
	• Basement	30 ACPH	As above	-NA-
	• Upper floors	12 ACPH	Provided in kitchen	MR
5.	Fire Extinguishers.			
	• Total numbers	Required	10 Nos	MR
	• Types	ABC / CO2	ABC & CO2	MR
	• ISI Marking	ISI marked	Provided	MR
6.	First Aid Hose Reels.	Provided & Maintained By Building Management		
	• Total numbers on each floor.	One	Provided near Restt	MR
	• Length of hose-reel hose.	30 mtr	Provided	MR
	• Nozzle Diameter	5 mm	Provided	MR

M/s Barbeque Nation Restt, Eros Cinema Bldg, Shop No-4 & 5, GF, Jangpura Extn, New Delhi

7	Automatic fire detection & alarming system.	Provided & Maintained By Building Management		
	• Type of detectors	Required	Heat & Smoke	MR
	• Location of Main Panel	Required	Ground floor	MR
	• Location of Repeater Panel	-NA-	-NA-	-NA-
	• Alternate source of power	Required	Provided	MR
	• Hooter's location	Required	Provided	MR
8.	MOEFA	Required	Provided	MR
9.	Public Address System	-NA-	-NA-	-NA-
10.	Automatic Sprinkler System	Provided & Maintained By Building Management		
	• Basement	-NA-	As above	-NA-
	• Upper floors / Restt premises	Required	As above	MR
	• Sprinkler above false ceiling	-NA-	As above	-NA-
11.	Internal Hydrants.	Provided & Maintained By Building Management		
	• Size of Riser/Down-comer	-NA-	As above	-NA-
	• Number of Hydrant per floor	-NA-	As above	-NA-
	• Hose box.	-NA-	As above	-NA-
12.	Yard Hydrants.	Provided & Maintained By Building Management		
	• Total number of hydrants.	-NA-	As above	-NA-
	• Hose box.	-NA-	As above	-NA-
13.	Pumping arrangements.			
	• Ground Level	Provided & Maintained By Building Management		
	➤ Discharge of main pump.	-NA-	2850 LPM	-NA-
	➤ Head of main pump.	-NA-	60m	-NA-
	➤ Number of main pumps.	-NA-	Two	-NA-
	➤ Jockey Pump output.	-NA-	180 LPM	-NA-
	➤ Jockey Pump head.	-NA-	60m	-NA-
	➤ Standby Pump output.	-NA-	2850 LPM	-NA-
	➤ Standby Pump head.	-NA-	60m	-NA-
	➤ Auto Starting / Manual Stopping.	-NA-	Provided	-NA-
	➤ Pump house access.	-NA-	Provided	-NA-
	• Terrace Level	Provided & Maintained By Building Management		
	➤ Discharge of pump.	Required	950 LPM	MR
	➤ Head of pump.	Required	45m	MR
	➤ Power supply.	Required	Provided	MR
	➤ Auto starting of pump.	Required	Provided	MR
14.	Captive water storage for fire fighting.	Provided & Maintained By Building Management		
	• Underground tank capacity.	-NA-	2,00,000 Ltr.	-NA-
	➤ Draw-off connection.	-NA-	Provided	-NA-
	➤ Fire Service Inlet.	-NA-	Provided	-NA-
	➤ Access to tank.	-NA-	Provided	-NA-
	• Overhead tank capacity.	Required	30,000 Ltr	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			
	• Pressurization of lift shaft.	-NA-	-NA-	-NA-
	• Pressurization of lift lobby.	-NA-	-NA-	-NA-
	• Communication in lift car.	-NA-	-NA-	-NA-
	• Fireman's switch.	-NA-	-NA-	-NA-
	• Lift signage.	-NA-	-NA-	-NA-
17.	Standby Power Supply	Required	Provided	MR
18.	Refuge Area			
	• Total area	-NA-	-NA-	-NA-
	• Location	-NA-	-NA-	-NA-


M/s Barbeque Nation Restt, Eros Cinema Bldg, Shop No-4 & 5, GF, Jangpura Extn, New Delhi

N/

19.	Fire Control Room.	Provided & Maintained By Building Management		
	• Detector system panel.	-NA-	As above	-NA-
	• Flow switch panel.	-NA-	As above	-NA-
	• PA system panel.	-NA-	As above	-NA-
	• Battery backup.	-NA-	As above	-NA-
	• Building floor plan.	-NA-	As above	-NA-
20.	Special Fire Protection System for the Protection of special Risk, if any.	-NA-	As above	-NA-

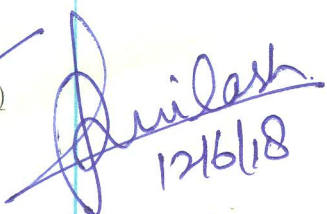
The fire protection system provided in the building/ premises were tested, checked at random and found functional at the time of inspection. Keeping in view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules, the FSC issued vide letter No. F6/MS/DPS/EH/2015SZ/1000 dated 12/06/2015, renewal under rule 37 of the Delhi Fire Service Rules 2010, is recommended.

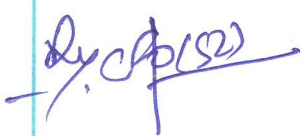
Accordingly DFA is put up for approval and signature please.



 Signature of the Inspecting Officer
 Name: Mehmoed
 Design: ADO (SJ)

M/s Barbeque Nation Restt, Eros Cinema Bldg, Shop No-4 & 5, GF, Jangpura Extn, New Delhi

DO (SD)


12/6/18




13/6

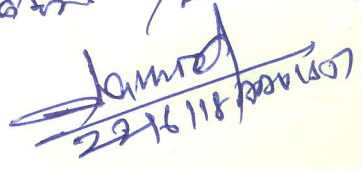
CP S/S

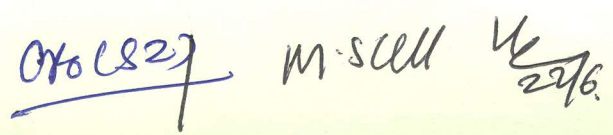
M-SCell

FTM.

13/6

A. G. of. letter for up for signature please


22/6/18


M-SCell 13/6



1544/CP/S2
22-6-18