

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI- 110001

No. F6/DFS/MS/^{Petrol}Petrol/2018/SZ/ 1459

Dated: 21/06/18

FIRE SAFETY CERTIFICATE

Certified that M/s **Capital Oil Agency** (Retail outlet of IOCL Petroleum Class- A & B) located at Ring Road, Sarojini Nagar, New Delhi-110023, comprised of Ground floor only was issued FSC by this department vide letter No. F.6/DFS/MS/2015/SZ/1314 dated 22/07/2015. The premise was re-inspected by the officer concerned of this department on 29/05/2018 in the presence of Sh. JS Khanna (Manager) of the filling station and found that the said premises have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the premises is fit for occupancy class "**Storage**" (Petrol Pump), as above with effect from 21/6/2018 for a period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010

Issued on 21/6/18 at New Delhi by


(Vipin Kental)
Chief Fire Officer
Tel: 011-23412225

Copy to: -

1. The Medical Health Officer, New Delhi Municipal Corporation, Palika Kendra, New Delhi
2. M/s Capital Oil Agency (IOCL retail outlet) at Ring Road, Sarojini Nagar, New Delhi-23

Conditions for the validity of Fire Safety Certificate: -

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire fighting system.
4. The owner/occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules-2010. The form is available on www.dfs.delhigovt.nic.in
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL-2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry.

INSPECTION REPORT

S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC requirements	Provided at Site	Remarks MR/NMR
1	Name & Address of the Building	M/s Capital Oil Agency (Retail outlet of I.O.C.L. Petroleum Class A & B) at Ring Road, Sarojini Nagar, New Delhi-110023		
2	Type of Occupancy	Storage Building (Petrol Pump)		
3	Building Comprised of	Ground floor only.		
4	Type of Case	Renewal		
5	Details of Previous NOC	F6/DFS/MS/2015/SZ/1314 Dated 22/07/2015		
6	Fire Safety Directives Letter No	Nil		
7	Date of Inspection	29-05-2018		
8	Name of the Inspecting Officers	ADO Mehmood (ADO/SJ)		
9	Name & Designation of Officers from the building side	Sh. JS Khanna (Manager)		
10	Year of construction	1995		
11	Applicant letter No.	Outdoor Diary No. 6437 dated 23-04-2018		
1	Access to Building.			
	• Road width	Required	30 mtr	MR
	• Gate width	N/A	N/A	N/A
	• Width of internal road	N/A	N/A	N/A
2	Number, width, type & arrangement of exits.			
	a. Number of Staircase			
	➤ Upper floors.	N/A	N/A	N/A
	➤ Basement.	N/A	N/A	N/A
	b. Width of Staircase			
	➤ Upper floors	N/A	N/A	N/A
	➤ Basement	N/A	N/A	N/A
	c. Protection of exits			
	➤ Fire check door	N/A	N/A	N/A
	➤ Pressurization	N/A	N/A	N/A
	d. No. of continuous staircase to terrace	N/A	N/A	N/A
	e. Width of corridor	N/A	N/A	N/A
	f. Door size	1m	Provided	MR
3	Compartmentation.			
	• Fire check door.	N/A	N/A	N/A
	• Sealing of electrical shafts.	N/A	N/A	N/A
	• Fire rating of shaft door.	N/A	N/A	N/A
	• Water curtain	N/A	N/A	N/A
	• Fire dampers.	N/A	N/A	N/A
4.	Smoke Management system.			
	• Basement	N/A	N/A	N/A
	• Upper floors	N/A	N/A	N/A
5.	Fire Extinguishers.			
	• Total numbers	10 Nos	12 Nos	MR
	• Types	CO2, ABC, DCP	CO2, DCP, ABC & AFFF	MR
	• ISI Marking	ISI marked	Provided	MR
6.	First Aid Hose Reels.			
	• Total numbers on each floor.	N/A	N/A	N/A
	• Length of hose-reel hose.	N/A	N/A	N/A
	• Nozzle Diameter	N/A	N/A	N/A

M/s Capital Oil Agency at Ring Road, Sarojini Nagar, New Delhi-110023

7	Automatic fire detection & alarming system.			
	• Type of detectors	N/A	N/A	N/A
	• Location of Main Panel	N/A	N/A	N/A
	• Location of Repeater Panel	N/A	N/A	N/A
	• Alternate source of power	N/A	N/A	N/A
	• Hooter's location	N/A	N/A	N/A
8.	MOEFA	N/A	N/A	N/A
9.	Public Address System	N/A	N/A	N/A
10.	Automatic Sprinkler System			
	• Basement	N/A	N/A	N/A
	• Upper floors	N/A	N/A	N/A
	• Sprinkler above false ceiling	N/A	N/A	N/A
11.	Internal Hydrants.			
	• Size of Riser/Down-comer	N/A	N/A	N/A
	• Number of Hydrant per floor	N/A	N/A	N/A
	• Hose box.	N/A	N/A	N/A
12.	Yard Hydrants.			
	• Total number of hydrants.	N/A	N/A	N/A
	• Hose box.	N/A	N/A	N/A
13.	Pumping arrangements.			
	• Ground Level			
	➤ Discharge of main pump.	N/A	N/A	N/A
	➤ Head of main pump.	N/A	N/A	N/A
	➤ Number of main pumps.	N/A	N/A	N/A
	➤ Jockey Pump output.	N/A	N/A	N/A
	➤ Jockey Pump head.	N/A	N/A	N/A
	➤ Standby Pump output.	N/A	N/A	N/A
	➤ Standby Pump head.	N/A	N/A	N/A
	➤ Auto Starting / Manual Stopping.	N/A	N/A	N/A
	➤ Pump house access.	N/A	N/A	N/A
	• Terrace Level			
	➤ Discharge of pump.	N/A	N/A	N/A
	➤ Head of pump.	N/A	N/A	N/A
	➤ Power supply.	N/A	N/A	N/A
	➤ Auto starting of pump.	N/A	N/A	N/A
14.	Captive water storage for Fire Fighting.			
	• Underground tank capacity.	N/A	N/A	N/A
	• Draw-off connection.	N/A	N/A	N/A
	• Fire Service Inlet.	N/A	N/A	N/A
	• Access to tank.	N/A	N/A	N/A
	• Overhead tank capacity.	N/A	N/A	N/A
15.	'No Smoking' Signage.	Required	Displayed in Hindi & English	MR
16.	Provision of Lifts.			
	• Pressurization of lift shaft.	N/A	N/A	N/A
	• Pressurization of lift lobby.	N/A	N/A	N/A
	• Communication in lift car.	N/A	N/A	N/A
	• Fireman's switch.	N/A	N/A	N/A
	• Lift signage.	N/A	N/A	N/A
17.	Standby Power Supply	N/A	Provided (DG Set)	N/A
18.	Refuge Area			
	• Total area	N/A	N/A	N/A
	• Location	N/A	N/A	N/A


N/11

19.	Fire Control Room.			
	• Detector system panel.	N/A	N/A	N/A
	• Flow switch panel.	N/A	N/A	N/A
	• PA system panel.	N/A	N/A	N/A
	• Battery backup.	N/A	N/A	N/A
	• Building floor plan.	N/A	N/A	N/A
20.	Special Fire Protection System for the Protection of special Risk, if any.	N/A	N/A	N/A

The fire protection system provided at suitable places in the retail outlet area were checked/operated at random and found functional at the time of inspection. "No Smoking" sign boards were found displayed both in Hindi & English at conspicuous places. No loose electrical wiring seen in the premises at the time of inspection.

Keeping in view of the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under the rules, the FSC issued vide letter No. F6/DFS/MS/2015/SZ/1314 dated 22.07.2015, renewal under rule 37 of the Delhi Fire Service Rules, 2010 is recommended.

Accordingly DFA is put up for approval and signature please.


 Signature of the Inspecting Officer
 Name: Mehmoed
 Design: ADO (SJ)


M/s Capital Oil Agency at Ring Road, Sarojini Nagar, New Delhi-110023

DO (SD)


11/6/18

dy. PRO (SZ)

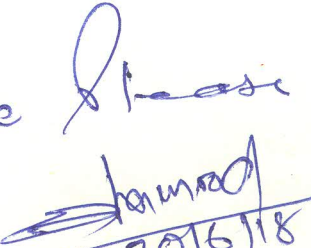

13/6



1529/40/15Z
91-0

CFO for m.s.c.u. 14/6.
A.G.T. for signature please

PRO (SZ)


20/6/18
ADO (SJ)