

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEADQUARTERS, DELHI FIRE SERVICE, CONNAUGHT PLACE  
NEW DELHI-110001

No. F.6/DFS/MS/EH/SZ/2018/ 1460

Dated: 21/06/18

**FIRE SAFETY CERTIFICATE**

Certified that M/s Dawat Khana Restaurant at 17, Community Centre, New Friends Colony, New Delhi located at ground floor of a building comprised of basement, ground and two upper floors was issued FSC by this department vide letter No. F6/DFS/MS/EH/2014/SZ/1362 dated 03/11/2014. The restaurant was re-inspected by the officer concerned of this department on 04/06/2018 in the presence of Mr. K.S. Rawat (Manager) of the restaurant and found that the said restaurant premises have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the premises fit for occupancy class "Assembly, Group-D" (Restaurant) with effect from the date of issue of this certificate for a period of **three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 21/06/18 at New Delhi by

  
(Vipin Kental)  
Chief Fire Officer  
Tel: 011-23412225

Copy to: -

1. M/s Dawat Khana Restt at 17, Community Centre, New Friends Colony, New Delhi-65
2. The Addl. Comm. of Police (Lic.), First Floor, P.S. Defence Colony, New Delhi-110049

**Conditions for the validity of Fire Safety Certificate: -**

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire fighting system.
4. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in)
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL-2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry.

## INSPECTION REPORT

1	Name & Address of the Building	M/s Dawat Khana Restaurant, 17, Community Centre, New Friends Colony, New Delhi-10065		
2	Type of Occupancy	Assembly, "Group-D" (Eating House)		
3	Building Comprised of	Basement, Ground + 2 upper floors.		
4	Type of Case	Renewal		
5	Details of Previous NOC	F.6/DFS/MS/EH/2014/SZ/1362 Dated 03/11/2014		
6	Fire Safety Directives Letter No	Nil		
7	Date of Inspection	04-06-2018		
8	Name of the Inspecting Officers	Mehmood, ADO (SJ)		
9	Name & Designation of Officers from the building side	Sh. KS Rawat (Manager)		
10	Year of construction	2005	Restt is running at ground floor of the bldg	
11	Applicant letter No.	Outdoor Diary No. 7189 dated 10.05.2018		
<b>S. No.</b>	<b>Minimum standards on Fire Prevention and Fire Safety U/R 33</b>	<b>Old NOC requirements</b>	<b>Provided at Site</b>	<b>Remarks MR/NMR</b>
<b>1</b>	<b>Access to Building.</b>			
	• Road width	Required	6 mtr	MR
	• Gate width	-NA-	-NA-	-NA-
	• Width of internal road	-NA-	-NA-	-NA-
<b>2</b>	<b>Number, width, type &amp; arrangement of exits.</b>			
	<b>a) Number of Staircase</b>			
	➤ Upper floors.	-NA-	Restt. at GF only	-NA-
	➤ Basement floor.	-NA-	-NA-	-NA-
	<b>b) Width of Staircase</b>			
	➤ Upper floors	-NA-	-NA-	-NA-
	➤ Basement floor	-NA-	-NA-	-NA-
	<b>c) Protection of exits</b>			
	➤ Fire check door	-NA-	-NA-	-NA-
	➤ Pressurization	-NA-	-NA-	-NA-
	<b>d) No. of continuous staircase to terrace</b>	Required	One	MR
	<b>e) Width of corridor</b>	-NA-	-NA-	-NA-
	<b>f) Door size</b>	Old case	0.86, 0.66, 0.94 & 1.04m	MR
<b>3</b>	<b>Compartmentation.</b>			
	• Fire check door.	-NA-	-NA-	-NA-
	• Sealing of electrical shafts.	-NA-	-NA-	-NA-
	• Fire rating of shaft door.	-NA-	-NA-	-NA-
	• Water curtain	-NA-	-NA-	-NA-
	• Fire dampers.	-NA-	-NA-	-NA-
<b>4.</b>	<b>Smoke Management system.</b>			
	• Basement	30 ACPH	-NA-	-NA-
	• Upper floors / Restt. area	12 ACPH	Provided in kitchen	MR
<b>5.</b>	<b>Fire Extinguishers.</b>			
	• Total numbers	Required	06 Nos	MR
	• Types	ABC / CO2	CO2 & ABC	MR
	• ISI Marking	ISI marked	Provided	MR
<b>6.</b>	<b>First Aid Hose Reels.</b>			
	• Total numbers on each floor.	One	Provided near Restt.	MR
	• Length of hose-reel hose.	30 mtr	30 mtr	MR
	• Nozzle Diameter	5 mm	5 mm	MR

M/s Dawat Khana Restt at 17, Community Centre, New Friends Colony, New Delhi

7	<b>Automatic fire detection &amp; alarming system.</b>			
	<ul style="list-style-type: none"> <li>Type of detectors</li> <li>Location of Main Panel</li> <li>Location of Repeater Panel</li> <li>Alternate source of power</li> <li>Hooter's location</li> </ul>	-NA-	Smoke type	-NA-
		-NA-	Ground floor	-NA-
		-NA-	-NA-	-NA-
		-NA-	Provided	-NA-
		-NA-	Provided	-NA-
8.	<b>MOEFA</b>	Required	Provided	MR
9.	<b>Public Address System</b>	-NA-	-NA-	-NA-
10.	<b>Automatic Sprinkler System</b>			
	<ul style="list-style-type: none"> <li>Basement</li> <li>Upper floors.</li> <li>Sprinkler above false ceiling</li> </ul>	-NA-	-NA-	-NA-
		Required	Provided in Restt.	MR
		-NA-	-NA-	-NA-
11.	<b>Internal Hydrants.</b>			
	<ul style="list-style-type: none"> <li>Size of Riser/Down-comer</li> <li>Number of Hydrant per floor</li> <li>Hose box.</li> </ul>	Required	100 mm	MR
		Required	One	MR
		Required	One	MR
12.	<b>Yard Hydrants.</b>			
	<ul style="list-style-type: none"> <li>Total number of hydrants.</li> <li>Hose box.</li> </ul>	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
13.	<b>Pumping arrangements.</b>			
	<ul style="list-style-type: none"> <li><b>Ground Level</b> <ul style="list-style-type: none"> <li>Discharge of main pump.</li> <li>Head of main pump.</li> <li>Number of main pumps.</li> <li>Jockey Pump output.</li> <li>Jockey Pump head.</li> <li>Standby Pump output.</li> <li>Standby Pump head.</li> <li>Auto Starting / Manual Stopping.</li> <li>Pump house access.</li> </ul> </li> <li><b>Terrace Level</b> <ul style="list-style-type: none"> <li>Discharge of pump.</li> <li>Head of pump.</li> <li>Power supply.</li> <li>Auto starting of pump.</li> </ul> </li> </ul>	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		450 LPM	450 LPM	MR
		40m	40m	MR
		Required	Provided	MR
		Required	Provided	MR
14.	<b>Captive water storage for fire fighting.</b>			
	<ul style="list-style-type: none"> <li>Underground tank capacity. <ul style="list-style-type: none"> <li>Draw-off connection.</li> <li>Fire Service Inlet.</li> <li>Access to tank.</li> </ul> </li> <li>Overhead tank capacity.</li> </ul>	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		Required	5.000 Ltr	MR
15.	<b>Exit Signage.</b>	Required	Provided	MR
16.	<b>Provision of Lifts.</b>			
	<ul style="list-style-type: none"> <li>Pressurization of lift shaft.</li> <li>Pressurization of lift lobby.</li> <li>Communication in lift ear.</li> <li>Fireman's switch.</li> <li>Lift signage.</li> </ul>	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
17.	<b>Standby Power Supply</b>	Required	Provided	MR
18.	<b>Refuge Area</b>			
	<ul style="list-style-type: none"> <li>Total area</li> <li>Location</li> </ul>	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-


M/s Dawat Khana Restt at 17, Community Centre, New Friends Colony, New Delhi

19.	<b>Fire Control Room.</b>			
	• Detector system panel.	-NA-	-NA-	-NA-
	• Flow switch panel.	-NA-	-NA-	-NA-
	• PA system panel.	-NA-	-NA-	-NA-
	• Battery backup.	-NA-	-NA-	-NA-
	• Building floor plan.	-NA-	-NA-	-NA-
20.	<b>Special Fire Protection System for the Protection of special Risk, if any.</b>	-NA-	-NA-	-NA-

The fire protection system provided in the building/ premises were test checked at random and found functional at the time of inspection. The shortcomings communicated vide letter dated 27/02/2018 (C-44) found complied.

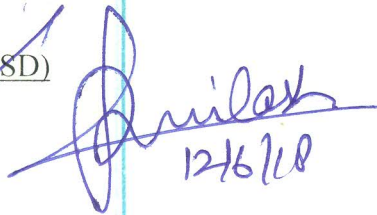
Keeping in view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules, the FSC issued vide letter No. F.6/DFS/MS/EH/2014/SZ/1362 Dated 03/11/2014, renewal under rule 37 of the Delhi Fire Service Rules 2010, is recommended.

Accordingly DFA is put up for approval and signature please.

  
 Signature of the Inspecting Officer  
 Name: Mehmoed  
 Design: ADO (SJ)

M/s Dawat Khana Restt at 17, Community Centre, New Friends Colony, New Delhi


DO (SD)

  
12/6/18

By: CPOCS22

Done  
13/6

FT/01  
CPO \$21 m.scell W  
15/6

A. G.T. put up for signature please  
  
 20/6/18

15/12/18 S2  
18/6



15/30/CP/S3  
21-6

CP/CS22 mscell W  
21/6