

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE  
NEW DELHI-110001

No. F.6/DFS/MS/School/2018/SZ/ 1452

Dated: 20/06/2018

FIRE SAFETY CERTIFICATE

Certified that **R.K.S. Vidya Niketan** located at Block-9/1A, Kalkaji Extension, New Delhi-110019, comprised of basement, ground plus three upper floors was issued FSC by this department vide letter No.F.6/DFS/MS/School/2015/SZ/75 dated 15-01-2015. The premises was re-inspection by officer concerned by this department on 15.05.2018 in the presence of Mr. Devki Nandan (Manager) of the school and found that school building have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of Delhi Fire Service Rules, 2010 and that the premises is fit for occupancy class "**Education, Group-B**" (School) as above with effect from the date of issue of this certificate for period of **Three years** subject to compliance of conditions mentioned below.

Issued 20/06/2018 at New Delhi by

  
(Vipin Kental)  
Chief Fire Officer  
Tel: 011-23412225  


Copy to: -

1. Manager, R.K.S. Vidya Niketan at Block-9/1A, Kalkaji Extension, New Delhi-110019
2. Directorate of Education, South MCD, Civic Centre, Minto Road, New Delhi-110002

Conditions for the validity of Fire Safety Certificate: -

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire fighting system.
4. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in)
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL- 2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry.

## INSPECTION REPORT

1	Name & Address of the Building	RKS Vidya Niketan, Block-9/1A, Kalkaji Extension, New Delhi-110019 (1925282)		
2	Type of Occupancy	Educational, Group-B (School)		
3	Building Comprised of	Basement, Ground plus three upper floors		
4	Type of Case	Renewal		
5	Details of Previous NOC	F.6/DFS/MS/School/2015/SZ/75 dated 15-01-2015		
6	Fire Safety Directives Letter No	DFS Act-2007 and Rules, 2010		
7	Date of Inspection	15-05-2018		
8	Name of the Inspecting Officers	Mehmood, ADO (SJ)		
9	Name & Designation of Officers from the building side	Sh. Devki Nandan (Manager)		
10	Year of construction	2010-11		
11	Applicant letter No.	Outdoor diary No. 6493 dated 23-04-2018		
<b>S. No.</b>	<b>Minimum standards on Fire Prevention and Fire Safety U/R 33</b>	<b>Old NOC requirements</b>	<b>Provided at Site</b>	<b>Remarks MR/NMR</b>
<b>1</b>	<b>Access to Building.</b>			
	• Road width	Required	6 mtr	MR
	• Gate width	-NA-	4.5 mtr	MR
	• Width of internal road	-NA-	-NA-	-NA-
<b>2</b>	<b>Number, width, type &amp; arrangement of exits.</b>			
	<b>a) Number of Staircase</b>			
	➤ Upper floors.	02 Nos	02 Nos	MR
	➤ Basement floor.	02 Nos	2 + 1 ramp	MR
	<b>b) Width of Staircase</b>			
	➤ Upper floors	1.5m or less & 0.75m	1.50m each	MR
	➤ Basement floor	1.5m or less & 0.75m	1.40m each	MR
	<b>c) Protection of exits</b>			
	➤ Fire check door	-NA-	-NA-	-NA-
	➤ Pressurization	-NA-	-NA-	-NA-
	<b>d) No. of continuous staircase to terrace</b>	Required	02 Nos	MR
	<b>e) Width of corridor</b>	-NA-	2.70 mtr	-NA-
	<b>f) Door size</b>	1.0m (two)	Provided	MR
<b>3</b>	<b>Compartmentation.</b>			
	• Fire check door.	-NA-	-NA-	-NA-
	• Sealing of electrical shafts.	-NA-	-NA-	-NA-
	• Fire rating of shaft door.	-NA-	-NA-	-NA-
	• Water curtain	-NA-	-NA-	-NA-
	• Fire dampers.	-NA-	-NA-	-NA-
<b>4.</b>	<b>Smoke Management system.</b>			
	• Basement	30 ACPH	Exhaust fan provided	MR
	• Upper floors	12 ACPH	-NA-	-NA-
<b>5.</b>	<b>Fire Extinguishers.</b>			
	• Total numbers	12 Nos	Provided	MR
	• Types	ABC / CO2	ABC type	MR
	• ISI Marking	ISI marked	Yes	MR
<b>6.</b>	<b>First Aid Hose Reels.</b>			
	• Total numbers on each floor.	One	Provided	MR
	• Length of hose-reel hose.	30m	Provided	MR
	• Nozzle Diameter	5mm	Provided	MR






19.	<b>Fire Control Room.</b> <ul style="list-style-type: none"> <li>• Detector system panel.</li> <li>• Flow switch panel.</li> <li>• PA system panel.</li> <li>• Battery backup.</li> <li>• Building floor plan.</li> </ul>	-NA-	-NA-	-NA-
20.	<b>Special Fire Protection System for the Protection of special Risk, if any.</b>	Required	ABC type fire extinguisher provided near electrical panel	MR

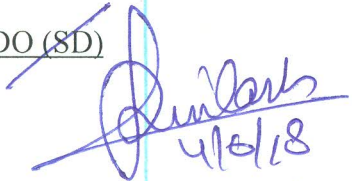
The fire protection system provided in the building / premises were test checked at random and found functional at the time of inspection.

Keeping in view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules, the FSC issued vide letter No. F6/DFS/MS/School/2015/SZ/75 dated 15/01/2015, renewal under rule 37 of the Delhi Fire Service Rules 2010, is recommended.


Accordingly DFA is put up for approval and signature please.

  
 Signature of the Inspecting Officer  
 Name: Mehmood  
 Design: ADO (SJ)

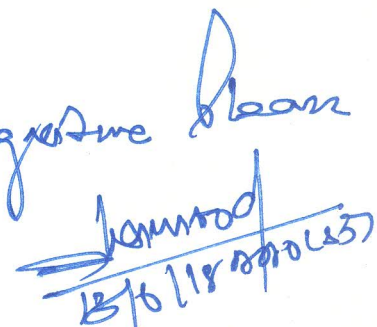
R.K.S. Vidya Niketan, Block-9/1A, Kalkaji Extension, New Delhi-110019

DO (SD)  
  
 4/6/18  
 dy. of (S2)



  
 JTB FTB.  
 M. Scell W  
 JTB.

1522/CP/15Z  
 2016  
 CPO (S2)

A. E.T. letter put up for signature please  
  
 12/6/18 (S2)  
 CPO (S2)  
 M. Scell W  
 19/6.