

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE  
NEW DELHI-110001

No. F.6/DFS/MS/School/2018/SZ/ 1409

Dated: 15/6/18

FIRE SAFETY CERTIFICATE

Certified that **S.D.M. C. Primary Model** located at Pant Nagar, Jangpura Extn., New Delhi-110014 (ID: 1958021), comprised of ground plus one upper floor was issued FSC by this department vide letter No. F6/DFS/MS/School/2015/SZ/882 dated 29/05/2015. The premises was re-inspected by officer concern of this department on 25.05.2018 in the presence of Mrs. Sarita (Principal) of the school and observed that an additional building block comprised of ground plus one upper floor have been constructed within the compound. Both, old & new school blocks have found to be complied with the fire prevention and fire safety requirements in accordance with Director of Education circular F.16//Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011 issued by Directorate of Education, Govt. of NCT of Delhi and that the building/premises is fit for occupancy class "**Educational, Group-B**" (School) as above with effect from the date of issue of this certificate for period of **Three years** in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued 15/06/18 at New Delhi by

15/6  
(Vipin Kental)  
Chief Fire Officer  
Tel: 011-23412225

Copy to: -

1. Principal, SDMC Primary Model School, Pant Nagar, Jangpura Extn, New Delhi-110014
2. Directorate of Education, South MCD, Civic Centre, Minto Road, New Delhi-110002

Conditions for the validity of Fire Safety Certificate: -

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire fighting system.
4. The owner/occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in)
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL- 2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry.



## INSPECTION REPORT

1	Name & Address of the Building	SDMC PRIMARY MODEL SCHOOL,PANT NAGAR, JANGPURA EXTN, NEW DELHI-110014 (1958021)		
2	Type of Occupancy	Educational, Group-B (School)		
3	Building Comprised of	Ground + One upper floor. (02 Blocks)		
4	Type of Case	Renewal & Addition of New Block		
5	Details of Previous NOC	F.6/DFS/MS/School/2015/SZ/882 dated 29-05-2015		
6	Fire Safety Directives Letter No	F.16//Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011		
7	Date of Inspection	25-05-2018		
8	Name of the Inspecting Officers	Mehmood, ADO (SJ)		
9	Name & Designation of Officers from the building side	Mrs. Sarita (Principal)		
10	Year of construction	2012 & 2016		
11	Applicant letter No.	Outdoor Diary No. 6271 dated 19.04.2018 (C-9)		
S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	DOE circular requirements	Provided at Site	Remarks MR/NMR
1	<b>Access to Building.</b>			
	• Road width	Accessible	6 mtr	MR
	• Gate width	-NA-	4.5 mtr	-NA-
	• Width of internal road	-NA-	-NA-	-NA-
2	<b>Number, width, type &amp; arrangement of exits.</b>			
	<b>a) Number of Staircase</b>			
	➤ Upper floors.	Old Bk.- 02 Nos New Bk.-01 No	Old Bk.- 02 Nos New Bk.-02 No	MR MR
	➤ Basement floor.	-NA-	-NA-	-NA-
	<b>b) Width of Staircase</b>			
	➤ Upper floors	1.5m or less & 0.75m 1.5m or less & 0.75m	Old Bk.-1.5 mtr each New Bk.-1.81 & 1.34m	MR MR
	➤ Basement floor	-NA-	-NA-	-NA-
	<b>c) Protection of exits</b>			
	➤ Fire check door	-NA-	-NA-	-NA-
	➤ Pressurization	-NA-	-NA-	-NA-
	<b>d) No. of continuous staircase to terrace</b>	-NA-	-NA-	-NA-
	<b>e) Width of corridor</b>	-NA-	-NA-	-NA-
	<b>f) Door size</b>	1m	Provided	MR
3	<b>Compartmentation.</b>			
	• Fire check door.	-NA-	-NA-	-NA-
	• Sealing of electrical shafts.	-NA-	-NA-	-NA-
	• Fire rating of shaft door.	-NA-	-NA-	-NA-
	• Water curtain	-NA-	-NA-	-NA-
	• Fire dampers.	-NA-	-NA-	-NA-
4.	<b>Smoke Management system.</b>			
	• Basement	30 ACPH	-NA-	-NA-
	• Upper floors	12 ACPH	-NA-	-NA-
5.	<b>Fire Extinguishers.</b>			
	• Total numbers	08 Nos	Provided	MR
	• Types	ABC / CO2	ABC type	MR
	• ISI Marking	ISI marked	Provided	MR
6.	<b>First Aid Hose Reels.</b>			
	• Total numbers on each floor.	-NA-	-NA-	-NA-
	• Length of hose-reel hose.	-NA-	-NA-	-NA-
	• Nozzle Diameter	-NA-	-NA-	-NA-




7	<b>Automatic fire detection &amp; alarming system.</b>			
	<ul style="list-style-type: none"> <li>Type of detectors</li> <li>Location of Main Panel</li> <li>Location of Repeater Panel</li> <li>Alternate source of power</li> <li>Hooter's location</li> </ul>	-NA-	-NA-	-NA-
8.	<b>MOEFA</b>	-NA-	-NA-	-NA-
9.	<b>Public Address System</b>	-NA-	-NA-	-NA-
10.	<b>Automatic Sprinkler System</b>			
	<ul style="list-style-type: none"> <li>Basement</li> <li>Upper floors</li> <li>Sprinkler above false ceiling</li> </ul>	-NA-	-NA-	-NA-
11.	<b>Internal Hydrants.</b>			
	<ul style="list-style-type: none"> <li>Size of Riser/Down-comer</li> <li>Number of Hydrant per floor</li> <li>Hose box.</li> </ul>	-NA-	-NA-	-NA-
12.	<b>Yard Hydrants.</b>			
	<ul style="list-style-type: none"> <li>Total number of hydrants.</li> <li>Hose box.</li> </ul>	-NA-	-NA-	-NA-
13.	<b>Pumping arrangements.</b>			
	<ul style="list-style-type: none"> <li><b>Ground Level</b> <ul style="list-style-type: none"> <li>Discharge of main pump.</li> <li>Head of main pump.</li> <li>Number of main pumps.</li> <li>Jockey Pump output.</li> <li>Jockey Pump head.</li> <li>Standby Pump output.</li> <li>Standby Pump head.</li> <li>Auto Starting / Manual Stopping.</li> <li>Pump house access.</li> </ul> </li> <li><b>Terrace Level</b> <ul style="list-style-type: none"> <li>Discharge of pump.</li> <li>Head of pump.</li> <li>Power supply.</li> <li>Auto starting of pump.</li> </ul> </li> </ul>	-NA-	-NA-	-NA-
14.	<b>Captive water storage for fire fighting.</b>			
	<ul style="list-style-type: none"> <li>Underground tank capacity. <ul style="list-style-type: none"> <li>Draw-off connection.</li> <li>Fire Service Inlet.</li> <li>Access to tank.</li> </ul> </li> <li>Overhead tank capacity.</li> </ul>	-NA-	-NA-	-NA-
15.	<b>Exit Signage.</b>	Required	Provided	MR
16.	<b>Provision of Lifts.</b>			
	<ul style="list-style-type: none"> <li>Pressurization of lift shaft.</li> <li>Pressurization of lift lobby.</li> <li>Communication in lift car.</li> <li>Fireman's switch.</li> <li>Lift signage.</li> </ul>	-NA-	-NA-	-NA-
17.	<b>Standby Power Supply</b>	-NA-	-NA-	-NA-
18.	<b>Refuge Area</b>			
	<ul style="list-style-type: none"> <li>Total area</li> <li>Location</li> </ul>	-NA-	-NA-	-NA-

19.	<b>Fire Control Room.</b>	• Detector system panel.	-NA-	-NA-	-NA-
		• Flow switch panel.	-NA-	-NA-	-NA-
		• PA system panel.	-NA-	-NA-	-NA-
		• Battery backup.	-NA-	-NA-	-NA-
		• Building floor plan.	-NA-	-NA-	-NA-
20.	<b>Special Fire Protection System for the Protection of special Risk, if any.</b>	-NA-	-NA-	-NA-	

Previously, old school building comprised of ground plus one upper floor was issued FSC by this department vide letter No. F.6/DFS/MS/School/2015/SZ/882 dated 29/05/2015. An additional school block comprised of ground plus one upper floor has been constructed in the existing compound by PWD, Govt. of NCT of Delhi.


The Fire protection systems provided in the building/premises were checked/ operated and found functional at the time of inspection. Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety measures as required under the DOE circular dated 01/03/2011, it is recommended to renew Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules, 2010.

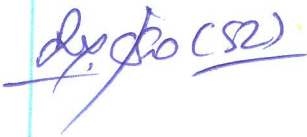
Accordingly DFA is put up for approval and signature please.


  
 Signature of the Inspecting Officer  
 Name: Mehmood  
 Design: ADO (SJ)

SDMC Primary Model School, Pant Nagar, Jangpura Extn, New Delhi

DO (SD)

  
4/6/18


  
ADO (SJ)

  
7/6

  
CFO (SJ)

M.Scell

F.T.O.

  
7/6


A.E.T. Letter put up for signature please

Signature please

  
Mehmood  
ADO (SJ) 8/6/18



1503/CFO/S2  
15-6

  
ADO (SJ)

M.Scell   
15/6