

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI - 110 001**

No. F.6/DFS/MS/Educational/SZ/2018/ 1354

Dated: 11/6/18

**FIRE SAFETY CERTIFICATE**

Certified that the **Jagan Nath Gupta Memorial Educational Society** situated at MOR Pocket-105, Kalkaji, New Delhi-110019 comprised of Basement, Ground & Four Upper Floors was granted FSC by this department vide letter no. F6/DFS/MS/2014/347 dated 12/03/2014. The premises was re-inspected by the officer concerned of this department on 06/06/2018 in the presence of Mr. Amit Kamra (Admin. Officer) and found that the said Educational building have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that these two building blocks are fit for occupancy class "**Group B Educational building**" with effect from ~~11/6/~~2018 for a period of **three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule-38 of the Delhi Fire Service Rules, 2010.

Issued on.... 11/6/2018 ..... at New Delhi by.

  
(Vipin Kental)  
Chief Fire Officer  
Tel: 011-23412225

Copy to:-

1. The Executive Engineer (Bldg.), SDMC, Jal Vihar, Lajpat Nagar, New Delhi-110024
2. Dr. Amit Gupta (Secretary), Jagan Nath Gupta Memorial Educational Society, H-2/1, Model Town-III, Delhi-110009

**Conditions for the validity of fire safety certificate:**

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of firefighting system.
4. The owner/ occupier shall submit a declaration **every year** in **Form 'K'** provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on [http://delhi.gov.in/wps/wcm/connect/doi\\_fire/FIRE/Home/Forms](http://delhi.gov.in/wps/wcm/connect/doi_fire/FIRE/Home/Forms)
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL-2016), if any.
6. "The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in **Form 'J'** [sub rule (1) of rule 37] along with a copy of this Certificate, **six months** prior to its expiry."

1. Name & address of the building : Jagan Nath Gupta Memorial Educational Society, MCR 100111, Kalkaji, New Delhi-110019
2. Type of Occupancy : Class- B (Educational)
3. Type of Case : Renewal [Educational]
4. Details of Previous NOC : F6 /DFS/MS/2014/347 dated 12/03/2014
5. Fire Safety directives letter No : F6/DFS/MS/BP/2008/2612 dated 16/09/2008
6. Date of inspection : 06/06/2018
7. Name of Inspecting Officer : A. K. Malik
8. Name and designation of officers  
From the building side : Mr. Amit Kamra
9. Year of Construction : 2000 & 2011 [Basement + Ground + 4 upper floors]
10. Applicant's letter No. : Outdoor diary no. 7718 dated 22/05/2018

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	Old NOC/Directives Requirement	Provided at site	Remarks MR/NMR
1.	<b>Access to building</b>			
	<ul style="list-style-type: none"> <li>• Road width</li> <li>• Gate width</li> <li>• Width of internal road</li> </ul>	9m 5m 6m	9m 4.87m & 4.37m Provided	MR MR (Old Case) MR
2.	<b>Number, Width, Type &amp; Arrangement of Exits</b>			
	a. Number of staircases			
	<ul style="list-style-type: none"> <li>• Upper Floors</li> <li>• Basements</li> </ul>	02 Nos 02 Nos	02 Nos 03 Nos	MR MR
	b. Width of staircases			
	<ul style="list-style-type: none"> <li>• Upper Floor</li> <li>• Basements</li> </ul>	1.5m(each) 1.5m(each)	1.56m & 1.12m 1.56m, 1m & 0.79m	MR (old case) MR (old case)
	c. Protection of exits			
	<ul style="list-style-type: none"> <li>• Fire check door</li> <li>• Pressurization</li> </ul>	Required in one staircase -NA-	Provided -NA-	MR -NA-
	d. No. of continuous staircases to terrace	01 Nos	01 Nos	MR
	e. Width of Corridor	-NA-	-NA-	-NA-
	f. Door Size	-NA-	1m (final exit)	-NA-
3.	<b>Compartmentation</b>			
	<ul style="list-style-type: none"> <li>• Fire check door</li> <li>• Sealing of electrical shafts</li> <li>• Fire Rating of shaft door</li> <li>• Water Curtain</li> <li>• Fire Dampers</li> </ul>	Required Required -NA- -NA- Required	Provided Provided -NA- -NA- Provided	MR MR -NA- -NA- MR
4.	<b>Smoke Management System</b>			
	<ul style="list-style-type: none"> <li>• Basements</li> <li>• Upper floors</li> </ul>	30 a/c per hour 12 a/c per hour	Exhaust Fan -NA-	MR -NA-
5.	<b>Fire Extinguishers</b>			
	<ul style="list-style-type: none"> <li>• Total numbers</li> <li>• Types</li> <li>• IS marking</li> </ul>	25 No's ABC/W. CO <sub>2</sub> /CO <sub>2</sub> ISI	25 No's 10/10/05 No's Yes	MR MR MR
6.	<b>First-Aid Hose Reels</b>			
	<ul style="list-style-type: none"> <li>• Total numbers on each floor</li> <li>• Length of hose reel hose</li> <li>• Nozzle diameter</li> </ul>	One 30m 5mm	Two Provided Provided	MR MR MR
7.	<b>Automatic fire detection and alarming system</b>			
	<ul style="list-style-type: none"> <li>• Type of detectors</li> <li>• Location of Main Panel</li> <li>• Location of Repeater Panel</li> <li>• Alternate source of power</li> <li>• Hooters' Location</li> </ul>	-NA- -NA- -NA- -NA- -NA-	-NA- -NA- -NA- -NA- -NA-	-NA- -NA- -NA- -NA- -NA-

8.	MOEFA	Required	Provided	MR
9.	Public Address System	Required	Provided	MR
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> <li>• Basement</li> <li>• Ground Floor</li> <li>• Sprinkler above false ceiling</li> </ul>	Required	Provided	MR
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
11.	Internal Hydrants			
	<ul style="list-style-type: none"> <li>• Size of riser/down-comer</li> <li>• Number of hydrants per floor</li> <li>• Hose Box</li> </ul>	100mm	Provided	MR
		One	Two	MR
		One	Two	MR
12.	Yard Hydrants			
	<ul style="list-style-type: none"> <li>• Total number of hydrants</li> <li>• Hose Box</li> </ul>	-NA-	01 Nos	-NA-
		-NA-	01 Nos	-NA-
13.	Pumping Arrangements			
	<ul style="list-style-type: none"> <li>• Ground Level <ul style="list-style-type: none"> <li>➤ Discharge of main Pump</li> <li>➤ Head of Main pump</li> <li>➤ Number of main pumps</li> <li>➤ Jockey Pump out put</li> <li>➤ Jockey pump head</li> <li>➤ Standby Pump out put</li> <li>➤ Standby Pump Head</li> <li>➤ Auto Starting/Manual Stopping</li> <li>➤ Pump House Access</li> </ul> </li> </ul>	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> <li>• Terrace level <ul style="list-style-type: none"> <li>➤ Discharge of pump</li> <li>➤ Head of the pump</li> <li>➤ Power Supply</li> <li>➤ Auto Starting of pump</li> </ul> </li> </ul>	900 LPM	900 LPM & 450 LPM	MR
		70m	35m	MR (Old Case)
		Required	Provided	MR
		Required	Provided	MR
14.	Captive Water Storage for fire fighting			
	<ul style="list-style-type: none"> <li>• Underground tank capacity <ul style="list-style-type: none"> <li>➤ Draw-off connection</li> <li>➤ Fire service inlet</li> <li>➤ Access to tank</li> </ul> </li> <li>• Overhead Tank capacity</li> </ul>	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		25,000 Lts.	30,000 Lts.	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			
	<ul style="list-style-type: none"> <li>• Pressurization of Lift Shaft</li> <li>• Pressurization of Lift lobby</li> <li>• Communication In lift Car</li> <li>• Fireman's Grounding Switch</li> <li>• Lift Signage</li> </ul>	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		Required	Provided	MR
		Required	Provided	MR
		Required	Provided	MR
17.	Standby power supply	Required	Provided	MR
18.	Refuge Area.			
	<ul style="list-style-type: none"> <li>➤ Total Area</li> <li>➤ Location</li> </ul>	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
19.	Fire Control Room			
	<ul style="list-style-type: none"> <li>• Detector System Panel</li> <li>• Flow Switch Panel</li> <li>• PA System Panel</li> <li>• Battery backup</li> <li>• Building Floor Plans</li> </ul>	Required	Provided	MR
		-NA-	-NA-	-NA-
		Required	Provided	MR
		Required	Provide	MR
		-NA-	-NA-	-NA-
20.	Special Fire Protection System for Protection of special Risks, if any:	-NA-	-NA-	-NA-

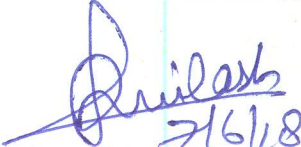
-2/22

Jagan Nath Gupta Memorial Educational Society, MOR Pocket-105, Kalkaji, New Delhi-110019



The fire protection systems provided in the building were randomly tested, checked and found functional at the time of inspection and the shortcomings communicated vide letter no. F/6/DFS/MS/Educational/SZ/2017/961 dated 17/04/2017 found complied.

Keeping in view of the above substantial compliance of the minimum standards of fire prevention and fire safety measures as required under the rules it is recommended to grant Fire Safety Certificate under rule 35(3) of the Delhi Fire Service Rules 2010.

Accordingly Form "H" in shape of DFA is put up for approval under Rule 35(4).



  
Signature of Inspecting Officer  
Name: A. K. Malik  
Designation: Divisional Officer

DY. CFO (SZ)

CFO (SZ)  7/6  
m. sell. FTP.  8/6

MOS/MS/SZ  
11-6

Since F.P. is put up for SS please.

CFO (SZ)  4/6/18  
m. sell.  11/6  
DO (SD)

