

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE  
NEW DELHI-110001

No. F.6/DFS/MS/School/2018/SZ/ 13/4

Dated: 13/6/18

FIRE SAFETY CERTIFICATE

Certified that **Sunshine Public School** located at D-1/102, Vishwakarma Colony, Jaitpur Extn., Badarpur, New Delhi-110044, comprised of ground floor only, Owned/Occupied by under RPS Educational Society have complied with the fire prevention and fire safety requirements in accordance with Education Director circular No. F.16//Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011 issued by Directorate of Education, Govt. of NCT of Delhi and verified by officer concern of this department on 19/05/2018 in the presence of Ms. Suraiya (Teacher) of the school and that the building/premises is fit for occupancy class "**Educational, Group-B**" (School) as above with effect from the date of issue of this certificate for period of **Three years** in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued 13/6/18 at New Delhi by

U  
12/6.

(Vipin Kental)  
Chief Fire Officer  
Tel: 011-23412225



Copy to: -

1. Manager, Sunshine Public School at D-1/102, Vishwakarma Colony, Jaitpur Extension, Badarpur, New Delhi-110044
2. Directorate of Education, South MCD, Civic Centre, Minto Road, New Delhi-110002

Conditions for the validity of Fire Safety Certificate: -

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life property due to non- functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire fighting system.
4. The owner/occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in)
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL-2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry.

## INSPECTION REPORT

1	Name & Address of the Building	Sunshine Public School, D-1/201, Vishwakarma Colony, Jaitpur Extn, Badarpur, New Delhi-44		
2	Type of Occupancy	Educational, Group-B (School)		
3	Building Comprised of	Ground floor only.		
4	Type of Case	New		
5	Details of Previous NOC	Nil		
6	Fire Safety Directives Letter No	F.16//Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011		
7	Date of Inspection	19-05-2018		
8	Name of the Inspecting Officers	Mehmood, ADO (SJ)		
9	Name & Designation of Officers from the building side	Ms. Suraiya (Teacher)		
10	Year of construction	2007		
11	Applicant letter No.	Outdoor Diary No. 6568 dated 24.04.2018		
<b>S. No.</b>	<b>Minimum standards on Fire Prevention and Fire Safety U/R 33</b>	<b>DOE circular requirements</b>	<b>Provided at Site</b>	<b>Remarks MR/NMR</b>
<b>1</b>	<b>Access to Building.</b>			
	<ul style="list-style-type: none"> <li>• Road width</li> <li>• Gate width</li> <li>• Width of internal road</li> </ul>	<ul style="list-style-type: none"> <li>Accessible</li> <li>-NA-</li> <li>-NA-</li> </ul>	<ul style="list-style-type: none"> <li>6 mtr</li> <li>-NA-</li> <li>-NA-</li> </ul>	<ul style="list-style-type: none"> <li>MR</li> <li>-NA-</li> <li>-NA-</li> </ul>
<b>2</b>	<b>Number, width, type &amp; arrangement of exits.</b>			
	<b>a) Number of Staircase</b>			
	<ul style="list-style-type: none"> <li>➤ Upper floors.</li> <li>➤ Basement floor.</li> </ul>	<ul style="list-style-type: none"> <li>-NA-</li> <li>-NA-</li> </ul>	<ul style="list-style-type: none"> <li>GF only</li> <li>-NA-</li> </ul>	<ul style="list-style-type: none"> <li>-NA-</li> <li>-NA-</li> </ul>
	<b>b) Width of Staircase</b>			
	<ul style="list-style-type: none"> <li>➤ Upper floors</li> <li>➤ Basement floor</li> </ul>	<ul style="list-style-type: none"> <li>-NA-</li> <li>-NA-</li> </ul>	<ul style="list-style-type: none"> <li>-NA-</li> <li>-NA-</li> </ul>	<ul style="list-style-type: none"> <li>-NA-</li> <li>-NA-</li> </ul>
	<b>c) Protection of exits</b>			
	<ul style="list-style-type: none"> <li>➤ Fire check door</li> <li>➤ Pressurization</li> </ul>	<ul style="list-style-type: none"> <li>-NA-</li> <li>-NA-</li> </ul>	<ul style="list-style-type: none"> <li>-NA-</li> <li>-NA-</li> </ul>	<ul style="list-style-type: none"> <li>-NA-</li> <li>-NA-</li> </ul>
	<b>d) No. of continuous staircase to terrace</b>	-NA-	-NA-	-NA-
	<b>e) Width of corridor</b>	-NA-	-NA-	-NA-
	<b>f) Door size</b>	1.0 mtr	Provided	MR
<b>3</b>	<b>Compartmentation.</b>			
	<ul style="list-style-type: none"> <li>• Fire check door.</li> <li>• Sealing of electrical shafts.</li> <li>• Fire rating of shaft door.</li> <li>• Water curtain</li> <li>• Fire dampers.</li> </ul>	<ul style="list-style-type: none"> <li>-NA-</li> <li>-NA-</li> <li>-NA-</li> <li>-NA-</li> <li>-NA-</li> </ul>	<ul style="list-style-type: none"> <li>-NA-</li> <li>-NA-</li> <li>-NA-</li> <li>-NA-</li> <li>-NA-</li> </ul>	<ul style="list-style-type: none"> <li>-NA-</li> <li>-NA-</li> <li>-NA-</li> <li>-NA-</li> <li>-NA-</li> </ul>
<b>4.</b>	<b>Smoke Management system.</b>			
	<ul style="list-style-type: none"> <li>• Basement</li> <li>• Upper floors</li> </ul>	<ul style="list-style-type: none"> <li>30 ACPH</li> <li>12 ACPH</li> </ul>	<ul style="list-style-type: none"> <li>-NA-</li> <li>-NA-</li> </ul>	<ul style="list-style-type: none"> <li>-NA-</li> <li>-NA-</li> </ul>
<b>5.</b>	<b>Fire Extinguishers.</b>			
	<ul style="list-style-type: none"> <li>• Total numbers</li> <li>• Types</li> <li>• ISI Marking</li> </ul>	<ul style="list-style-type: none"> <li>4 Nos</li> <li>ABC / CO2</li> <li>ISI mark</li> </ul>	<ul style="list-style-type: none"> <li>Provided</li> <li>ABC type</li> <li>Provided</li> </ul>	<ul style="list-style-type: none"> <li>MR</li> <li>MR</li> <li>MR</li> </ul>
<b>6.</b>	<b>First Aid Hose Reels.</b>			
	<ul style="list-style-type: none"> <li>• Total numbers on each floor.</li> <li>• Length of hose-reel hose.</li> <li>• Nozzle Diameter</li> </ul>	<ul style="list-style-type: none"> <li>-NA-</li> <li>-NA-</li> <li>-NA-</li> </ul>	<ul style="list-style-type: none"> <li>-NA-</li> <li>-NA-</li> <li>-NA-</li> </ul>	<ul style="list-style-type: none"> <li>-NA-</li> <li>-NA-</li> <li>-NA-</li> </ul>






19.	<b>Fire Control Room.</b>			
	• Detector system panel.	-NA-	-NA-	-NA-
	• Flow switch panel.	-NA-	-NA-	-NA-
	• PA system panel.	-NA-	-NA-	-NA-
	• Battery backup.	-NA-	-NA-	-NA-
	• Building floor plan.	-NA-	-NA-	-NA-
20.	<b>Special Fire Protection System for the Protection of special Risk, if any.</b>	-NA-	1. Provided 01 ABC type fire extinguisher near electrical panel. 2. Provided sand buckets with stand.	-NA-


The Fire protection systems provided in the building were test checked at random and found functional at the time of inspection. Keeping in view the substantial satisfactory compliance of the minimum standards on fire prevention and fire safety measures as required under Directorate of Education circular dated 01/03/2011, it is recommended to issue Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules, 2010.


Accordingly DFA is put up for approval and signature please.


  
 Signature of the Inspecting Officer  
 Name: Mehmoos  
 Design: ADO (SJ)

Sunshine Public School, D-1/102, Vishwakarma Colony, Jaitpur Extn, Badarpur, New Delhi

DO (SD)

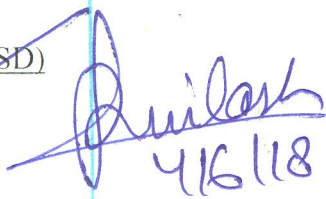
  
4/6/18

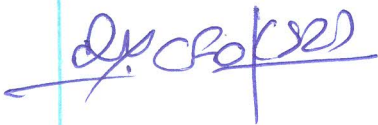

  
S/O  
F.T.M.

CFO 


m.s.c.u.

  
7/6



A. D.T. letter is put up for signature please

  
Address 11/6/18



m.s.c.u.   
12/6.

1492/CFO/S2  
728