

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE  
NEW DELHI-110001

No. F.6/DFS/MS/School/2018/SZ/ 1365

Dated: 13/6/18

FIRE SAFETY CERTIFICATE

Certified that **The Pinnacle School** located at D-Block, Panchsheel Enclave, New Delhi-110017, comprised of ground plus two upper floors was issued FSC by this department vide letter No.F.6/DFS/MS/School/2015/SZ/676 dated 01-05-2015. The premises was re-inspection by officer concerned by this department on 17.05.2018 in the presence of Mr. Tony (Maintenance In-charge) of the school and found that school building have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of Delhi Fire Service Rules, 2010 and that the premises is fit for occupancy class "Education Building, Group-B" as above with effect from the date of issue of this certificate for period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued 13/6/18 at New Delhi by

  
(Vipin Kental)  
Chief Fire Officer  
Tel: 011-23412225  


Copy to: -

1. Manager, The Pinnacle School at D-Block, Panchsheel Enclave, New Delhi-110017
2. Directorate of Education, South MCD, Civic Centre, Minto Road, New Delhi-110002

Conditions for the validity of Fire Safety Certificate: -

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire fighting system.
4. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in)
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL- 2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry.

## INSPECTION REPORT

1	Name & Address of the Building	The Pinnacle School, D-Block, Panchsheel Enclave, New Delhi-110017 (1925282)		
2	Type of Occupancy	Educational, Group-B (School)		
3	Building Comprised of	Ground plus two upper floors		
4	Type of Case	Renewal		
5	Details of Previous NOC	F.6/DFS/MS/School/2015/SZ/676 dated 01-05-2015		
6	Fire Safety Directives Letter No	F6//MS/DFS/BP/99/2650 Dated 01-02-99		
7	Date of Inspection	17-05-2018		
8	Name of the Inspecting Officers	Mehmood, ADO (SJ)		
9	Name & Designation of Officers from the building side	Sh. Tony (Maintenance In-charge)		
10	Year of construction	2000		
11	Applicant letter No.	PTM/Adm/2018/DFS/824 dated 17-04-2018		
S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC requirements	Provided at Site	Remarks MR/NMR
1	<b>Access to Building.</b>			
	<ul style="list-style-type: none"> <li>Road width</li> <li>Gate width</li> <li>Width of internal road</li> </ul>	Required 5m -NA-	9 mtr Provided -NA-	MR MR -NA-
2	<b>Number, width, type &amp; arrangement of exits.</b>			
	<b>a) Number of Staircase</b>			
	➤ Upper floors.	02 Nos	02 Nos	MR
	➤ Basement floor.	-NA-	-NA-	-NA-
	<b>b) Width of Staircase</b>			
	➤ Upper floors	1.5m	1.6m & 1.9m	MR
	➤ Basement floor	-NA-	-NA-	-NA-
	<b>c) Protection of exits</b>			
	➤ Fire check door	-NA-	-NA-	-NA-
	➤ Pressurization	-NA-	-NA-	-NA-
	<b>d) No. of continuous staircase to terrace</b>	01 No	Provided	MR
	<b>e) Width of corridor</b>	1.5m	Provided	MR
	<b>f) Door size</b>	1 mtr	Provided	MR
3	<b>Compartmentation.</b>			
	<ul style="list-style-type: none"> <li>Fire check door.</li> <li>Sealing of electrical shafts.</li> <li>Fire rating of shaft door.</li> <li>Water curtain</li> <li>Fire dampers.</li> </ul>	-NA- -NA- -NA- -NA- -NA-	-NA- -NA- -NA- -NA- -NA-	-NA- -NA- -NA- -NA- -NA-
4	<b>Smoke Management system.</b>			
	<ul style="list-style-type: none"> <li>Basement</li> <li>Upper floors</li> </ul>	30 ACPH 12 ACPH	-NA- -NA-	-NA- -NA-
5	<b>Fire Extinguishers.</b>			
	<ul style="list-style-type: none"> <li>Total numbers</li> <li>Types</li> <li>ISI Marking</li> </ul>	12 Nos ABC/CO2/W.CO2 ISI mark	20 Nos ABC & W.CO2 Provided	MR MR MR
6	<b>First Aid Hose Reels.</b>			
	<ul style="list-style-type: none"> <li>Total numbers on each floor.</li> <li>Length of hose-reel hose.</li> <li>Nozzle Diameter</li> </ul>	Two 30m 5mm	Two 30m 5mm	MR MR MR

The Pinnacle School, D-Block, Panchsheel Enclave, New Delhi


7	<b>Automatic fire detection &amp; alarming system.</b>			
	• Type of detectors	-NA-	-NA-	-NA-
	• Location of Main Panel	-NA-	-NA-	-NA-
	• Location of Repeater Panel	-NA-	-NA-	-NA-
	• Alternate source of power	-NA-	-NA-	-NA-
	• Hooter's location	-NA-	-NA-	-NA-
8.	<b>MOEFA</b>	Required	Provided	MR
9.	<b>Public Address System</b>			
10.	<b>Automatic Sprinkler System</b>			
	• Basement	-NA-	-NA-	-NA-
	• Upper floors	-NA-	-NA-	-NA-
	• Sprinkler above false ceiling	-NA-	-NA-	-NA-
11.	<b>Internal Hydrants.</b>			
	• Size of Riser/Down-comer	-NA-	-NA-	-NA-
	• Number of Hydrant per floor	-NA-	-NA-	-NA-
	• Hose box.	-NA-	-NA-	-NA-
12.	<b>Yard Hydrants.</b>			
	• Total number of hydrants.	-NA-	-NA-	-NA-
	• Hose box.	-NA-	-NA-	-NA-
13.	<b>Pumping arrangements.</b>			
	• <b>Ground Level</b>			
	➤ Discharge of main pump.	-NA-	-NA-	-NA-
	➤ Head of main pump.	-NA-	-NA-	-NA-
	➤ Number of main pumps.	-NA-	-NA-	-NA-
	➤ Jockey Pump output.	-NA-	-NA-	-NA-
	➤ Jockey Pump head.	-NA-	-NA-	-NA-
	➤ Standby Pump output.	-NA-	-NA-	-NA-
	➤ Standby Pump head.	-NA-	-NA-	-NA-
	➤ Auto Starting / Manual Stopping.	-NA-	-NA-	-NA-
	➤ Pump house access.	-NA-	-NA-	-NA-
	• <b>Terrace Level</b>			
	➤ Discharge of pump.	450 LPM	450 LPM (two)	MR
	➤ Head of pump.	40 mtr	40 mtr each	MR
	➤ Power supply.	Required	Provided	MR
	➤ Auto starting of pump.	Required	Provided	MR
14.	<b>Captive water storage for fire fighting.</b>			
	• Underground tank capacity.	-NA-	-NA-	-NA-
	➤ Draw-off connection.	-NA-	-NA-	-NA-
	➤ Fire Service Inlet.	-NA-	-NA-	-NA-
	➤ Access to tank.	-NA-	-NA-	-NA-
	• Overhead tank capacity.	5,000 Ltr	5,000 x 2	MR
15.	<b>Exit Signage.</b>	Required	Provided	MR
16.	<b>Provision of Lifts.</b>			
	• Pressurization of lift shaft.	-NA-	-NA-	-NA-
	• Pressurization of lift lobby.	-NA-	-NA-	-NA-
	• Communication in lift car.	-NA-	-NA-	-NA-
	• Fireman's switch.	-NA-	-NA-	-NA-
	• Lift signage.	-NA-	-NA-	-NA-
17.	<b>Standby Power Supply</b>	-NA-	Provided	-NA-
18.	<b>Refuge Area</b>			
	• Total area	-NA-	-NA-	-NA-
	• Location	-NA-	-NA-	-NA-

19.	<b>Fire Control Room.</b>			
	• Detector system panel.	-NA-	-NA-	-NA-
	• Flow switch panel.	-NA-	-NA-	-NA-
	• PA system panel.	-NA-	-NA-	-NA-
	• Battery backup.	-NA-	-NA-	-NA-
	• Building floor plan.	-NA-	-NA-	-NA-
20.	<b>Special Fire Protection System for the Protection of special Risk, if any.</b>	-NA-	-NA-	-NA-

The fire protection system provided in the building / premises were test checked at random and found functional at the time of inspection.

Keeping in view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules, the FSC issued vide letter No. F6/DFS/MS/School/2015/SZ/676 dated 01/05/2015, renewal under rule 37 of the Delhi Fire Service Rules 2010, is recommended.

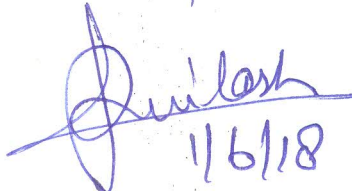
Accordingly DFA is put up for approval and signature please.

  
 Signature of the Inspecting Officer  
 Name: Mehmood  
 Design: ADO (SJ)

The Pinnacle School, D-Block, Panchsheel Enclave, New Delhi

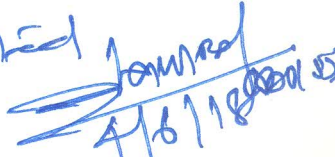
DO (SD)

form 'H' is not in standard format, correct it and re-submit it.


  
 1/6/18

ADO  
5/6/18

As directed changed the format & being new corrected letter.

be resubmitted  
  
 1/6/18

DO (SD)

  
 5/6/18



1293/44/52  
 Dy. CPO (SZ)

