

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS, DELHI FIRE SERVICE, CONNAUGHT PLACE
NEW DELHI-110001

No. F.6/DFS/MS/EH/SZ/2018/ 1301

Dated: 05.06.18

FIRE SAFETY CERTIFICATE

Certified that M/s **Mainland China** (A Unit of Specialty Restaurants Pvt. Ltd) at P. No-4, LSC, Masjid Moth, Greater Kailash-II, New Delhi, comprised of basement (storage only), ground, mezzanine plus one upper floor (Restaurant at ground, mezzanine plus one upper floor only) was issued Fire Safety Certificate by this department vide letter No. F6/MS/DFS/EH/2015/SZ/779 dated 15/05/2015. The restaurant was re-inspected by the officer concerned of this department on 11/05/2018 in the presence of Mr. Sacheen Sahni (Business Manager) and found that the said restaurant premises have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the premises fit for occupancy class "**Assembly, Group-D**" (Restaurant) with effect from the date of issue of this certificate for a period of **three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 05.06.18 at New Delhi by


(Vipin Kental)
Chief Fire Officer
Ph: 011-23412225

Copy to: -

1. The Manager, M/s Mainland China at P. No-4, LSC, Masjid Moth, G.K.-II, New Delhi-48
2. The DHO (SZ), South MCD, Public Health Department, Green Park, New Delhi-110016

Conditions for the validity of Fire Safety Certificate: -

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire fighting system.
4. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL-2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry.

INSPECTION REPORT


1	Name & Address of the Building	M/s Mainland China Restt at Plot No-4, LSC, Masjid Moth, Greater Kailash-II, New Delhi-110048		
2	Type of Occupancy	Assembly, "Group-D" (Eating House)		
3	Building Comprised of	Basement, Ground +3 upper floors.		
4	Type of Case	Renewal		
5	Details of Previous NOC	F.6/MS/DFS/EH/2009/SZ/779 Dated 15/05/2015		
6	Fire Safety Directives Letter No	F6/DFS/MS/EH/2005/718 Dated 04/04/2005		
7	Date of Inspection	11-05-2018		
8	Name of the Inspecting Officers	Mehmood, ADO (SJ)		
9	Name & Designation of Officers from the building side	Mr. Sacheen Sahni (Business Manager)		
10	Year of construction	2005		
11	Applicant letter No.	Outdoor Diary No. 6658 dated 26-04-2018		
S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC requirements	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	• Road width	4.5 mtr	6 mtr	MR
	• Gate width	-NA-	-NA-	-NA-
	• Width of internal road	-NA-	-NA-	-NA-
2	Number, width, type & arrangement of exits.			
	a) Number of Staircase			
	➤ Upper floors.	Required	02 Nos	MR
	➤ Basement floor.	Required	02 Nos	MR
	b) Width of Staircase			
	➤ Upper floors	Required	1.25m each	MR
	➤ Basement floor	Required	1.25m each	MR
	c) Protection of exits			
	➤ Fire check door	-NA-	-NA-	-NA-
	➤ Pressurization	-NA-	-NA-	-NA-
	d) No. of continuous staircase to terrace	One	One	MR
	e) Width of corridor	-NA-	-NA-	-NA-
	f) Door size	Required	1.25m (two)	MR
3	Compartmentation.			
	• Fire check door.	-NA-	-NA-	-NA-
	• Sealing of electrical shafts.	-NA-	-NA-	-NA-
	• Fire rating of shaft door.	-NA-	-NA-	-NA-
	• Water curtain	-NA-	-NA-	-NA-
	• Fire dampers.	-NA-	-NA-	-NA-
4.	Smoke Management system.			
	• Basement	30 ACPH	Exhaust fan provided	MR
	• Upper floors	12 ACPH	Exhaust fan provided	MR
5.	Fire Extinguishers.			
	• Total numbers	08 Nos	12 Nos	MR
	• Types	ABC / CO2	ABC & CO2	MR
	• ISI Marking	ISI marked	Provided	MR
6.	First Aid Hose Reels.			
	• Total numbers on each floor.	One	One	MR
	• Length of hose-reel hose.	30 mtr	30 mtr	MR
	• Nozzle Diameter	5 mm	5 mm	MR

7	Automatic fire detection & alarming system.			
	• Type of detectors	Required	Heat & Smoke	MR
	• Location of Main Panel	Required	Ground floor	MR
	• Location of Repeater Panel	-NA-	-NA-	-NA-
	• Alternate source of power	Required	Provided	MR
	• Hooter's location	Required	At various location	MR
8.	MOEFA	Required	Provided	MR
9.	Public Address System	Required	Provided	MR
10.	Automatic Sprinkler System			
	• Basement	Required	Provided	MR
	• Upper floors.	Required	Provided	MR
	• Sprinkler above false ceiling	-NA-	As above	-NA-
11.	Internal Hydrants.			
	• Size of Riser/Down-comer	Required	100 mm	MR
	• Number of Hydrant per floor	Required	One	MR
	• Hose box.	Required	One	MR
12.	Yard Hydrants.			
	• Total number of hydrants.	-NA-	-NA-	-NA-
	• Hose box.	-NA-	-NA-	-NA-
13.	Pumping arrangements.			
	• Ground Level			
	➤ Discharge of main pump.	-NA-	-NA-	-NA-
	➤ Head of main pump.	-NA-	-NA-	-NA-
	➤ Number of main pumps.	-NA-	-NA-	-NA-
	➤ Jockey Pump output.	-NA-	-NA-	-NA-
	➤ Jockey Pump head.	-NA-	-NA-	-NA-
	➤ Standby Pump output.	-NA-	-NA-	-NA-
	➤ Standby Pump head.	-NA-	-NA-	-NA-
	➤ Auto Starting / Manual Stopping.	-NA-	-NA-	-NA-
	➤ Pump house access.	-NA-	-NA-	-NA-
	• Terrace Level			
	➤ Discharge of pump.	Required	450 & 180 LPM	MR
	➤ Head of pump.	Required	35m	MR
	➤ Power supply.	Required	Provided	MR
	➤ Auto starting of pump.	Required	Provided	MR
14.	Captive water storage for fire fighting.			
	• Underground tank capacity.	-NA-	-NA-	-NA-
	➤ Draw-off connection.	-NA-	-NA-	-NA-
	➤ Fire Service Inlet.	Required	Provided	MR
	➤ Access to tank.	-NA-	-NA-	-NA-
	• Overhead tank capacity.	Required	15,000 Ltr	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			
	• Pressurization of lift shaft.	-NA-	-NA-	-NA-
	• Pressurization of lift lobby.	-NA-	-NA-	-NA-
	• Communication in lift car.	-NA-	-NA-	-NA-
	• Fireman's switch.	Required	Provided	MR
	• Lift signage.	Required	Provided	MR
17.	Standby Power Supply	Required	Provided (DG Set)	MR
18.	Refuge Area			
	• Total area	-NA-	-NA-	-NA-
	• Location	-NA-	-NA-	-NA-

19.	Fire Control Room.	-NA-	-NA-	-NA-
	• Detector system panel.	-NA-	-NA-	-NA-
	• Flow switch panel.	-NA-	-NA-	-NA-
	• PA system panel.	-NA-	-NA-	-NA-
	• Battery backup.	-NA-	-NA-	-NA-
	• Building floor plan.	-NA-	-NA-	-NA-
20.	Special Fire Protection System for the Protection of special Risk, if any.	-NA-	-NA-	-NA-


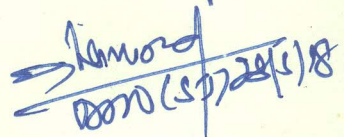
The fire protection system provided in the building/ premises were test checked at random and found functional at the time of inspection. Keeping in view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules, the FSC issued vide letter No. F.6/DFS/MS/EH/2015/SZ/779 Dated 15/05/2015, renewal under rule 37 of the Delhi Fire Service Rules 2010, is recommended.

Accordingly DFA is put up for approval and signature please.


 Signature of the Inspecting Officer
 Name: Mehmood
 Design: ADO (SJ)


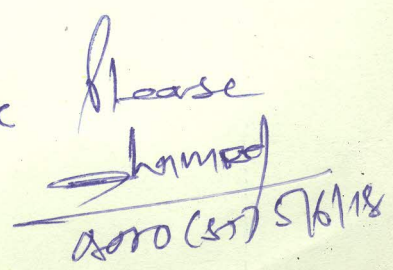
M/s Mainland China Restt at plot No-4, LSC, Masjid Moth GK-II, New Delhi

DO (SD)

Pl speak on Rule 35(6)
 spoken, made correction in inspection
 note - be submitted
 23/5/18
 23/5/18
 Dy. CP (SZ)



14CS/CP/SZ
326

 23/5
 FT/M.
 M. scell
 31/5.
 Chro syh
 A. G. I. bus- up for signature please
 31/5/18
 Chro (SZ)
 M. scell
 31/5/18