

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI-110001

Fax No. 011-23412593, Ph. 011-23412225


No. F.6/DFS/MS/EH/2018/SZ/ 1296

Dated: 04/06/18

FIRE SAFETY CERTIFICATE

Certified that **McDonald's Family Restaurant** located at Shop No-2 & 3, Ground floor of Eros Cinema Building, Jangpura Extn, New Delhi-110014 comprised of two tiers basement, Ground plus two upper floors. The restaurant running at ground floor was issued Fire Safety Certificate by this department vide letter No. F6/DFS/MS/EH/2015/SZ/803 dated 19-05-2015. The premises was re-inspected by officer concerned of this department on 04/05/2018 in the presence of Sh. Riyaz Alam (Manager) and found that the said premises have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of Delhi Fire Service Rules, 2010 and that building is fit for occupancy class "**Assembly, Group-A**" (Eating House) as above with effect from the date of issue of this certificate for period of **Three years** in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued 04/06/18 at New Delhi by


(Vipin Kental)
Chief Fire Officer


Copy to: -

1. Auth. Signatory M/s McDonald's Family Restaurant, Shop No- 2&3, GF of Eros Cinema Building, Jangpura Extn, New Delhi-110014
2. The Addl. Comm. of Police (Lic.), First Floor, P.S. Defense Colony, New Delhi-110049

Conditions for the validity of Fire Safety Certificate:

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life property due to non- functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire fighting system.
4. The owner/occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL- 2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry.


INSPECTION REPORT				
1	Name & Address of the Building	M/s McDonald's Family Restt, Eros Cinema Bldg, Shop No-2 & 3, GF, Jangpura Extn, New Delhi-14		
2	Type of Occupancy	Assembly, "Group-D" (Eating House)		
3	Building Comprised of	02 Basements, Ground + 02 upper floors.		
4	Type of Case	Renewal		
5	Details of Previous NOC	F.6/DFS/MS/EH/2015/SZ/803 Dated 19-05-2015		
6	Fire Safety Directives Letter No	N/A		
7	Date of Inspection	04-05-2018		
8	Name of the Inspecting Officers	Mehmood, ADO (SJ)		
9	Name & Designation of Officers from the building side	Sh. Riyaz Alam (Manager)		
10	Year of construction	2011	Restt running at ground floor of the building.	
11	Applicant letter No.	NIL dated 09-04-2018		
S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC requirements	Provided at Site	Remarks MR/NMR
1	Access to Building.	F6/DFS/MS/Mixed/2017/SZ/1388 dated 19-09-2017		
	<ul style="list-style-type: none"> Road width Gate width Width of internal road 	Restt located in Eros Cinema Building	As above As above As above	MR -NA- -NA-
2	Number, width, type & arrangement of exits.			
	a) Number of Staircase	Provided & Maintained By Building Management		
	➤ Upper floors.	-NA-	Restt. at GF	-NA-
	➤ Basement floor.	-NA-	-NA-	-NA-
	b) Width of Staircase	Provided & Maintained By Building Management		
	➤ Upper floors	-NA-	-NA-	-NA-
	➤ Basement floor	-NA-	-NA-	-NA-
	c) Protection of exits	Provided & Maintained By Building Management		
	➤ Fire check door	-NA-	As above	-NA-
	➤ Pressurization	-NA-	As above	-NA-
	d) No. of continuous staircase to terrace	-NA-	As above	-NA-
	e) Width of corridor	-NA-	As above	-NA-
	f) Door size	2.0 mtr	2.30m & 1.45m	MR
3	Compartmentation.	Provided & Maintained By Building Management		
	<ul style="list-style-type: none"> Fire check door. Sealing of electrical shafts. Fire rating of shaft door. Water curtain Fire dampers. 	-NA- -NA- -NA- -NA- -NA-	As above As above As above As above As above	-NA- -NA- -NA- -NA- -NA-
4.	Smoke Management system.	Provided & Maintained By Building Management		
	<ul style="list-style-type: none"> Basement Upper floors 	30 ACPH 12 ACPH	As above Venting provided in kitchen	-NA- MR
5.	Fire Extinguishers.			
	<ul style="list-style-type: none"> Total numbers Types ISI Marking 	06 Nos ABC / CO2 ISI marked	Provided ABC & CO2 Provided	MR MR MR
6.	First Aid Hose Reels.	Provided & Maintained By Building Management		
	<ul style="list-style-type: none"> Total numbers on each floor. Length of hose-reel hose. Nozzle Diameter 	One 30 mtr 5 mm	Provided near Restt Provided Provided	MR MR MR

7	Automatic fire detection & alarming system.	Provided & Maintained By Building Management		
	• Type of detectors	Required	Heat & Smoke	MR
	• Location of Main Panel	Required	Ground floor	MR
	• Location of Repeater Panel	-NA-	-NA-	-NA-
	• Alternate source of power	Required	Provided	MR
	• Hooter's location	Required	Provided	MR
8.	MOEFA	Required	Provided	MR
9.	Public Address System	-NA-	-NA-	-NA-
10.	Automatic Sprinkler System	Provided & Maintained By Building Management		
	• Basement	-NA-	As above	-NA-
	• Upper floors / Restt premises	Required	As above	MR
	• Sprinkler above false ceiling	-NA-	As above	-NA-
11.	Internal Hydrants.	Provided & Maintained By Building Management		
	• Size of Riser/Down-comer	-NA-	As above	-NA-
	• Number of Hydrant per floor	-NA-	As above	-NA-
	• Hose box.	-NA-	As above	-NA-
12.	Yard Hydrants.	Provided & Maintained By Building Management		
	• Total number of hydrants.	-NA-	As above	-NA-
	• Hose box.	-NA-	As above	-NA-
13.	Pumping arrangements.			
	• Ground Level	Provided & Maintained By Building Management		
	➤ Discharge of main pump.	-NA-	2280 LPM	-NA-
	➤ Head of main pump.	-NA-	60m	-NA-
	➤ Number of main pumps.	-NA-	Two	-NA-
	➤ Jockey Pump output.	-NA-	180 LPM	-NA-
	➤ Jockey Pump head.	-NA-	60m	-NA-
	➤ Standby Pump output.	-NA-	2280 LPM	-NA-
	➤ Standby Pump head.	-NA-	60m	-NA-
	➤ Auto Starting / Manual Stopping.	-NA-	Provided	-NA-
	➤ Pump house access.	-NA-	Provided	-NA-
	• Terrace Level	Provided & Maintained By Building Management		
	➤ Discharge of pump.	Required	950 LPM	MR
	➤ Head of pump.	Required	45m	MR
	➤ Power supply.	Required	Provided	MR
	➤ Auto starting of pump.	Required	Provided	MR
14.	Captive water storage for fire fighting.	Provided & Maintained By Building Management		
	• Underground tank capacity.	-NA-	2,00,000 Ltr.	-NA-
	➤ Draw-off connection.	-NA-	Provided	-NA-
	➤ Fire Service Inlet.	-NA-	Provided	-NA-
	➤ Access to tank.	-NA-	Provided	-NA-
	• Overhead tank capacity.	Required	40,000 Ltr	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			
	• Pressurization of lift shaft.	-NA-	As above	-NA-
	• Pressurization of lift lobby.	-NA-	As above	-NA-
	• Communication in lift car.	-NA-	As above	-NA-
	• Fireman's switch.	-NA-	As above	-NA-
	• Lift signage.	-NA-	As above	-NA-
17.	Standby Power Supply	Required	Provided	MR
18.	Refuge Area			
	• Total area	-NA-	-NA-	-NA-
	• Location	-NA-	-NA-	-NA-

19.	Fire Control Room.	Provided & Maintained By Building Management		
	<ul style="list-style-type: none"> • Detector system panel. • Flow switch panel. • PA system panel. • Battery backup. • Building floor plan. 	-NA-	As above	-NA-
		-NA-	As above	-NA-
		-NA-	As above	-NA-
		-NA-	As above	-NA-
		-NA-	As above	-NA-
20.	Special Fire Protection System for the Protection of special Risk, if any.	-NA-	As above	-NA-


The fire protection system provided in the building/ premises were tested, checked at random and found functional at the time of inspection. Keeping in view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules, the FSC issued vide letter No. F6/MS/DFS/EH/2015SZ/803 dated 19/05/2015, renewal under rule 37 of the Delhi Fire Service Rules 2010, is recommended.


Accordingly DFA is put up for approval and signature please.


 Signature of the Inspecting Officer
 Name: Mehmoed
 Design: ADO (SJ)

M/s McDonald's Family Restt, Eros Cinema Bldg, Shop No-2 & 3, GF, Jangpura Extn, New Delhi

DO (SD)

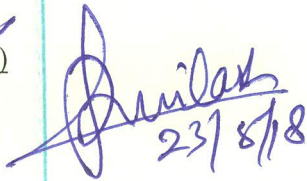
23/5/18






24/5




m-sell 97M.

25/5

A. P.T. letter is put up for signature please

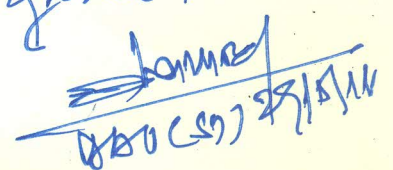



m-sell 31/5

