

FORM 'H'
FORM FOR ISSUING FIRE SAFETY CERTIFICATE
[Refer sub.- rule (1) of rule 35]
GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE, NEW DELHI


No. F6/DFS/MS/EH/2018/ W2/1213

Dated: 24/05/2018

FIRE SAFETY CERTIFICATE

Certified that the **Green Lounge North Banquet (A unit of Nagpal Hospitality Pvt. Ltd)** Located at **Ground & 1st Floor, C-93, Wazir pur Industrial Area, Delhi -110035** in a building comprised of **Basement + Ground + Mez + One Upper Floors** owned/occupied by **Green Lounge North Banquet** was issued FSC vide Letter No. F6/DFS/MS/2015/WZ/659 Dated-01/05/15 and the premises was re inspected by the officers concerned of this department on **04-05-2018** in the presence of Sh. Jagdish Nagpal (Owner) and found that the said building have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rule, 2010 and that the premises is fit for occupancy class "Assembly" Group D (**Ground & 1st Floor Except Basement**) with effect from 24/5/18 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on ...24/5/18..... at New Delhi by.


(Atul Garg)
Chief Fire Officer,
Delhi Fire Service.
0/6/2018
& 1st

Copy to:-

1. The Director, Green Lounge North Banquet (A unit of Nagpal Hospitality Pvt. Ltd), Ground & 1st Floor, C-93, Wazir Pur Industrial Area, Delhi -110035
2. The DHO, SDMC, Public Health Department, West Zone, Vishal Enclave, Rajori Garden, N. Delhi-110027.

Following fire safety directives must be adhered to:-

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
3. The trained staff should be available round the clock.
4. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
5. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
6. Basement shall not be used for any purpose.
7. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.
8. The owner/ occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expired.

INSPECTION REPORT

1. Name & address of the building: Green Lounge North Banquet (A unit of Nagpal Hospitality pvt. ltd)at Ground & 1st Floor,C-93,Wazir pur Industry Area, Delhi -110035
2. Type of Occupancy : Assembly (G. Floor +1st Floor)
3. Type of Case :Renewal
4. Details of previous NOC : F6/DFS/MS/2015/WZ/659Dated-01/05/15
5. Fire Safety directives Letter No. : F F-6/DFS/MS/BP/2014/13 Dated 17/01/2014(For Industry)Occupancy change in assembly
6. Date of inspection : 04-05-2018
7. Name of the Inspecting Officer : DO/W & ADO (WP)
8. Name and designation of Officer
from the building side : Sh. Jadish Nagpal (owner)
9. Year of Construction : 2008
10. Applicant's letter No. : Nil Dated-02/04/2018

Plot Area = 1923m²
 Covered Area
 Basement=317m²(storage)
 Ground=907 m² (Banquet)
 Mez. Floor=201 m²(Offices)
 1st Floor=880 M²(Banquet)

S No	Minimum standards on fire prevention and fire safety U/R 33	BBL Requirements	Provided at site	Remarks MR/NMR
1.	Access of building			
	• Road width	12 m	Provided on Road	MR
	• Gate width	5 m	Provided	MR
	• Width of internal road	NA	NA	NA
2.	Number, width, Type & Arrangements of exits			
	a. Number of staircases			
	• Upper floors	2	03 Provided	MR
	• Basements	NA	02 Provided	NA
	b. Width of staircases			
	• Upper floors	2 mtr & 2mtr	1x200cm, 1x205cm & 1x1.82 to 192 cm	MR
	• Basements	NA	1x142cm & 1x132cm One stair found blocked	NA
	c. Protection of exits			
	• Fire check door	Required	Provided	MR
	• Pressurization	NA	NA	NA
	d. No of continuous staircase to terrace	2	Provided	MR
	e. Width Of Corridor	NA	NA	NA
	f. Door Size	2x200cm	GF=2x245cm & 1x186cm FF=2x200cm	MR

3.	Compartmentation			
	• Fire check door	Required	Provided	MR
	• Sealing of electrical shafts	NA	NA	NA
	• Fire Rating of shaft door	NA	NA	NA
	• Water Curtain	NA	NA	NA
	• Fire Dampers	NA	NA	NA
4.	Smoke managements System		Basement use by cenesale as store	
	• Basements	Required	Provided	NA
	• Upper floors	Required	Provided	MR
5.	Fire Extinguishers			
	• Total numbers	15 nos.	Provided	MR
	• Types	ABC & CO2	Provided	MR
	• IS marking	ISI marked	Provided	MR
6.	First – Aid Hose Reels			
	• Total numbers on each floor	Required	Provided	MR
		30 m	Provided	MR
	• Length of hose reel hose	5 mm	Provided	MR
	• Nozzle diameter			
7.	Automatic fire detection and alarming system			
	• Type of detectors	Smoke	Provided	MR
	• Location of Main Panel	Required	Provided	MR
	• Location of Repeater Panel	Required	Provided	MR
	• Alternate source of power	Required	Provided	MR
	• Hooters' Location	NA	NA	NA
8.	MOEFA	Required	Provided	MR
9.	Public Address System	Required	Provided	MR
10.	Automatic Sprinkler System			
	• Basements	Required	Provided	MR
	• Upper Floor	Required	Provided	MR
	• Sprinkler above false ceiling	NA	NA	NA
11.	Internal Hydrants			
	• Size of riser/down-comer	100 mm	Provided	MR
		1	Provided	MR
	• Number of hydrants per floor	2	Provided	MR
	• Hose Box			
12.	Yard Hydrants			
	• Total number of hydrants	4	Provided	MR
	• Hose Box	4	Provided	MR


13.	Pumping Arrangements	All the pumps are connected with DG set		
	<ul style="list-style-type: none"> • Ground Level • Discharge of main pump ➤ Head of main pump ➤ Number of main pumps ➤ Jockey pump out put ➤ Jockey pump head ➤ Standby Pump out put ➤ Standby Pump Head ➤ Auto Staring/Manual stopping ➤ Pump House Access • Terrace level ➤ Discharge of pump ➤ Head of the pump ➤ Power supply ➤ Auto starting of pump 	2280 lpm	Provided	MR
		60m	Provided	MR
		1	Provided	MR
		180lpm	Provided	MR
		60m	Provided	MR
		2280lpm	Provided	MR
		60m	Provided	MR
		Required	Provided	MR
		Required	Provided	MR
		900 lpm	Provided	MR
		40 m	Provided	MR
		Required	Provided	MR
		Required	Provided	MR
14.	Captive water Storage for fire fighting			
	<ul style="list-style-type: none"> • Under ground tank capacity ➤ Draw of connection ➤ Fire service inlet ➤ Access to tank • Overhead Tank capacity 	50000ltrs	provided	MR
		Required	Provided	MR
		Required	Provided	MR
		Required	Provided	MR
		10,000 ltrs	Provided	MR
15	Exit Signage	Required	Provided	MR
16.	Provision of Lifts			
	<ul style="list-style-type: none"> ➤ Pressurization of Lift Shaft ➤ Pressurization of lift lobby ➤ Communication in lift Car ➤ Fireman's Grounding Switch ➤ Lift Signage 	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
17.	Standby power supply	Required	Provided	MR
18.	Refuge Area	NA	NA	
	<ul style="list-style-type: none"> ➤ Total area ➤ Location 	NA	NA	NA
		NA	NA	NA
19.	Fire control room			
	<ul style="list-style-type: none"> ➤ Detector system panel ➤ Flow Switch Panel ➤ PA System Panel ➤ Battery backup 	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA


	➤ Building Floor Plans			
20.	Special Fire Protection Systems for Protection of special Risks, if any;	NA	NA	NA



Note.- Mezzanine Floor is located in between G. Floor and 1st floor and segregated from both floor.



The fire protection systems provided in the building were test checked and found functional at the time of inspection.

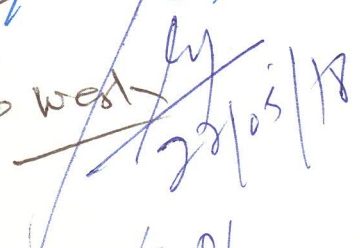
In view of the deemed compliance of minimum standards on fire prevention and fire safety as required under the rules the NOC issued vide letter no. F6/DFS/MS/2015/WZ/659 Dated-01/05/15 renewal under rule 35 of the Delhi Fire Service Rules 2010 is recommended.

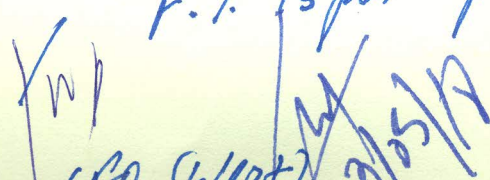
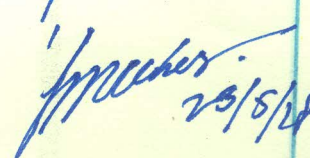

 Signature of the Inspecting Officer
 Name Uday Vir Singh
 Designation ADO/WP


 Signature of the Inspecting Officer
 Name Sh. Mohesh Verma
 Designation D.O/W

~~Dy. CPO (W2)~~ Speak Reg. AFA & Basement -
 D.O/West
 17/5/18
 16/5/18

AD O/WP
 Sir, the basement is not to be used for any purpose. Recommended for hangout on Ground and first floor only.
 21/5/18
 21/5/18

~~Dy. CPO (W2)~~
 CPO West
 22/05/18

AD O/WP
 F.T. is put up for signature please.
 23/5/18
 23/5/18