

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI**  
**HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE**  
**NEW DELHI- 110001**

Fax No. 011-23412593, Ph. 011-23412225

No. F.6/DFS/MS/Petrol/2018/SZ/ 1102

Dated: 16/5/18

**FIRE SAFETY CERTIFICATE**

Certified that M/s **Global Petro** (IOCL Retail Outlet) at Ring Road, (Opp. Bhikaji Cama Place & Hyatt Regency), R.K. Puram, New Delhi-110066, comprised of Ground floor only have complied with fire prevention and fire safety requirements in accordance with rule 33 of Delhi Fire Service Rules, 2010 and verified by officer concerned of this department on 26.04.2018 in the presence of Mr. Dinesh Singh (Manager) and that the premises is fit for occupancy class 'Hazardous, Group-J' (Filling Station & CNG Facility) as above with effect from date of issue of this certificate for a period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 16/5/18 at New Delhi by

  
(Vipin Kental)  
Chief Fire Officer  


Copy to: -

1. The Medical Officer (Health), N.D.M.C, Palika Kendra, New Delhi- 110001
2. M/s Global Petro (Opp. Bhikaji Cama Place & Hyatt Regency), R.K. Puram, New Delhi-66

**Conditions for the validity of Fire Safety Certificate**

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of firefighting system.
4. The owner/ occupier shall submit a declaration every year in Form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in)
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL-2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry.



INSPECTION REPORT				
1	Name & Address of the Building	M/s Global Petro (IOCL Retail Outlet & CNG Facility), Opp. BCP & Hyatt Regency, Ring Road, R.K. Puram, ND		
2	Type of Occupancy	Hazardous, 'Group-J' (Filling Station & CNG Station)		
3	Building Comprised of	Ground floor only.		
4	Type of Case	New		
5	Details of Previous NOC	Nil		
6	Fire Safety Directives Letter No	F.5 (3A)/DFS/BP/2009/04 Dated 06/01/2009		
7	Date of Inspection	26-04-2018		
8	Name of the Inspecting Officers	R.N. Singh, ADO (BCP)		
9	Name & Designation of Officers from the building side	Mr. Dinesh Singh (Manager)		
10	Year of Construction	2009		
11	Applicant letter No.	Nil dated 16-04-2018, ODD No. 6325 Dt. 19.04.2018		
S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	NBC / BBL requirements	Provided at Site	Remarks MR/NMR
1	<b>Access to Building.</b>			
	• Road width	9 mtr	12 mtr	MR
	• Gate width	N/A	N/A	N/A
	• Width of internal road	N/A	N/A	N/A
2	<b>Number, width, type &amp; arrangement of exits.</b>			
	<b>a. Number of Staircase</b>			
	➤ Upper floors.	N/A	N/A	N/A
	➤ Basement.	N/A	N/A	N/A
	<b>b. Width of Staircase</b>			
	➤ Upper floors	N/A	N/A	N/A
	➤ Basement	N/A	N/A	N/A
	<b>c. Protection of exits</b>			
	➤ Fire check door	N/A	N/A	N/A
	➤ Pressurization	N/A	N/A	N/A
	<b>d. No. of continuous staircase to terrace</b>	N/A	N/A	N/A
	<b>e. Width of corridor</b>	N/A	N/A	N/A
	<b>f. Door size</b>	N/A	N/A	N/A
3	<b>Compartmentation.</b>			
	• Fire check door.	N/A	N/A	N/A
	• Sealing of electrical shafts.	N/A	N/A	N/A
	• Fire rating of shaft door.	N/A	N/A	N/A
	• Water curtain	N/A	N/A	N/A
	• Fire dampers.	N/A	N/A	N/A
4.	<b>Smoke Management system.</b>			
	• Basement	N/A	N/A	N/A
	• Upper floors	N/A	N/A	N/A
5.	<b>Fire Extinguishers.</b>			
	• Total numbers	20 No's	24 No's	MR
	• Types	ABC, CO2, DCP	CO2, DCP & ABC	MR
	• ISI Marking	ISI Marked	Provided	MR
6.	<b>First Aid Hose Reels.</b>			
	• Total numbers on each floor.	One	Provided	MR
	• Length of hose-reel hose.	36 mtr	Provided	MR
	• Nozzle Diameter	5 mm	Provided	MR


M/s Global Petro, Opp. Hyatt Regency Hotel, Ring Road, RK Puram, New Delhi









N//

19.	<b>Fire Control Room.</b>			
	• Detector system panel.	N/A	N/A	N/A
	• Flow switch panel.	N/A	N/A	N/A
	• PA system panel.	N/A	N/A	N/A
	• Battery backup.	N/A	N/A	N/A
	• Building floor plan.	N/A	N/A	N/A
20.	<b>Special Fire Protection System for the Protection of special Risk, if any.</b>	Required	1. Provided Co2 flooding system in CNG compressor unit. 2. Provided fire buckets of dry loose sand with stand.	MR
<p>The fire protection systems provided in the retail outlet area were test checked at random and found functional at the time of inspection. Keeping in view the substantial satisfactory compliance of the minimum standards on fire prevention and fire safety measures as required under the rules, it is recommended to issue Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules, 2010.</p> <p>Accordingly DFA is put up for approval and signature please.</p> <p style="text-align: right;">   Signature of the Inspecting Officer  Name: R.N. Singh  Designation: ADO (BCP) </p>				


M/s Global Petro, Opp. Hyatt Regency Hotel, Ring Road, RK Puram, New Delhi

DO (SD)

  
3/5/18


  
4/5/18

1359/CR-2  
8/5/18/5

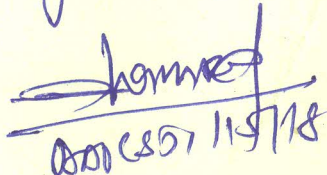
  
4/5


CR-2/18

m.s.c.u


  
7/5

A Q.R. letter is put for signature please

  
8/5/18

  
4/5/18

m.s.c.u

  
7/5

