

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE  
NEW DELHI-110001


No. F.6/DFS/MS/School/2018/SZ/ 1791

Dated: 1/8/18

FIRE SAFETY CERTIFICATE

Certified that G.D. Goenka Public School (Junior) located at Plot No-5 & 6, Sector-B, Pocket-8, Vasant Kunj, New Delhi-110070, comprised of basement (storage only), ground plus one upper floor, have complied with the fire prevention and fire safety requirements in accordance with Director of Education circular No. F.16//Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011 issued by Directorate of Education, Govt. of NCT of Delhi and verified by officer concern of this department on 18/07/2018 in the presence of Mr. John (Admin Officer) of the school and that the school building is fit for occupancy class "Educational, Group-B" (School) as above with effect from the date of issue of this certificate for period of **Three years** in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010

Issued 1/8/18 at New Delhi by

  
(Vipin Kental)  
Chief Fire Officer  
Ph: 011-23412225  
qe

Copy to: -

1. Sh. Rajeev Sharma (Administrative), G.D. Goenka Public School (Junior), Plot No-5 & 6, Sector-B, Pocket-8, Vasant Kunj, New Delhi-110070
2. Directorate of Education, South MCD, Civic Centre, Minto Road, New Delhi-110002

Conditions for the validity of Fire Safety Certificate:

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire fighting system.
4. The owner/occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in)
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL- 2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry.


INSPECTION REPORT				
1	Name & Address of the Building	G.D. Goenka Public School (Junior), Plot No-5 & 6, Sector-B, Pocket-8, Vasant Kunj, New Delhi-110070		
2	Type of Occupancy	Educational, Group-B (School)		
3	Building Comprised of	Basement (storage only), Ground + 01 upper floor.		
4	Type of Case	New		
5	Details of Previous NOC	Nil		
6	Fire Safety Directives Letter No	F.16//Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011		
7	Date of Inspection	18-07-2018		
8	Name of the Inspecting Officers	Mehmood, ADO (SJ)		
9	Name & Designation of Officers from the building side	Mr. John (Admin Officer)		
10	Year of construction	2003		
11	Applicant letter No.	Outdoor Diary No. 9070 dated 21-06-2018		
S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	DOE circular requirements	Provided at Site	Remarks MR/NMR
1	<b>Access to Building.</b>			
	• Road width	Accessible	09 mtr	MR
	• Gate width	-NA-	-NA-	-NA-
	• Width of internal road	-NA-	-NA-	-NA-
2	<b>Number, width, type &amp; arrangement of exits.</b>			
	<b>a) Number of Staircase</b>			
	➤ Upper floors.	02 No	Provided	MR
	➤ Basement floor.	02 No	Provided	MR
	<b>b) Width of Staircase</b>			
	➤ Upper floors	1.5m / 0.75m	1.5m each	MR
	➤ Basement floor	1.5m / 0.75m	1.5m each	MR
	<b>c) Protection of exits</b>			
	➤ Fire check door	-NA-	-NA-	-NA-
	➤ Pressurization	-NA-	-NA-	-NA-
	<b>d) No. of continuous staircase to terrace</b>	One	Provided	MR
	<b>e) Width of corridor</b>	-NA-	-NA-	MR
	<b>f) Door size</b>	1m	Provided	MR
3	<b>Compartmentation.</b>			
	• Fire check door.	-NA-	-NA-	-NA-
	• Sealing of electrical shafts.	-NA-	-NA-	-NA-
	• Fire rating of shaft door.	-NA-	-NA-	-NA-
	• Water curtain	-NA-	-NA-	-NA-
	• Fire dampers.	-NA-	-NA-	-NA-
4.	<b>Smoke Management system.</b>			
	• Basement	30 ACPH	Exhaust fan provided	MR
	• Upper floors	12 ACPH	Natural ventilation	MR
5.	<b>Fire Extinguishers.</b>			
	• Total numbers	7 Nos	03+03+20=26 Nos	MR
	• Types	ABC / CO2	ABC (5 kg-3, 2kg-20) & Co2-03	MR
	• ISI Marking	ISI mark	Provided	MR
6.	<b>First Aid Hose Reels.</b>			
	• Total numbers on each floor.	-NA-	03 Nos	-NA-
	• Length of hose-reel hose.	-NA-	30m	-NA-
	• Nozzle Diameter	-NA-	5mm	-NA-

7	<b>Automatic fire detection &amp; alarming system.</b>			
	• Type of detectors	-NA-	-NA-	-NA-
	• Location of Main Panel	-NA-	-NA-	-NA-
	• Location of Repeater Panel	-NA-	-NA-	-NA-
	• Alternate source of power	-NA-	-NA-	-NA-
	• Hooter's location	-NA-	-NA-	-NA-
8.	<b>MOEFA</b>	-NA-	Provided	-NA-
9.	<b>Public Address System</b>	-NA-	-NA-	-NA-
10.	<b>Automatic Sprinkler System</b>			
	• Basement	Required	Provided	MR
	• Upper floors	-NA-	-NA-	-NA-
	• Sprinkler above false ceiling	-NA-	-NA-	-NA-
11.	<b>Internal Hydrants.</b>			
	• Size of Riser/Down-comer	-NA-	100 mm	-NA-
	• Number of Hydrant per floor	-NA-	03 Nos	-NA-
	• Hose box.	-NA-	03 Nos	-NA-
12.	<b>Yard Hydrants.</b>			
	• Total number of hydrants.	-NA-	-NA-	-NA-
	• Hose box.	-NA-	-NA-	-NA-
13.	<b>Pumping arrangements.</b>			
	• <b>Ground Level</b>			
	➤ Discharge of main pump.	-NA-	-NA-	-NA-
	➤ Head of main pump.	-NA-	-NA-	-NA-
	➤ Number of main pumps.	-NA-	-NA-	-NA-
	➤ Jockey Pump output.	-NA-	-NA-	-NA-
	➤ Jockey Pump head.	-NA-	-NA-	-NA-
	➤ Standby Pump output.	-NA-	-NA-	-NA-
	➤ Standby Pump head.	-NA-	-NA-	-NA-
	➤ Auto Starting/Manual Stopping.	-NA-	-NA-	-NA-
	➤ Pump house access.	-NA-	-NA-	-NA-
	• <b>Terrace Level</b>			
	➤ Discharge of pump.	450 LPM	900 LPM	MR
	➤ Head of pump.	40m	40m	MR
	➤ Power supply.	Required	Provided	MR
	➤ Auto starting of pump.	Required	Provided	MR
14.	<b>Captive water storage for fire fighting.</b>			
	• Underground tank capacity.	-NA-	1,00,000 Ltr	-NA-
	➤ Draw-off connection.	-NA-	-NA-	-NA-
	➤ Fire Service Inlet.	-NA-	-NA-	-NA-
	➤ Access to tank.	-NA-	-NA-	-NA-
	• Overhead tank capacity.	-NA-	-NA-	-NA-
15.	<b>Exit Signage.</b>	5,000 Ltr	25,000 Ltr	MR
16.	<b>Provision of Lifts.</b>			
	• Pressurization of lift shaft.	-NA-	-NA-	-NA-
	• Pressurization of lift lobby.	-NA-	-NA-	-NA-
	• Communication in lift car.	-NA-	-NA-	-NA-
	• Fireman's switch.	-NA-	-NA-	-NA-
	• Lift signage.	-NA-	-NA-	-NA-
17.	<b>Standby Power Supply</b>	-NA-	-NA-	-NA-
18.	<b>Refuge Area</b>			
	• Total area	-NA-	-NA-	-NA-
	• Location	-NA-	-NA-	-NA-

19.	<b>Fire Control Room.</b>			
	• Detector system panel.	-NA-	-NA-	-NA-
	• Flow switch panel.	-NA-	-NA-	-NA-
	• PA system panel.	-NA-	-NA-	-NA-
	• Battery backup.	-NA-	-NA-	-NA-
	• Building floor plan.	-NA-	-NA-	-NA-
20.	<b>Special Fire Protection System for the Protection of special Risk, if any.</b>	-NA-	-NA-	-NA-


The Fire protection systems provided in the building /premises were checked/ operated at random and found functional at the time of inspection. Keeping in view the substantial satisfactory compliance of the minimum standards on fire prevention and fire safety measures as required under Directorate of Education circular dated 01/03/2011, it is recommended to issue Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules, 2010

Accordingly DFA is put up for approval and signature please.

  
 Signature of the Inspecting Officer  
 Name: Mehmood  
 Design: ADO (SJ)

G.D. Goenka Public School, Plot No-5 & 6, Sector-B, Pocket-8, Vasant Kunj, New Delhi-110070

DO (SD)

  
26/7/18


  
26/7/18

  
27/7


CFU SFI

M.SCELL


FT/18

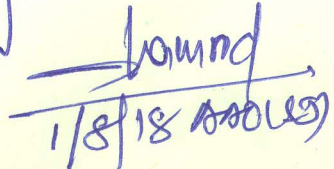
  
31/7

A. B.T. letter put up for signature please

  
1/8/18

M.SCELL

  
1/8

  
1/8/18



1674/cf02  
1/8/18