

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI-110001

No. F.6/DFS/MS/School/2018/SZ/ 1816

Dated: 03/08/18

FIRE SAFETY CERTIFICATE

Certified that Lareesa Public School located at 266E/9, Ward No-2, Mehrauli, New Delhi-110030 comprised of Ground plus one upper floor was issued NOC by this department vide letter No. F.6/DFS/MS/09/722 dated 16-03-2009. The premises was re-inspected by officer concerned of this department on 18.07.2018 in the presence of Sh. Satyanarain (Manager) of the school and found that the premises have deemed complied with the fire prevention and fire safety requirements in accordance with Circular No 262-362 dated 17/01/2005 issued by Education Directorate, Govt. of NCT of Delhi. Old Secretariat, New Delhi and that building is fit for occupancy class **Educational Building, Group-B** as above with effect from the date of issue of this certificate for period of **three years** subject to compliance of the conditions as mentioned below.

Issued 03/08/18 at New Delhi by


(Vipin Kental)
Chief Fire Officer
Ph: 011-23412225


Copy to: -

1. Manager, Lareesa Public School, 266E/9, Ward No-2, Mehrauli, New Delhi-110030
2. Directorate of Education, South MCD, Civic Centre, Minto Road, New Delhi-110002

Conditions for the validity of Fire Safety Certificate:

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life property due to non- functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire fighting system.
4. The owner/occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL- 2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry.

INSPECTION REPORT

1	Name & Address of the Building	Lareesa Public School, 266E/9, Ward No.2, Mehrauli, New Delhi-110030		
2	Type of Occupancy	Educational Building (School)		
3	Building Comprised of	Ground plus one upper floor.		
4	Type of Case	Renewal		
5	Details of Previous NOC	F.6/DFS/MS/09/722 dated 16-03-2009		
6	Fire Safety Directives Letter No	DOE Circular No262-362 dated 17/01/2005		
7	Date of Inspection	18-07-2018		
8	Name of the Inspecting Officers	Mehmood ADO (SJ)		
9	Name & Designation of Officers from the building side	Mr. Satyanarain (Manager)		
10	Year of construction	2009		
11	Applicant letter No.	Nil Dated 31/05/18		
S. No	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC requirements	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	<ul style="list-style-type: none"> Road width 	Accessible	5 mtr	MR (old case)
	<ul style="list-style-type: none"> Gate width 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> Width of internal road 	-N/A-	-N/A-	-N/A-
2	Number, width, type & arrangement of exits.			
	a) Number of Staircase			
	➤ Upper floors	Required	Two	MR
	➤ Basement floor	-N/A-	-N/A-	-N/A-
	b) Width of Staircase			
	➤ Upper floors.	1.50m	1.20 m, 1.33m	MR
	➤ Basement floor	-N/A-	-N/A-	-N/A-
	c) Protection of exits			
	➤ Fire check door	-N/A-	-N/A-	-N/A-
	➤ Pressurization	-N/A-	-N/A-	-N/A-
	d) No. of continuous staircase to terrace	01 No	Provided	MR
	e) Width of corridor	1.5m	Provided	MR
	f) Door size	1 mtr	Provided	MR
3	Compartmentation.			
	<ul style="list-style-type: none"> Fire check door. 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> Sealing of electrical shafts. 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> Fire rating of shaft door. 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> Water curtain 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> Fire dampers. 	-N/A-	-N/A-	-N/A-
4.	Smoke Management system.			
	<ul style="list-style-type: none"> Basement 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> Upper floors 	-N/A-	-N/A-	-N/A-
5.	Fire Extinguishers.			
	<ul style="list-style-type: none"> Total numbers 	04 No's	05 No's	MR
	<ul style="list-style-type: none"> Types 	ABC / Co2	ABC- 04,C02-01	MR
	<ul style="list-style-type: none"> ISI Marking 	ISI Marked	Provided	MR
6.	First Aid Hose Reels.			
	<ul style="list-style-type: none"> Total numbers on each floor. 	01 no	One no provided	MR
	<ul style="list-style-type: none"> Length of hose-reel hose. 	30m	Provided	MR
	<ul style="list-style-type: none"> Nozzle Diameter 	5mm	Provided	MR

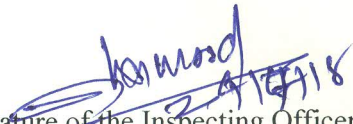
7	Automatic fire detection & alarming system.			
	• Type of detectors	-N/A-	-N/A-	-N/A-
	• Location of Main Panel	-N/A-	-N/A-	-N/A-
	• Location of Repeater Panel	-N/A-	-N/A-	-N/A-
	• Alternate source of power	-N/A-	-N/A-	-N/A-
	• Hooter's location	-N/A-	-N/A-	-N/A-
8.	MOEFA	-N/A-	-N/A-	-N/A-
9.	Public Address System	-N/A-	-N/A-	-N/A-
10.	Automatic Sprinkler System			
	• Basement.	-N/A-	-N/A-	-N/A-
	• Upper floors	-N/A-	-N/A-	-N/A-
	• Sprinkler above false ceiling	-N/A-	-N/A-	-N/A-
11.	Internal Hydrants.			
	• Size of Riser / Down-comer	-N/A-	-N/A-	-N/A-
	• Number of Hydrant per floor	-N/A-	-N/A-	-N/A-
	• Hose box.	-N/A-	-N/A-	-N/A-
12.	Yard Hydrants.			
	• Total number of hydrants.	-N/A-	-N/A-	-N/A-
	• Hose box.	-N/A-	-N/A-	-N/A-
13.	Pumping arrangements.			
	• Ground Level			
	➤ Discharge of main pump.	-N/A-	-N/A-	-N/A-
	➤ Head of main pump.	-N/A-	-N/A-	-N/A-
	➤ Number of main pumps.	-N/A-	-N/A-	-N/A-
	➤ Jockey Pump output.	-N/A-	-N/A-	-N/A-
	➤ Jockey Pump head.	-N/A-	-N/A-	-N/A-
	➤ Standby Pump output.	-N/A-	-N/A-	-N/A-
	➤ Standby Pump head.	-N/A-	-N/A-	-N/A-
	➤ Auto Starting/Manual stopping.	-N/A-	-N/A-	-N/A-
	➤ Pump house access.	-N/A-	-N/A-	-N/A-
	• Terrace Level			
	➤ Discharge of pump.	Required	225 LPM	MR
	➤ Head of pump.	40m	40m	MR
	➤ Power supply.	-N/A-	-N/A-	-N/A-
	➤ Auto starting of pump.	-N/A-	-N/A-	-N/A-
14.	Captive water storage for firefighting.			
	• Underground tank capacity.	-N/A-	-N/A-	-N/A-
	➤ Draw-off connection.	-N/A-	-N/A-	-N/A-
	➤ Fire Service Inlet.	-N/A-	-N/A-	-N/A-
	➤ Access to tank.	-N/A-	-N/A-	-N/A-
	• Overhead tank capacity.	2,500liter	Provided	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			
	• Pressurization of lift shaft.	-N/A-	-N/A-	-N/A-
	• Pressurization of lift lobby.	-N/A-	-N/A-	-N/A-
	• Communication in lift car.	-N/A-	-N/A-	-N/A-
	• Fireman's switch.	-N/A-	-N/A-	-N/A-
	• Lift signage.	-N/A-	-N/A-	-N/A-
17	Standby Power Supply	-N/A-	-N/A-	-N/A-
18.	Refuge Area			
	• Total area	-N/A-	-N/A-	-N/A-
	• Location	-N/A-	-N/A-	-N/A-


19.	Fire Control Room.			
	• Detector System Panel.	-N/A-	-N/A-	-N/A-
	• Flow Switch Panel.	-N/A-	-N/A-	-N/A-
	• PA system Panel.	-N/A-	-N/A-	-N/A-
	• Battery backup	-N/A-	-N/A-	-N/A-
	• Building floor plan	-N/A-	-N/A-	-N/A-
20.	Special Fire Protection System for the Protection of special Risk, if any.	-N/A-	-N/A-	-N/A-

The Fire protection systems provided in the building were randomly checked/ tested and found functional at the time of inspection. The shortcomings communicated vide letter dated 07/04/2017 have been complied

Keeping in view the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under the DOE circular, FSC issued vide letter No. F.6/DFS/MS/09/722 dated 16-03-2009, renewal under rule 37 of the Delhi Fire Service rules, 2010 is recommended.

Accordingly DFA is put up for approval and signature please.


 Signature of the Inspecting Officer
 Name : Mehmood
 Designation: ADO (SJ)

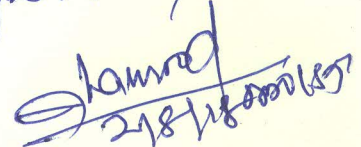
DO (SD) 
25/7/18


dy. cfo (S2)




-97



CFO(S2) m.scell  30/7.

A. S.T. letter put up for signature please

 21/8/18

1693 CFO(S2)
31/8/18

 m.scell  2/8