

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI-110001

No. F.6/DFS/MS/Petl./2018/SZ/ 1818

Dated: 03/08/18

FIRE SAFETY CERTIFICATE

Certified that M/s **Pushpanjali Filling Station** (Retail Outlet of B.P.C.L. Petroleum Class A & B) located at Nelson Mandela Marg, Vasant Kunj, New Delhi-110070, comprised of ground and first floor have complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and verified by the officer concerned of Delhi Fire Service on 07/07/2018 in the presence of Mr. Devbrat (Manager) of the filling station and found that the said premises have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of Delhi Fire Service Rules, 2010 and that premises is fit for occupancy class "**Hazardous, Group-J**" (Petrol Pump), as above with effect from the date of issue of this certificate for period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued 03/08/18 at New Delhi by


(Vipin Kental)
Chief Fire Officer
Ph: 011-23412225

Copy to: -

1. Territory Manager (Retail), B.P.C.L, Bijwasan Installation, Bijwasan, New Delhi-110061
2. M/s Pushpanjali Filling Station at Nelson Mandela Marg, Vasant Kunj, New Delhi-110070

Conditions for the validity of Fire Safety Certificate:

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire fighting system.
4. The owner/occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL- 2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry.

INSPECTION REPORT

1	Name & Address of the Building	M/s Pushpanjali Filling Station (Retail Outlet of B.P.C.L. Petroleum Class A&B), Nelson Mandela Marg, Vasant Kunj, New Delhi-110070		
2	Type of Occupancy	Hazardous, Group 'J' (Filling Station)		
3	Building Comprised of	Ground & first floor.		
4	Type of Case	New		
5	Details of Previous NOC	Nil		
6	Fire Safety Directives Letter No	F5/(34)/DFS/2003/BP/673 dated 29/10/03		
7	Date of Inspection	07-07-2018		
8	Name of the Inspecting Officers	Mehmood (ADO/SJ)		
9	Name & Designation of Officers from the building side	Mr. Devbrat (Manager)		
10	Year of construction			
11	Applicant letter No.	Outdoor Diary No. 8044 dated 29-06-2018		
S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	NBC requirements	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	<ul style="list-style-type: none"> Road width Gate width Width of internal road 	9 mtr N/A N/A	Provided N/A N/A	MR N/A N/A
2	Number, width, type & arrangement of exits.			
	a. Number of Staircase			
	<ul style="list-style-type: none"> Upper floors. Basement. 	02 Nos N/A	02 Nos N/A	MR N/A
	b. Width of Staircase			
	<ul style="list-style-type: none"> Upper floors Basement 	1.2 mtr N/A	1.2m each N/A	MR N/A
	c. Protection of exits			
	<ul style="list-style-type: none"> Fire check door Pressurization 	N/A N/A	N/A N/A	N/A N/A
	d. No. of continuous staircase to terrace	One	Provided	MR
	e. Width of corridor	N/A	N/A	N/A
	f. Door size	1m	Provided	MR
3	Compartmentation.			
	<ul style="list-style-type: none"> Fire check door. Sealing of electrical shafts. Fire rating of shaft door. Water curtain Fire dampers. 	N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A	N/A N/A N/A N/A N/A
4.	Smoke Management system.			
	<ul style="list-style-type: none"> Basement Upper floors 	N/A N/A	N/A N/A	N/A N/A
5.	Fire Extinguishers.			
	<ul style="list-style-type: none"> Total numbers Types ISI Marking 	Required CO2, ABC, DCP ISI marked	31 Nos CO2, ABC & Foam Provided	MR MR MR
6.	First Aid Hose Reels.			
	<ul style="list-style-type: none"> Total numbers on each floor. Length of hose-reel hose. Nozzle Diameter 	N/A N/A N/A	N/A N/A N/A	N/A N/A N/A

M/s Pushpanjali Filling Station, Nelson Mandela Marg, Vasant Kunj, New Delhi


7	Automatic fire detection & alarming system.			
	<ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooter's location 	N/A	N/A	N/A
8.	MOEFA	N/A	N/A	N/A
9.	Public Address System	N/A	N/A	N/A
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> Basement Upper floors Sprinkler above false ceiling 	N/A	N/A	N/A
11.	Internal Hydrants.			
	<ul style="list-style-type: none"> Size of Riser/Down-comer Number of Hydrant per floor Hose box. 	N/A	N/A	N/A
12.	Yard Hydrants.			
	<ul style="list-style-type: none"> Total number of hydrants. Hose box. 	N/A	N/A	N/A
13.	Pumping arrangements.			
	<ul style="list-style-type: none"> Ground Level <ul style="list-style-type: none"> Discharge of main pump. Head of main pump. Number of main pumps. Jockey Pump output. Jockey Pump head. Standby Pump output. Standby Pump head. Auto Starting / Manual Stopping. Pump house access. Terrace Level <ul style="list-style-type: none"> Discharge of pump. Head of pump. Power supply. Auto starting of pump. 	N/A	N/A	N/A
14.	Captive water storage for Fire Fighting.			
	<ul style="list-style-type: none"> Underground tank capacity. Draw-off connection. Fire Service Inlet. Access to tank. Overhead tank capacity. 	N/A	N/A	N/A
15.	'No Smoking' Signage.	Required	Displayed in Hindi & English	MR
16.	Provision of Lifts.			
	<ul style="list-style-type: none"> Pressurization of lift shaft. Pressurization of lift lobby. Communication in lift car. Fireman's switch. Lift signage. 	N/A	N/A	N/A
17.	Standby Power Supply	N/A	Provided (DG Set)	N/A
18.	Refuge Area			
	<ul style="list-style-type: none"> Total area Location 	N/A	N/A	N/A

19.	Fire Control Room.	• Detector system panel.	N/A	N/A	N/A
		• Flow switch panel.	N/A	N/A	N/A
		• PA system panel.	N/A	N/A	N/A
		• Battery backup.	N/A	N/A	N/A
		• Building floor plan.	N/A	N/A	N/A
20.	Special Fire Protection System for the Protection of special Risk, if any.	N/A	N/A	N/A	

The fire protection system provided at suitable places in the retail outlet area were checked/operated at random and found functional at the time of inspection. The shortcomings communicated by this department vide letter No. F.5/(3A)/DFS/2004 dated 15/10/2004 found complied.

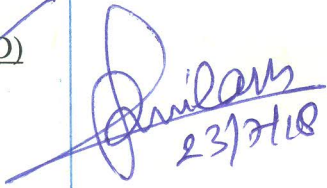
Keeping in view of the substantial satisfactory compliance of the minimum standards on fire prevention and fire safety measures as required under the rules, it is recommended to issue Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules, 2010.


Accordingly DFA is put up for approval and signature please.



 Signature of the Inspecting Officer
 Name: Mehmood
 Design: ADO (SJ)

M/s Pushpanjali Filling Station, Nelson Mandela Marg, Vasant Kunj, New Delhi

DO (SD)


23/11/18


dy. CFO (S2)


24/11

CFO 27

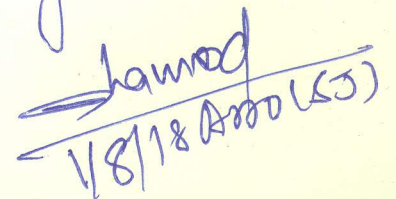
m-scell



FTM.



30/11

A. B.T. Letter put-up for signature please


 1/8/18 ADO (SJ)


CFO (S2) m-scell 

1695 CFO (S2)
31/8/18

