

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI- 110001

No. F.6/DFS/MS/EH/2018/SZ/ 1830

Dated: 6/8/18

FIRE SAFETY CERTIFICATE

Certified that the Eating House in the name & style of M/s **Diplomat Restaurant** located at Ground floor in Hotel Diplomat at 9, Sardar Patel Marg, Chanakyapuri, New Delhi-110021, comprised of basement, ground + 02 upper floors. The restaurant located at ground floor have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and verified by the officer concerned of this department on 28/07/2018 in the presence of Mr. Sandeep (Manager) and that the premises is fit for occupancy class "**Assembly, Group-D**" (Restaurant) with effect from the date of issue of this certificate for a period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010

Issued on 6/8/18 at New Delhi by


(Vipin Kental)
Chief Fire Officer
Ph: 011-23412225

Copy to: -

1. Addl. Commissioner of Police (Lic.), First Floor, PS Defence Colony, New Delhi-110001
2. Manager, M/s Diplomat Restaurant at Ground floor in Hotel Diplomat at 9, Sardar Patel Marg, Chanakyapuri, New Delhi-110021

Conditions for the validity of Fire Safety Certificate: -

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire-fighting system.
4. The owner/ occupier shall submit a declaration every year in Form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL-2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry.
7. This FSC will become null & void, if the FSC of the main premise is not renewed under rule 37 of DFS Rules-2010.

INSPECTION REPORT

1	Name & Address of the Building	M/s Diplomat Restt at 9, Sardar Patel Marg, Diplomatic Enclave, Chanakyapuri, New Delhi-21		
2	Type of Occupancy	Assembly 'Group-D' (Restaurant)		
3	Building comprised of	Basement, Ground + 02 upper floors.		
4	Type of Case	New		
5	Details of Previous NOC	Nil		
6	Fire Safety Directives Letter No	Nil		
7	Date of Inspection	28-07-2018		
8	Name of the Inspecting Officers	Mehmood, ADO (SJ)		
9	Name & Designation of Officers from the building side	Mr. Sandeep (Manager)		
10	Year of construction	1982	Restt locate at ground floor in Hotel Diplomat	
11	Applicant letter No.	Outdoor Diary No. 9287 dated 27-06-2018		
S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	NBC/BBL requirements	Provided at Site	Remarks MR/NMR
1	Access to Building.	F.6/DFS/MS/GH/2016/SZ/905 Dated 01-06-2016		
	<ul style="list-style-type: none"> Road width Gate width Width of internal road 	Restt located at Gd. Fl. in Hotel Diplomat	As above As above As above	MR N/A N/A
2	Number, width, type & arrangement of exits			
	a. Number of Staircase	Provided & Maintained by Hotel Diplomat		
	<ul style="list-style-type: none"> Upper floors Basement floor 	N/A N/A	Restt. at Gd. Floor As above	N/A N/A
	b. Width of Staircase	Provided & Maintained by Hotel Diplomat		
	<ul style="list-style-type: none"> Upper floors Basement floor 	N/A N/A	As above As above	N/A N/A
	c. Protection of exits	Provided & Maintained by Hotel Diplomat		
	<ul style="list-style-type: none"> Fire check door Pressurization 	N/A N/A	N/A N/A	N/A N/A
	d. No. of continuous staircase to terrace	Required	Provided	MR
	e. Width of corridor	N/A	N/A	N/A
	f. Door size	02 exits	2m & 1m	MR
3	Compartmentation.	Provided & Maintained by Hotel Diplomat		
	<ul style="list-style-type: none"> Fire check door. Sealing of electrical shafts. Fire rating of shaft door. Water curtain Fire dampers. 	N/A N/A N/A N/A N/A	N/A As above N/A N/A N/A	N/A N/A N/A N/A N/A
4.	Smoke Management system.	Provided & Maintained by Hotel Diplomat		
	<ul style="list-style-type: none"> Basement Upper floors 	30 ACPH 12 ACPH	As above As above	N/A MR
5.	Fire Extinguishers.			
	<ul style="list-style-type: none"> Total numbers Types ISI Marking 	Required ABC / CO2 ISI marked	06 Nos ABC & Co2 Provided	MR MR MR
6.	First Aid Hose Reels.	Provided & Maintained by Hotel Diplomat		
	<ul style="list-style-type: none"> Total numbers on each floor. Length of hose-reel hose. Nozzle Diameter 	One 30m 5mm	Provided 30m 30m	MR MR MR

M/s Diplomat Restt at 9, Sardar Patel Marg, Diplomatic Enclave, Chanakyapuri, New Delhi

7	Automatic fire detection & alarming system.	Provided & Maintained by Hotel Diplomat		
	• Type of detectors	N/A	N/A	N/A
	• Location of Main Panel	N/A	N/A	N/A
	• Location of Repeater Panel	N/A	N/A	N/A
	• Alternate source of power	N/A	N/A	N/A
	• Hooper's location	N/A	N/A	N/A
8.	MOEFA	Required	Provided	MR
9.	Public Address System	N/A	N/A	N/A
10.	Automatic Sprinkler System	Provided & Maintained by Hotel Diplomat		
	• Basement	N/A	As above	N/A
	• Upper floors	N/A	Provided in Restt	N/A
	• Sprinkler above false ceiling	N/A	N/A	N/A
11.	Internal Hydrants.			
	• Size of Riser/Down-comer	N/A	N/A	N/A
	• Number of Hydrant per floor	N/A	N/A	N/A
	• Hose box.	N/A	N/A	N/A
12.	Yard Hydrants.			
	• Total number of hydrants.	N/A	N/A	N/A
	• Hose box.	N/A	N/A	N/A
13.	Pumping arrangements.			
	• Ground Level			
	➤ Discharge of main pump.	N/A	N/A	N/A
	➤ Head of main pump.	N/A	N/A	N/A
	➤ Number of main pumps.	N/A	N/A	N/A
	➤ Jockey Pump output.	N/A	N/A	N/A
	➤ Jockey Pump head.	N/A	N/A	N/A
	➤ Standby Pump output.	N/A	N/A	N/A
	➤ Standby Pump head.	N/A	N/A	N/A
	➤ Auto Starting / Manual Stopping.	N/A	N/A	N/A
	➤ Pump House Access	N/A	N/A	N/A
	• Terrace Level	Provided & Maintained by Hotel Diplomat		
	➤ Discharge of pump.	450 LPM	Provided	MR
	➤ Head of pump.	35 mtr	Provided	MR
	➤ Power supply.	Required	Provided	MR
	➤ Auto starting of pump.	Required	Provided	MR
14.	Captive water storage for Fire Fighting.	Provided & Maintained by Hotel Diplomat		
	• Underground tank capacity.	N/A	N/A	N/A
	➤ Draw-off connection.	N/A	N/A	N/A
	➤ Fire Service Inlet.	N/A	N/A	N/A
	➤ Access to tank.	N/A	N/A	N/A
	• Overhead tank capacity.	5,000 Ltr	Provided	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			
	• Pressurization of lift shaft.	N/A	N/A	N/A
	• Pressurization of lift lobby.	N/A	N/A	N/A
	• Communication in lift car.	N/A	N/A	N/A
	• Fireman's switch.	N/A	N/A	N/A
	• Lift signage.	N/A	N/A	N/A
17	Standby Power Supply	Required	Provided	MR
18.	Refuge Area			
	• Total area	N/A	N/A	N/A
	• Location	N/A	N/A	N/A


M/s Diplomat Restt at 9, Sardar Patel Marg, Diplomatic Enclave, Chanakyapuri, New Delhi

19.	Fire Control Room.	• Detector System Panel.	N/A	N/A	N/A
		• Flow Switch Panel.	N/A	N/A	N/A
		• PA system Panel.	N/A	N/A	N/A
		• Battery backup	N/A	N/A	N/A
		• Building floor plan	N/A	N/A	N/A
20.	Special Fire Protection System for the Protection of special Risk, if any :	N/A	N/A	N/A	

The shortcomings communicated by this department vide letter No. F.6/DFS/MS/EH/2018/SZ/2443 dated 08/06/2018 found complied. ✓

The Fire protection systems provided in the building/ premises were checked/ operated at random and found functional at the time of inspection. Keeping in view the substantial satisfactory compliance of the minimum standards on fire prevention and fire safety measures as required under the rules, it is recommended to issue Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules, 2010.


Accordingly, DFA is put up for approval and signature please.



Signature of the Inspecting Officer
Name: Mehmoed
Design: ADO (SJ)

M/s Diplomat Restt at 9, Sardar Patel Marg, Diplomatic Enclave, Chanakyapuri, New Delhi

DO (SD)

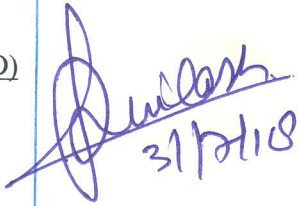
31/8/18

dy. CFO (S2)


dy. CFO
1/8

F1601.

W
2/8


CFO

m.scell



1703 CFO (S2)
6/8/18

A. B.T. letter for my for signature please

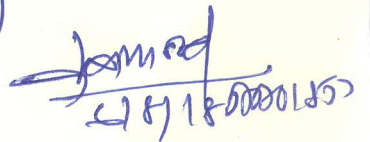
2/8/18

CFO

m.scell W
5/8