

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI-110001**

Fax No. 011-23412593, Ph. 011-23412225



No. F.6/DFS/MS/School/2018/SZ/ 1891

Dated: 13/8/18

FIRE SAFETY CERTIFICATE

Certified that SDMC Primary Co-Ed. School located at Kilokri Tank, Jal Vihar, Lajpat Nagar, New Delhi-110024, comprised of ground floor only was issued FSC by this department vide letter No. F.6/DFS/MS/School/2012/SZ/4245 dated 14-11-2012. The said premises was re-inspected by officer concerned of this department on 28/07/2018 in the presence of Mrs. Savita Daheja (Teacher) and found that school building have deemed complied with the fire prevention and fire safety requirements in accordance with Directorate of Education Circular No F.16//Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011 issued by Director of Education, Govt. of NCT of Delhi. and that building is fit for occupancy class "**Educational Building**" Group-B with effect from the date of issue of this certificate for period of **Three years** in accordance with rule 36 unless renewed under rule 37 of sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of Delhi Fire Service Rules, 2010.

Issued 13/8/18 at New Delhi by


(Vipin Kental)
Chief Fire Officer


Copy to: -

1. The Principal, SDMC Primary Co-Ed. School, Kilokri Tank, Jal Vihar, Lajpat Nagar, New Delhi-110024
2. Directorate of Education, Govt. of NCT Delhi, Old Secretariat, New Delhi-110054

Conditions for the validity of Fire Safety Certificate:

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire fighting system.
4. The owner/occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL- 2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry.

INSPECTION REPORT

1	Name & Address of the Building	SDMC Primary Co-ED. School, Kilokri Tank ,Jal Vihar, Lajpat Nagar,New Delhi-110024		
2	Type of Occupancy	Educational Building (School)		
3	Building Comprised of	Ground floor Only.		
4	Type of Case	Renewal		
5	Details of Previous NOC	F.6/DFS/MS/School/2012/4245 dated 14-11-2012		
6	Fire Safety Directives Letter No	F.16/Estate/CC/Fire Safety/2011/3298 to 3398 dated 01.03.2011		
7	Date of Inspection	28-07-2018		
8	Name of the Inspecting Officers	Mehmood ADO (SJ)		
9	Name & Designation of Officers from the building side	Mrs. Savita Daheja (Teacher)		
10	Year of construction	1967		
11	Applicant letter No.	Nil Dated 14/06/18		
S. No	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC requirements	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	• Road width	6mtr	9 mtr	MR
	• Gate width	5m	5 m	MR
	• Width of internal road	-N/A-	-N/A-	-N/A-
2	Number, width, type & arrangement of exits.			
	a) Number of Staircase			
	➤ Upper floors	-N/A-	-N/A-	-N/A-
	➤ Basement floor	-N/A-	-N/A-	-N/A-
	b) Width of Staircase			
	➤ Upper floors.	-N/A-	-N/A-	-N/A-
	➤ Basement floor	-N/A-	-N/A-	-N/A-
	c) Protection of exits			
	➤ Fire check door	-N/A-	-N/A-	-N/A-
	➤ Pressurization	-N/A-	-N/A-	-N/A-
	d) No. of continuous staircase to terrace	-N/A-	-N/A-	-N/A-
	e) Width of corridor	1.5m	Provided	MR
	f) Door size	1 mtr	Provided	MR
3	Compartmentation.			
	• Fire check door.	-N/A-	-N/A-	-N/A-
	• Sealing of electrical shafts.	-N/A-	-N/A-	-N/A-
	• Fire rating of shaft door.	-N/A-	-N/A-	-N/A-
	• Water curtain	-N/A-	-N/A-	-N/A-
	• Fire dampers.	-N/A-	-N/A-	-N/A-
4.	Smoke Management system.			
	• Basement	-N/A-	-N/A-	-N/A-
	• Upper floors	-N/A-	-N/A-	-N/A-
5.	Fire Extinguishers.			
	• Total numbers	02 No 's	02 No's	MR
	• Types	ABC / Co2	ABC- 02	MR
	• ISI Marking	ISI Marked	Provided	MR
6.	First Aid Hose Reels.			
	• Total numbers on each floor.	-N/A-	-N/A-	-N/A-
	• Length of hose-reel hose.	-N/A-	-N/A-	-N/A-
	• Nozzle Diameter	-N/A-	-N/A-	-N/A-

7	Automatic fire detection & alarming system.			
	<ul style="list-style-type: none"> Type of detectors 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> Location of Main Panel 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> Location of Repeater Panel 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> Alternate source of power 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> Hooter's location 	-N/A-	-N/A-	-N/A-
8.	MOEFA	-N/A-	-N/A-	-N/A-
9.	Public Address System	-N/A-	-N/A-	-N/A-
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> Basement. 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> Upper floors 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> Sprinkler above false ceiling 	-N/A-	-N/A-	-N/A-
11.	Internal Hydrants.			
	<ul style="list-style-type: none"> Size of Riser / Down-comer 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> Number of Hydrant per floor 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> Hose box. 	-N/A-	-N/A-	-N/A-
12.	Yard Hydrants.			
	<ul style="list-style-type: none"> Total number of hydrants. 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> Hose box. 	-N/A-	-N/A-	-N/A-
13.	Pumping arrangements.			
	<ul style="list-style-type: none"> Ground Level 			
	<ul style="list-style-type: none"> ➤ Discharge of main pump. 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> ➤ Head of main pump. 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> ➤ Number of main pumps. 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> ➤ Jockey Pump output. 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> ➤ Jockey Pump head. 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> ➤ Standby Pump output. 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> ➤ Standby Pump head. 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> ➤ Auto Starting/Manual stopping. 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> ➤ Pump house access. 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> Terrace Level 			
	<ul style="list-style-type: none"> ➤ Discharge of pump. 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> ➤ Head of pump. 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> ➤ Power supply. 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> ➤ Auto starting of pump. 	-N/A-	-N/A-	-N/A-
14.	Captive water storage for firefighting.			
	<ul style="list-style-type: none"> Underground tank capacity. 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> ➤ Draw-off connection. 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> ➤ Fire Service Inlet. 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> ➤ Access to tank. 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> Overhead tank capacity. 	-N/A-	-N/A-	-N/A-
15.	Exit Signage.	-N/A-	-N/A-	-N/A-
16.	Provision of Lifts.			
	<ul style="list-style-type: none"> Pressurization of lift shaft. 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> Pressurization of lift lobby. 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> Communication in lift car. 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> Fireman's switch. 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> Lift signage. 	-N/A-	-N/A-	-N/A-
17	Standby Power Supply	-N/A-	-N/A-	-N/A-
18.	Refuge Area			
	<ul style="list-style-type: none"> Total area 	-N/A-	-N/A-	-N/A-
	<ul style="list-style-type: none"> Location 	-N/A-	-N/A-	-N/A-


N18

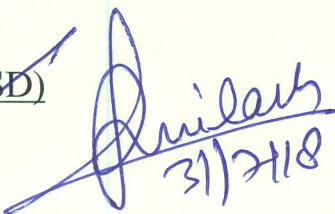
19.	Fire Control Room.			
	• Detector System Panel.	-N/A-	-N/A-	-N/A-
	• Flow Switch Panel.	-N/A-	-N/A-	-N/A-
	• PA system Panel.	-N/A-	-N/A-	-N/A-
	• Battery backup	-N/A-	-N/A-	-N/A-
	• Building floor plan	-N/A-	-N/A-	-N/A-
20.	Special Fire Protection System for the Protection of special Risk, if any.	-N/A-	-N/A-	-N/A-

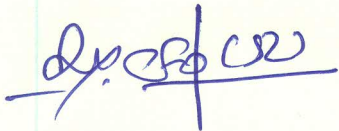
The Fire protection systems provided in the premises were checked / operated at random and found functional at the time of inspection.

Keeping in view the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under the DOE circular, FSC issued vide letter No. F.6/DFS/MS/School/2012/4245 dated 14-11-2012, renewal under rule 37 of the Delhi Fire Service rules, 2010 is recommended.

Accordingly DFA is put up for approval and signature please.


 Signature of the Inspecting Officer
 Name : Mehmood
 Designation: ADO (SJ)


DO (SD)

 31/8/18







CFO S2/ M-SCell FTM,
 13/8/18

A. G.T. Letter put up for signature please

 6/8/18 (M/SS)

1734CFOCS2/
 13/8/18

CFO S2/
 M-SCell 13/8/18