

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI- 110001


No. F.6/DFS/MS/EH/2018/SZ/ 1971

Dated: 28/8/18

FIRE SAFETY CERTIFICATE

Certified that the Eating House in the name & style of M/s **Social Ambience Mall** (A Unit of Impresario Entertainment & Hospitality Pvt. Ltd) situated at Shop T-306, 3rd Floor, Ambience Mall, Plot No-2, Nelson Mandela Marg, New Delhi-110070, comprised of 03 basements, ground plus three upper floors. The restaurant running at 3rd floor have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and verified by the officer concerned of this department on 07/08/2018 in the presence of Mr. Sahu (Manager) and that the premises is fit for occupancy class "**Assembly, Group-D**" (Eating House) with effect from the date of issue of this certificate for a period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010

Issued on 28/8/18 at New Delhi by


(Vipin Kental)
Chief Fire Officer
Ph: 011-23412225

Copy to: -

1. DHO, South MCD, Public Health Department, South Zone, Green Park, Aurobindo Marg, New Delhi-110016
2. Mr. Satyajit Dhingra (Auth. Signatory), M/s Social Ambience Mall (A Unit of Impresario Entertainment & Hospitality Pvt. Ltd), Shop T-306, 3rd Floor, Ambience Mall, Plot No-2, Nelson Mandela Marg, New Delhi-110070

Conditions for the validity of Fire Safety Certificate: -

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire-fighting system.
4. The owner/ occupier shall submit a declaration every year in Form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL-2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry.
7. This FSC will become null & void, if the FSC of the main premise is not renewed under rule 37 of DFS Rules-2010

INSPECTION REPORT

1	Name & Address of the Building	M/s Social Ambience Mall (A Unit of Impresario Entertainment & Hospitality Pvt. Ltd) at Shop No. T-306, 3 rd Floor, Ambience Mall, Plot No-2, Nelson Mandela Marg, New Delhi-110070		
2	Type of Occupancy	Assembly, "Group-D" (Eating House)		
3	Building Comprised of	03 Basements, Ground + 03 Upper Floors		
4	Type of Case	New		
5	Details of Previous NOC	Nil		
6	Fire Safety Directives Letter No	Nil		
7	Date of Inspection	07-08-2018		
8	Name of the Inspecting Officers	Mehmood, ADO (SJ)		
9	Name & Designation of Officers from the building side	Mr. Sahu (Manager)		
10	Year of construction	2008 Eating House at 3 rd Floor of the building		
11	Applicant letter No.	Outdoor diary No. 10385 dated 19-07-2018		
S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	NBC / BBL requirements	Provided at Site	Remarks MR/NMR
1	Access to Building.	F.6/MS/DFS/Mall/SZ/2017/33 dated 09-01-2017		
	<ul style="list-style-type: none"> Road width Gate width Width of internal road 	Restt. within Ambience Mall	As above As above As above	MR -NA- -NA-
2	Number, width, type & arrangement of exits.			
	a) Number of Staircase	Provided & Maintained by Ambience Mall		
	➤ Upper floors.	02 Nos	As above	MR
	➤ Basement floor.	-NA-	As above	-NA-
	b) Width of Staircase	Provided & Maintained by Ambience Mall		
	➤ Upper floors	1.5 mtr	As above	MR
	➤ Basement floor	-NA-	As above	-NA-
	c) Protection of exits	Provided & Maintained by Ambience Mall		
	➤ Fire check door	-NA-	As above	-NA-
	➤ Pressurization	-NA-	As above	-NA-
	d) No. of continuous staircase to terrace	Required	As above	MR
	e) Width of corridor	-NA-	As above	-NA-
	f) Door size	2 exits (2m/1m)	2m & 1.5m	MR
3	Compartmentation.	Provided & Maintained by Ambience Mall		
	<ul style="list-style-type: none"> Fire check door. Sealing of electrical shafts. Fire rating of shaft door. Water curtain Fire dampers. 	-NA- -NA- -NA- -NA- -NA-	As above As above As above As above As above	-NA- -NA- -NA- -NA- -NA-
4.	Smoke Management system.	Provided & Maintained by Ambience Mall		
	<ul style="list-style-type: none"> Basement Upper floors /Restt. Area 	30 ACPH 12 ACPH	-NA- Provided in kitchen	-NA- MR
5.	Fire Extinguishers.			
	<ul style="list-style-type: none"> Total numbers Types ISI Marking 	06 Nos ABC / CO2 ISI marked	Provided CO2 & ABC Provided	MR MR MR
6.	First Aid Hose Reels.	Provided & Maintained by Ambience Mall		
	<ul style="list-style-type: none"> Total numbers on each floor. Length of hose-reel hose. Nozzle Diameter 	One 30 mtr 5 mm	Provided near Restt. Provided Provided	MR MR MR


M/s Social Ambience Mall at T-306, 3rd Floor, Ambience Mall, Plot No-2, NM Marg, New Delhi

7	Automatic fire detection & alarming system.	Provided & Maintained by Ambience Mall		
	• Type of detectors	-NA-	As above	-NA-
	• Location of Main Panel	-NA-	As above	-NA-
	• Location of Repeater Panel	-NA-	-NA-	-NA-
	• Alternate source of power	-NA-	As above	-NA-
	• Hooter's location	-NA-	As above	-NA-
8.	MOEFA	Required	As above	MR
9.	Public Address System	-NA-	As above	-NA-
10.	Automatic Sprinkler System	Provided & Maintained by Ambience Mall		
	• Basement	-NA-	As above	-NA-
	• Upper floors.	Required	As above	MR
	• Sprinkler above false ceiling	-NA-	As above	-NA-
11.	Internal Hydrants.	Provided & Maintained by Ambience Mall		
	• Size of Riser/Down-comer	Required	As above	MR
	• Number of Hydrant per floor	-NA-	As above	-NA-
	• Hose box.	-NA-	As above	-NA-
12.	Yard Hydrants.	Provided & Maintained by Ambience Mall		
	• Total number of hydrants.	-NA-	As above	-NA-
	• Hose box.	-NA-	As above	-NA-
13.	Pumping arrangements.	Provided & Maintained by Ambience Mall		
	• Ground Level	Provided & Maintained by Ambience Mall		
	➤ Discharge of main pump.	4500 LPM	4500 LPM	MR
	➤ Head of main pump.	70 mtr	70 mtr	MR
	➤ Number of main pumps.	Two	Two	MR
	➤ Jockey Pump output.	180 LPM	180 LPM	MR
	➤ Jockey Pump head.	70 mtr	70 mtr	MR
	➤ Standby Pump output.	4500 LPM	4500 LPM	MR
	➤ Standby Pump head.	70 mtr	70 mtr	MR
	➤ Auto Starting/Manual Stopping.	Required	Provided	MR
	➤ Pump house access.	Required	Provided	MR
	• Terrace Level	Provided & Maintained by Ambience Mall		
	➤ Discharge of pump.	-NA-	As above	-NA-
	➤ Head of pump.	-NA-	As above	-NA-
	➤ Power supply.	-NA-	As above	-NA-
	➤ Auto starting of pump.	-NA-	As above	-NA-
14.	Captive water storage for fire fighting.	Provided & Maintained by Ambience Mall		
	• Underground tank capacity.	-NA-	5,25,000 Ltr	-NA-
	➤ Draw-off connection.	-NA-	As above	-NA-
	➤ Fire Service Inlet.	-NA-	As above	-NA-
	➤ Access to tank.	-NA-	As above	-NA-
	• Overhead tank capacity.	5,000 Ltr	As above	MR
15.	Exit Signage.	Required	As above	MR
16.	Provision of Lifts.	Provided & Maintained by Ambience Mall		
	• Pressurization of lift shaft.	-NA-	As above	-NA-
	• Pressurization of lift lobby.	-NA-	As above	-NA-
	• Communication in lift car.	-NA-	As above	-NA-
	• Fireman's switch.	-NA-	As above	-N,
	• Lift signage.	-NA-	As above	-N
17.	Standby Power Supply	Required	Provided	N
18.	Refuge Area			
	• Total area	-NA-	-NA-	-
	• Location	-NA-	-NA-	-

19.	Fire Control Room.	Provided & Maintained by Ambience Mall			
		• Detector system panel.	-NA-	As above	-NA-
		• Flow switch panel.	-NA-	As above	-NA-
		• PA system panel.	-NA-	As above	-NA-
		• Battery backup.	-NA-	As above	-NA-
• Building floor plan.	-NA-	As above	-NA-		
20.	Special Fire Protection System for the Protection of special Risk, if any.	-NA-	As above	-NA-	

The Fire protection systems provided in the premises were checked / operated at random and found functional at the time of inspection. Keeping in view of the substantially satisfactory compliance of the minimum standards on fire prevention and fire safety measures as required under the rules, it is recommended to issue Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules, 2010

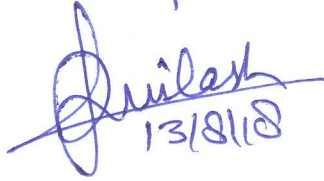
Accordingly DFA is put up for approval and signature please.


 Signature of the Inspecting Officer
 Name: Mehmood
 Design: ADO (SJ)

M/s Social Ambience Mall at T-306, 3rd Floor, Ambience Mall, Plot No-2, NM Marg, New Delhi

~~DO (SD)~~

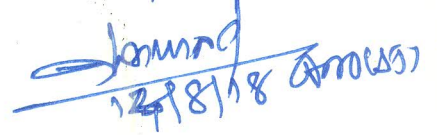
Put up with Main file.


13/8/18

~~App
SP~~

Sir, Main file enclosed herewith.

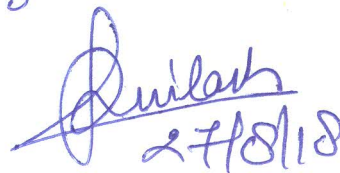
he. Submitted please


12/8/18 (Anilash)

~~DO (SD)~~

~~DO (SD)~~

All provide the status of place in the approved drawings, where the Eating area is proposed.


27/8/18

~~App
SP~~

Sir. As per Approved drawing is marked as Atrium shown in that place. Submitted please

'A'