

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI-110001

Fax No. 011-23412593, Ph. 011-23412225



No. F.6/DFS/MS/School/2018/SZ/ 2047

Dated: 6/9/18

FIRE SAFETY CERTIFICATE

Certified that Global Academy located Behind E-Pocket Market, Sarita Vihar, New Delhi-110076, comprised of ground plus three upper floors was issued Fire Safety Certificate by this department vide letter No.F.6/DFS/MS/School/2015/SZ/1600 dated 04/09/2015. The premises was re-inspection by officer concerned by this department on 25/08/2018 in the presence of Mrs. Arpita (Principal) and observed that said school have deemed complied with the fire prevention and fire safety requirements in accordance with Delhi Fire Service Act-2007 & Delhi Fire Service Rules, 2010 and that the building/premises is fit for occupancy class "**Education Building**" Group-B, with effect from the date of issue of this certificate for period of **Three years** in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued 6/9/18 at New Delhi by


(Vipin Kental)
Chief Fire Officer


Copy to: -

1. The Principal, Global Academy, Behind E-Pocket Market, Sarita Vihar, New Delhi-110076
2. The Director of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi.

Conditions for the validity of Fire Safety Certificate: -

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire fighting system.
4. The owner/occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL- 2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry.

N/9

INSPECTION REPORT

1	Name & Address of the Building	Global Academy, Behind E Block Market, Sarita Vihar, New Delhi-110076		
2	Type of Occupancy	Educational, Group-B (School)		
3	Building Comprised of	G+03 upper floor		
4	Type of Case	Renewal		
5	Details of Previous NOC	F6/DFS/MS/School/2015/SZ/1600 Dated 04/09/2015		
6	Fire Safety Directives Letter No	Delhi Fire Service Act-2007 & Delhi Fire Service Rules 2010		
7	Date of Inspection	25-08-2018		
8	Name of the Inspecting Officers	Mehmood, ADO (SJ)		
9	Name & Designation of Officers from the building side	Mrs. Arpita (Principal)		
10	Year of construction	2009		
11	Applicant letter No.	Nil dated 30.07.2018		
S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	As Per Old NOC	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	<ul style="list-style-type: none"> Road width Gate width Width of internal road 	6 mtr	Provided	MR
		4.5m	Provided	MR
		-NA-	-NA-	-NA-
2	Number, width, type & arrangement of exits.			
	a) Number of Staircase			
	➤ Upper floors.	Three	Three	MR
	➤ Basement floor.	-NA-	-NA-	-NA-
	b) Width of Staircase			
	➤ Upper floors	1.5 m/0.75m	1.20m, 1.08m & 0.98m	MR
	➤ Basement floor	-NA-	-NA-	-NA-
	c) Protection of exits			
	➤ Fire check door	-NA-	-NA-	-NA-
	➤ Pressurization	-NA-	-NA-	-NA-
	d) No. of continuous staircase to terrace	-NA-	-NA-	-NA-
	e) Width of corridor	1.5m	Provided	MR
	f) Door size	1m	Provided	MR
3	Compartmentation.			
	<ul style="list-style-type: none"> Fire check door. Sealing of electrical shafts. Fire rating of shaft door. Water curtain Fire dampers. 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
4.	Smoke Management system.			
	<ul style="list-style-type: none"> Basement Upper floors 	30 ACPH	-NA-	-NA-
		12 ACPH	-NA-	-NA-
5.	Fire Extinguishers.			
	<ul style="list-style-type: none"> Total numbers Types ISI Marking 	10 Nos	10 Nos	MR
		ABC / CO2	ABC & Co2	MR
		ISI marked	Provided	MR
6.	First Aid Hose Reels.			
	<ul style="list-style-type: none"> Total numbers on each floor. Length of hose-reel hose. Nozzle Diameter 	One	Provided	MR
		30m	Provided	MR
		5mm	Provided	MR


7.	Automatic fire detection & alarming system.			
	<ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooter's location 	-NA-	-NA-	-NA-
8.	MOEFA	Required	Provided	MR
9.	Public Address System	Required	Provided	MR
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> Basement Upper floors Sprinkler above false ceiling 	-NA-	-NA-	-NA-
11.	Internal Hydrants.			
	<ul style="list-style-type: none"> Size of Riser/Down-comer Number of Hydrant per floor Hose box. 	100MM	Provided	MR
		01 no	Provided	MR
		01no	Provided	MR
12.	Yard Hydrants.			
	<ul style="list-style-type: none"> Total number of hydrants. Hose box. 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
13.	Pumping arrangements.			
	<ul style="list-style-type: none"> Ground Level ➤ Discharge of main pump. ➤ Head of main pump. ➤ Number of main pumps. ➤ Jockey Pump output. ➤ Jockey Pump head. ➤ Standby Pump output. ➤ Standby Pump head. ➤ Auto Starting / Manual Stopping. ➤ Pump house access. 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> Terrace Level ➤ Discharge of pump. ➤ Head of pump. ➤ Power supply. ➤ Auto starting of pump. 	450 LPM	450 LPM	MR
		40m	40 m	MR
		Required	Provided	MR
		Required	Provided	MR
14.	Captive water storage for fire fighting.			
	<ul style="list-style-type: none"> Underground tank capacity. ➤ Draw-off connection. ➤ Fire Service Inlet. ➤ Access to tank. Overhead tank capacity. 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		10,000 Ltr	Provided	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			
	<ul style="list-style-type: none"> Pressurization of lift shaft. Pressurization of lift lobby. Communication in lift car. Fireman's switch. Lift signage. 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
17.	Standby Power Supply	-NA-	-NA-	-NA-
18.	Refuge Area			
	<ul style="list-style-type: none"> Total area Location 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-

19.	Fire Control Room.	• Detector system panel.	-NA-	-NA-	-NA-
		• Flow switch panel.	-NA-	-NA-	-NA-
		• PA system panel.	-NA-	-NA-	-NA-
		• Battery backup.	-NA-	-NA-	-NA-
		• Building floor plan.	-NA-	-NA-	-NA-
20.	Special Fire Protection System for the Protection of special Risk, if any.		-NA-	ABC type fire extinguisher provided near electrical panel	-NA-

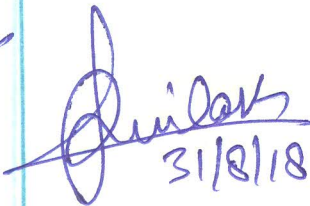
The Fire protection systems provided in the building were randomly tested, checked and found functional at the time of inspection.

Keeping in view the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under the rule, FSC issued vide letter No. F.6/DFS/MS/School/2015/SZ/1600 dated 04/09/2015, renewal under rule Delhi Fire Service Act-2007 & 2010 is recommended.


Accordingly DFA is put up for approval and signature please.


 Signature of the Inspecting Officer
 Name: Mehmood
 Design: ADO (SJ)

~~DO (SD)~~


31/8/18

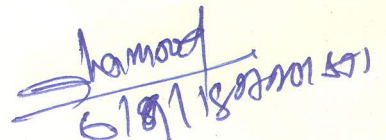
dy. CB/CS2


31/8

1782/cfo 52
5/9.

cfo 52 m's cell u
4/9.

A. F. S. letter u for signature please


6/9/18

CSO/CS2 m's cell u
6/9.

