

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE  
NEW DELHI-110001

No. F.6/DFS/MS/2018/SZ/ 2114

Dated: 14/9/18

**FIRE SAFETY CERTIFICATE**

Certified that M/s **R.K. Service Station** (Retail outlet of I.O.C.L. Petroleum Class A & B) located at Africa Avenue Marg, Opp. Yashwant Place, Chanakya Puri, New Delhi-110021, comprised of ground floor only was issued Fire Safety Certificate by this department vide letter No. F5/(3A)/DFS/MS/2011/187 dated 05/08/2011. The premises was re-inspected by officer concerned of this department on 01/09/2018 in the presence of Mr. Pratap Arya (Manager) and found that the said premises have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of Delhi Fire Service Rules, 2010 and that premises is fit for occupancy class "**Mixed**" (Petrol Pump and Service Station), as above with effect from the date of issue of this certificate for period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued 14/9/18 at New Delhi by

  
(Vipin Kental)  
Chief Fire Officer  
Ph: 011-23412225  


Copy to: -

1. M/s R.K. Service Station at Africa Avenue Marg, Opp. Yashwant Place, Chanakya Puri, New Delhi-110021
2. The Medical Officer of Health, New Delhi Municipal Council, Palika Kendra, New Delhi.

**Conditions for the validity of Fire Safety Certificate:**

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire fighting system.
4. The owner/occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in)
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL-2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry.

INSPECTION REPORT				
1	Name & Address of the Building	M/s R.K. Service Station (Retail outlet of I.O.C.L. Petroleum Class A & B), Opp. Yashwant Place, Chanakyapuri, New Delhi-110021		
2	Type of Occupancy	Storage (Petrol Pump-cum-Service Station)		
3	Building Comprised of	Ground floor only.		
4	Type of Case	Renewal		
5	Details of Previous NOC	F5(3A)/DFS/MS/2011/187 Dated 05/08/2011		
6	Fire Safety Directives Letter No	Nil		
7	Date of Inspection	01-09-2018		
8	Name of the Inspecting Officers	Mehmood, ADO/SJ		
9	Name & Designation of Officers from the building side	Sh. Pratap Arya (Manager)		
10	Year of construction			
11	Applicant letter No.	Outdoor Diary No. 11101 dated 02-08-2018		
S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC requirements	Provided at Site	Remarks MR/NMR
1	<b>Access to Building.</b>			
	• Road width	Required	12 mtr	MR
	• Gate width	N/A	N/A	N/A
	• Width of internal road	N/A	N/A	N/A
2	<b>Number, width, type &amp; arrangement of exits.</b>			
	<b>a. Number of Staircase</b>			
	➤ Upper floors.	N/A	N/A	N/A
	➤ Basement.	N/A	N/A	N/A
	<b>b. Width of Staircase</b>			
	➤ Upper floors	N/A	N/A	N/A
	➤ Basement	N/A	N/A	N/A
	<b>c. Protection of exits</b>			
	➤ Fire check door	N/A	N/A	N/A
	➤ Pressurization	N/A	N/A	N/A
	<b>d. No. of continuous staircase to terrace</b>	N/A	N/A	N/A
	<b>e. Width of corridor</b>	N/A	N/A	N/A
	<b>f. Door size</b>	1m	Provided	MR
3	<b>Compartmentation.</b>			
	• Fire check door.	N/A	N/A	N/A
	• Sealing of electrical shafts.	N/A	N/A	N/A
	• Fire rating of shaft door.	N/A	N/A	N/A
	• Water curtain	N/A	N/A	N/A
	• Fire dampers.	N/A	N/A	N/A
4.	<b>Smoke Management system.</b>			
	• Basement	N/A	N/A	N/A
	• Upper floors	N/A	N/A	N/A
5.	<b>Fire Extinguishers.</b>			
	• Total numbers	10 Nos	Provided	MR
	• Types	CO2, ABC, DCP	CO2, DCP & Foam	MR
	• ISI Marking	ISI marked	Provided	MR
6.	<b>First Aid Hose Reels.</b>			
	• Total numbers on each floor.	N/A	N/A	N/A
	• Length of hose-reel hose.	N/A	N/A	N/A
	• Nozzle Diameter	N/A	N/A	N/A

M/s R.K. Service Station (IOCL Retail Outlet), Opp. Yashwant Place, Chanakyapuri, New Delhi-110021


7.	<b>Automatic fire detection &amp; alarming system.</b>			
	• Type of detectors	N/A	N/A	N/A
	• Location of Main Panel	N/A	N/A	N/A
	• Location of Repeater Panel	N/A	N/A	N/A
	• Alternate source of power	N/A	N/A	N/A
	• Hooter's location	N/A	N/A	N/A
8.	<b>MOEFA</b>	N/A	N/A	N/A
9.	<b>Public Address System</b>	N/A	N/A	N/A
10.	<b>Automatic Sprinkler System</b>			
	• Basement	N/A	N/A	N/A
	• Upper floors	N/A	N/A	N/A
	• Sprinkler above false ceiling	N/A	N/A	N/A
11.	<b>Internal Hydrants.</b>			
	• Size of Riser/Down-comer	N/A	N/A	N/A
	• Number of Hydrant per floor	N/A	N/A	N/A
	• Hose box.	N/A	N/A	N/A
12.	<b>Yard Hydrants.</b>			
	• Total number of hydrants.	N/A	N/A	N/A
	• Hose box.	N/A	N/A	N/A
13.	<b>Pumping arrangements.</b>			
	• <b>Ground Level</b>			
	➤ Discharge of main pump.	N/A	N/A	N/A
	➤ Head of main pump.	N/A	N/A	N/A
	➤ Number of main pumps.	N/A	N/A	N/A
	➤ Jockey Pump output.	N/A	N/A	N/A
	➤ Jockey Pump head.	N/A	N/A	N/A
	➤ Standby Pump output.	N/A	N/A	N/A
	➤ Standby Pump head.	N/A	N/A	N/A
	➤ Auto Starting / Manual Stopping.	N/A	N/A	N/A
	➤ Pump house access.	N/A	N/A	N/A
	• <b>Terrace Level</b>			
	➤ Discharge of pump.	N/A	N/A	N/A
	➤ Head of pump.	N/A	N/A	N/A
	➤ Power supply.	N/A	N/A	N/A
	➤ Auto starting of pump.	N/A	N/A	N/A
14.	<b>Captive water storage for Fire Fighting.</b>			
	• Underground tank capacity.	N/A	N/A	N/A
	• Draw-off connection.	N/A	N/A	N/A
	• Fire Service Inlet.	N/A	N/A	N/A
	• Access to tank.	N/A	N/A	N/A
	• Overhead tank capacity.	N/A	N/A	N/A
15.	<b>'No Smoking' Signage.</b>	Required	Displayed in Hindi & English	MR
16.	<b>Provision of Lifts.</b>			
	• Pressurization of lift shaft.	N/A	N/A	N/A
	• Pressurization of lift lobby.	N/A	N/A	N/A
	• Communication in lift car.	N/A	N/A	N/A
	• Fireman's switch.	N/A	N/A	N/A
	• Lift signage.	N/A	N/A	N/A
17.	<b>Standby Power Supply</b>	N/A	Provided (DG Set)	N/A
18.	<b>Refuge Area</b>			
	• Total area	N/A	N/A	N/A
	• Location	N/A	N/A	N/A

19.	<b>Fire Control Room.</b>		N/A	N/A	N/A
		• Detector system panel.	N/A	N/A	N/A
		• Flow switch panel.	N/A	N/A	N/A
		• PA system panel.	N/A	N/A	N/A
		• Battery backup.	N/A	N/A	N/A
	• Building floor plan.	N/A	N/A	N/A	
20.	<b>Special Fire Protection System for the Protection of special Risk, if any.</b>	N/A	04 nos. fire buckets full of dry loose sand provided	N/A	

The fire protection system provided at suitable places in the retail outlet area were checked/operated at random and found functional at the time of inspection. "No Smoking" sign boards were found displayed both in Hindi & English at conspicuous places. No loose electrical wiring seen in the premises at the time of inspection.

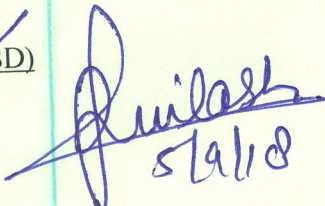
Keeping in view of the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under the rules, the FSC issued vide letter No. F5/(3A)/DFS/MS/2011/187 dated 05.08.2011, renewal under rule 37 of the Delhi Fire Service Rules, 2010 is recommended.

Accordingly DFA is put up for approval and signature please.

  
 Signature of the Inspecting Officer  
 Name: Mehmood  
 Design: ADO (SJ)

M/s R.K. Service Station (IOCL Retail Outlet), Opp. Yashwant Place, Chanakyapuri, New Delhi-110021

DO (SD)

  
 5/9/18  
 (Signature)

  
 5/9


6/8/18

m.scell

FT 107.

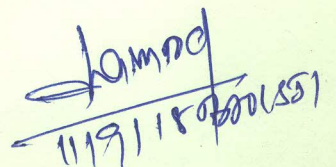
W 6/9

A. G.T. letter put up for signature please


  
 14/9/18

m.scell

W 13/9.

  
 11/9/18



  
 14/9/18