

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI- 110001

No. F.6/DFS/MS/EH/2018/SZ/ 2094


Dated: 13/9/18

FIRE SAFETY CERTIFICATE

Certified that the Eating House in the name & style of M/s **Upgrade Kitchen & Bar** (A Unit of Urban Gala) located at Property No-42, 43 & 44, First Floor, India Mall, Community Centre, New Friends Colony, New Delhi-110025, comprised of Basement, Ground plus 02 upper floors. Restaurant running at 1st floor have complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and verified by the officer concerned of this department on 10/08/2018 in the presence of Mr. Bharat (Manager) and that the premises is fit for occupancy class "**Assembly, Group-D**" (Restaurant) with effect from the date of issue of this certificate for a period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010

Issued on 13/9/18 at New Delhi by





(Vipin Kental)
Chief Fire Officer
Ph: 011-23412225



Copy to: -

1. DHO, South MCD, Public Health Deptt, Central Zone, Lajpat Nagar, New Delhi-110024
2. Partner, M/s Upgrade Kitchen & Bar (A unit of Urban Gala) at Property No-42, 43 & 44, First Floor, India Mall, Community Centre, New Friends Colony, New Delhi-110025

Conditions for the validity of Fire Safety Certificate: -

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire-fighting system.
4. The owner/ occupier shall submit a declaration every year in Form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL-2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry.

INSPECTION REPORT				
1	Name & Address of the Building	M/s Upgrade Kitchen & Bar (A unit of Urban Gala) at Shop No-42,43,44, FF, India Mall, Community Centre, New Friends Colony, New Delhi-110025		
2	Type of Occupancy	Assembly, "Group-D" (Eating House)		
3	Building Comprised of	Basement, Ground + 02 upper floors.		
4	Type of Case	New		
5	Details of Previous NOC	Nil		
6	Fire Safety Directives Letter No	Nil		
7	Date of Inspection	10-08-2018		
8	Name of the Inspecting Officers	Mehmood, ADO (SJ)		
9	Name & Designation of Officers from the building side	Mr. Bharat (Manager)		
10	Year of construction	1999		
11	Applicant letter No.	Outdoor diary No. 10803 dated 26-07-2018		
S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	NBC / BBL requirements	Provided at Site	Remarks MR/NMR
1	Access to Building.	F.6/MS/DFS/Cinema/2017/SZ/494 Dt. 31-03-17		
	<ul style="list-style-type: none"> Road width Gate width Width of internal road 	Restt. within India Mall	As above	MR
			As above	-NA-
			As above	-NA-
2	Number, width, type & arrangement of exits.			
	a) Number of Staircase	Provided & Maintained by India Mall Mgmt		
	➤ Upper floors.	02 Nos	As above	MR
	➤ Basement floor.	-NA-	As above	-NA-
	b) Width of Staircase	Provided & Maintained by India Mall Mgmt		
	➤ Upper floors	1.5 mtr	As above	MR
	➤ Basement floor	-NA-	As above	-NA-
	c) Protection of exits	Provided & Maintained by India Mall Mgmt		
	➤ Fire check door	-NA-	-NA-	-NA-
	➤ Pressurization	-NA-	-NA-	-NA-
	d) No. of continuous staircase to terrace	Required	As above	MR
	e) Width of corridor	-NA-	-NA-	-NA-
	f) Door size	2 exits	2m & 1.5m	MR
3	Compartmentation.	Provided & Maintained by India Mall Mgmt		
	<ul style="list-style-type: none"> Fire check door. Sealing of electrical shafts. Fire rating of shaft door. Water curtain Fire dampers. 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
4.	Smoke Management system.	Provided & Maintained by India Mall Mgmt		
	<ul style="list-style-type: none"> Basement Upper floors /Restt. Area 	30 ACPH	-NA-	-NA-
		12 ACPH	Provided in kitchen	MR
5.	Fire Extinguishers.			
	<ul style="list-style-type: none"> Total numbers Types ISI Marking 	04 Nos	Provided	MR
		ABC / CO2	CO2 & ABC	MR
		ISI marked	Provided	MR
6.	First Aid Hose Reels.	Provided & Maintained by India Mall Mgmt		
	<ul style="list-style-type: none"> Total numbers on each floor. Length of hose-reel hose. Nozzle Diameter 	One	As above	MR
		30 mtr	As above	MR
		5 mm	As above	MR

M/s Upgrade Kitchen & Bar at Shop No-42,43,44, FF, India Mall, Community Centre, NFC, New Delhi


7	Automatic fire detection & alarming system.	Provided & Maintained by India Mall Mgmt		
	<ul style="list-style-type: none"> • Type of detectors • Location of Main Panel • Location of Repeater Panel • Alternate source of power • Hooter's location 	-NA-	As above	-NA-
		-NA-	As above	-NA-
		-NA-	As above	-NA-
		-NA-	As above	-NA-
		-NA-	As above	-NA-
8.	MOEFA	Required	Provided	MR
9.	Public Address System	-NA-	-NA-	-NA-
10.	Automatic Sprinkler System	Provided & Maintained by India Mall Mgmt		
	<ul style="list-style-type: none"> • Basement • Upper floors. • Sprinkler above false ceiling 	-NA-	As above	-NA-
		-NA-	As above	-NA-
		-NA-	As above	-NA-
11.	Internal Hydrants.	Provided & Maintained by India Mall Mgmt		
	<ul style="list-style-type: none"> • Size of Riser/Down-comer • Number of Hydrant per floor • Hose box. 	Required	As above	MR
		-NA-	As above	-NA-
		-NA-	As above	-NA-
12.	Yard Hydrants.	Provided & Maintained by India Mall Mgmt		
	<ul style="list-style-type: none"> • Total number of hydrants. • Hose box. 	-NA-	As above	-NA-
		-NA-	As above	-NA-
13.	Pumping arrangements.	Provided & Maintained by India Mall Mgmt		
	<ul style="list-style-type: none"> • Ground Level ➤ Discharge of main pump. ➤ Head of main pump. ➤ Number of main pumps. ➤ Jockey Pump output. ➤ Jockey Pump head. ➤ Standby Pump output. ➤ Standby Pump head. ➤ Auto Starting/Manual Stopping. ➤ Pump house access. 	-NA-	2400 LPM	MR
		-NA-	50 mtr	MR
		-NA-	One	MR
		-NA-	220 LPM	MR
		-NA-	50 mtr	MR
		-NA-	2400 LPM	MR
		-NA-	50 mtr	MR
		-NA-	Provided	MR
		-NA-	Provided	MR
	<ul style="list-style-type: none"> • Terrace Level ➤ Discharge of pump. ➤ Head of pump. ➤ Power supply. ➤ Auto starting of pump. 	Provided & Maintained by India Mall Mgmt		
		450 LPM	As above	MR
		40m	As above	MR
		Required	As above	MR
		Required	As above	MR
14.	Captive water storage for fire fighting.	Provided & Maintained by India Mall Mgmt		
	<ul style="list-style-type: none"> • Underground tank capacity. ➤ Draw-off connection. ➤ Fire Service Inlet. ➤ Access to tank. • Overhead tank capacity. 	-NA-	2,00,000 Ltr	-NA-
		-NA-	As above	-NA-
		-NA-	As above	-NA-
		-NA-	As above	-NA-
		10,000 Ltr	25,000 Ltr	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.	Provided & Maintained by India Mall Mgmt		
	<ul style="list-style-type: none"> • Pressurization of lift shaft. • Pressurization of lift lobby. • Communication in lift car. • Fireman's switch. • Lift signage. 	-NA-	As above	-NA-
		-NA-	As above	-NA-
		-NA-	As above	-NA-
		-NA-	As above	-NA-
		-NA-	As above	-NA-
17.	Standby Power Supply	Required	Provided	MR
18.	Refuge Area	Provided & Maintained by India Mall Mgmt		
	<ul style="list-style-type: none"> • Total area • Location 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-

M/s Upgrade Kitchen & Bar at Shop No-42,43,44, FF, India Mall, Community Centre, NFC, New Delhi

19.	Fire Control Room.	Provided & Maintained by India Mall Mgmt		
	• Detector system panel.	-NA-	As above	-NA-
	• Flow switch panel.	-NA-	As above	-NA-
	• PA system panel.	-NA-	As above	-NA-
	• Battery backup.	-NA-	As above	-NA-
	• Building floor plan.	-NA-	As above	-NA-
20.	Special Fire Protection System for the Protection of special Risk, if any.	-NA-	As above	-NA-

The Fire protection systems provided in the premises were checked / operated at random and found functional at the time of inspection. Keeping in view of the substantially satisfactory compliance of the minimum standards on fire prevention and fire safety measures as required under the rules, it is recommended to issue Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules, 2010

Accordingly DFA is put up for approval and signature please.

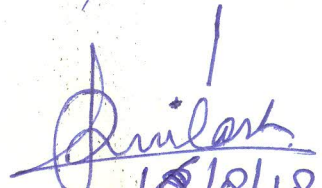

 Signature of the Inspecting Officer
 Name: Mehmood
 Design: ADO (SJ)

M/s Upgrade Kitchen & Bar at Shop No-42,43,44, FF, India Mall, Community Centre, NFC, New Delhi


DO (SD)

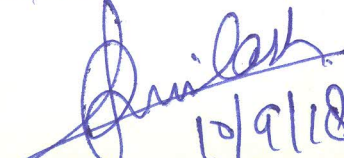
- i) Correct the fire P. & F.S. requirement as per Table 23 of NBC.
- ii) Kindly clarify about the status of occupancy of 42,43 & 44 FF on sanctioned plan.

ADP
 (SJ)


 18/8/18
 DO(SD)

Corrected fire and F.S. requirement as per Table 23 of NBC. the sanctioned plan is mentioned as reference to 42,43 and 44 FF

to be submitted please

 17/9/18

DO (Sd)

 17/9/18



01/cfo 22
 17/9/18