

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI- 110001

No. F.6/DFS/MS/Indl/2018/SZ/ 2373

Dated:22/10/18

FIRE SAFETY CERTIFICATE

Certified that M/s **Haldiram Marketing Pvt. Limited** located at B-1, H-8/1, Mohan Cooperative Industrial Estate, Main Mathura Road, New Delhi-110044, comprised of Stilt, Ground plus two upper floors was issued FSC by this department vide letter No. F6/DFS/MS/2015/EH/SZ/2062 dated 18/11/2015. The premises was re-inspected by the officer concerned of this department on 09/10/2018 in the presence of Mr. Rajiv Arora (Manager) and found that the said premises have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the premises is fit for occupancy class "Industrial Building" Group 'G' as above with effect from 22/10/2018 for a period of three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules 2010.

Issued 22/10/18 at New Delhi by

(Vipin Kental)
Chief Fire Officer
Ph: 011-23412225

Copy to: -

1. Auth. Signatory, M/s Haldiram Marketing Pvt. Limited at B-1, H-8/1, Mohan Cooperative Industrial Estate, Main Mathura Road, New Delhi-110044
2. Ex. Engineer (Bldg), South MCD, Central Zone, Jal Vihar, Lajpat Nagar, New Delhi-110024

Conditions for the validity of Fire Safety Certificate: -

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire fighting system.
4. The owner/occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL-2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry.


INSPECTION REPORT				
1	Name & Address of the Building	Haldiram Marketing Pvt. Ltd at Plot No. B-1, H-8/1, M.C.I.E, Main Mathura Road, New Delhi-110044		
2	Type of Occupancy	Industrial Building (Group-G)		
3	Building Comprised of	Stilt, Ground + 2 upper floors.		
4	Type of Case	Renewal		
5	Details of Previous NOC	F6/DFS/MS/2015/EH/SZ/2062 Dated 18/11/2015		
6	Fire Safety Directives Letter No	F6/DFS/MS/BP/2012/298 Dated 01/02/2012		
7	Date of Inspection	09-10-2018		
8	Name of the Inspecting Officers	Mehmood, ADO (SJ)		
9	Name & Designation of Officers from the building side	Mr. Rajiv Arora (Manager)		
10	Year of construction	2011		
11	Applicant letter No.	Outdoor diary No. 12983 Dated 11-09-2018		
S. No	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC Requirement	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	• Road width	06 mts	Provided	MR
	• Gate width	Accessible from road	MR
	• Width of internal road	-NA-	-NA-	-NA-
2	Number, width, type and arrangements of exits.			
	a. Number of Staircase			
	• Upper floors	02 nos.	Provided	MR
	• Basement floor	-NA-	-NA-	-NA-
	b. Width of Staircase			
	• Upper floors	1.5m each	Provided	MR
	• Basement floor	-NA-	-NA-	-NA-
	c. Protection of exits			
	• Fire check door	Required	Provided	MR
	• Pressurization	-NA-	-NA-	-NA-
	d. No. of continuous staircase to terrace	2 Nos.	2 Nos.	MR
	e. Width of corridor	-NA-	-NA-	-NA-
	f. Door size	1.5m	Provided	MR
3	Compartmentation.			
	• Fire check door.	Required	Provided	MR
	• Sealing of electrical shafts.	-NA-	-NA-	-NA-
	• Fire rating of shaft door.	-NA-	-NA-	-NA-
	• Water curtain	-NA-	-NA-	-NA-
	• Fire dampers.	-NA-	-NA-	-NA-
4.	Smoke Management system.			
	• Basement	30 a/c per hour	-NA-	-NA-
	• Upper floors	12 a/c per hour	Provided Exhaust fan	MR
5.	Fire Extinguishers.			
	• Total numbers	10 nos.	Provided	MR
	• Types	ABC/CO2/W.CO2	ABC & CO2	MR
	• ISI Marking	ISI Marked	Provided	MR
6.	First Aid Hose Reels.			
	• Total numbers on each floor.		01	MR
	• Length of hose-reel hose.	Hose-reel	30m	MR
	• Nozzle Diameter		5mm	MR

7	Automatic Fire Detection and Alarming system.			
	• Type of detectors	Smoke / Heat	Provided	MR
	• Location of Main Panel	Ground floor	Provided	MR
	• Location of Repeater Panel	-NA-	-NA-	-NA-
	• Alternate source of power	Required	Provided	MR
	• Hooter's location	Required	Each floor	MR
8.	MOEFA	Required	Provided	MR
9.	Public Address System	-NA-	-NA-	-NA-
10.	Automatic Sprinkler System			
	• Basement	-NA-	-NA-	-NA-
	• Upper floors	Required	Provided	MR
	• Sprinkler above false ceiling	-NA-	-NA-	-NA-
11.	Internal Hydrants.			
	• Size of Riser / Down-comer	150 mm	Provided	MR
	• Number of Hydrant per floor	01	Provided	MR
	• Hose box.	01	Provided	MR
12.	Yard Hydrants.			
	• Total number of hydrants.	02	Provided	MR
	• Hose box.	02	Provided	MR
13.	Pumping arrangements.			
	• Ground Level			
	➤ Discharge of main pump.	2280 LPM	Provided	MR
	➤ Head of main pump.	70m	88 Mtr	MR
	➤ Number of main pumps.	01	Provided	MR
	➤ Jockey Pump output.	180 LPM	Provided	MR
	➤ Jockey Pump head.	70m	88 Mtr	MR
	➤ Standby Pump output.	2280 LPM	Provided	MR
	➤ Standby Pump head.	70m	88 Mtr	MR
	➤ Auto Starting/Manual Stopping.	Required	Provided	MR
	• Terrace Level			
	➤ Discharge of pump.	900 LPM	Provided	MR
	➤ Head of pump.	35m	Provided	MR
	➤ Power supply.	Required	Provided	MR
	➤ Auto starting of pump.	Required	Provided	MR
14.	Captive water storage for fire-fighting.			
	• Underground tank capacity.	75,000 Ltr.	Provided	MR
	➤ Draw-off connection.	Required	Provided	MR
	➤ Fire Service Inlet.	Required	Provided	MR
	➤ Access to tank.	Required	Provided	MR
	• Overhead tank capacity.	20,000 Ltr	Provided	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			
	• Pressurization of lift shaft.	-NA-	-NA-	-NA-
	• Pressurization of lift lobby.	-NA-	-NA-	-NA-
	• Communication in lift car.	-NA-	-NA-	-NA-
	• Fireman's switch.	-NA-	-NA-	-NA-
	• Lift signage.	-NA-	-NA-	-NA-
17	Standby Power Supply	Required	Provided (125 KVA)	MR
18.	Refuge Area			
	• Total area	-NA-	-NA-	-NA-
	• Location	-NA-	-NA-	-NA-

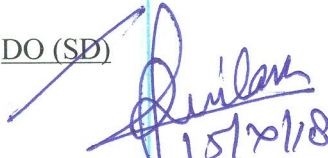
19.	Fire Control Room.	• Detector System Panel.	Required	Provided	MR
		• Flow Switch Panel.	Required	Provided	MR
		• PA system Panel.	-NA-	-NA-	-NA-
		• Battery backup	-NA-	-NA-	-NA-
		• Building floor plan	-NA-	-NA-	-NA-
20.	Special Fire Protection System for the Protection of special Risk, if any.	NA	NA	NA	NA

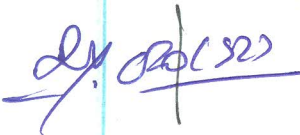
The fire protection systems provided in the building were test checked at random and found functional at the time of inspection. In view of the deemed compliance of the minimum standards on fire prevention and fire safety measures as required under rules, renewal of the FSC issued vide letter No. F6/DFS/MS/2015/EH/SZ/2062 Dated 18/11/2015, under rules 35 of the Delhi Fire Service Rules 2010 is recommended.

Accordingly, DFA is put up for perusal and signature please.


 Signature of the Inspecting Officer
 Name: Mehmoos
 Design: ADO (SJ)

M/s Haldiram Marketing Pvt. Ltd at B-1, H-8/1, M.C.I.E, Main Mathura Road, New Delhi-110044

DO (SD)

 15/10/18



126/CF/S2
 16/X/18/X


 15/X



CF/S2

M.Scell

F 7/10/18



 16/X

a. b.t. letter put up for signature please

CF/S2

M.Scell


 17/X


 17/10/18
 M.Scell