

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI-110001**

No. F.6/DFS/MS/School/2018/SZ/ 2284

Dated: 9/10/18

FIRE SAFETY CERTIFICATE

Certified that the **Red Roses Public School** located at D-Block, Saket, New Delhi-110017, comprised of Ground + Three upper floors owed/occupied by Shri R.R. Mehta Educational Trust (Regd.) was issued FSC by this department vide letter No.F6/MS/DFS/2015/SZ/2120 dated 02/12/2015. The premises was re-inspection by officer concerned by this department on 20/09/2018 in the presence of Mr. Joshi (Maint) and observed that the school building have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of Delhi Fire Service Rules, 2010 and that the school building is fit for occupancy class **"Educational"** Group-B (School upto Sr. Sec. Level) as above with effect from 9/10/2018 for period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of conditions mentioned below.

Issued 9/10/18 at New Delhi by


(Vipin Kental)
Chief Fire Officer
Ph: 011-23412225


Copy to: -

1. Principal, Red Roses Public School located at D-Block, Saket, New Delhi-110017
2. Directorate of Education, S.D.M.C, Dr. SPM Civic Centre, Minto Road, New Delhi-110002

Conditions for the validity of Fire Safety Certificate: -

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire fighting system.
4. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL- 2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry.

INSPECTION REPORT

1	Name & Address of the Building	Red Roses Public School located at D-Block, Saket, New Delhi-110017 (ID: 2730194)		
2	Type of Occupancy	Educational, Group-B (School)		
3	Building Comprised of	Ground + 03 upper floors.		
4	Type of Case	Renewal		
5	Details of Previous NOC	F6/DFS/MS/School/2015/SZ/2120 dated 02-12-2015		
6	Fire Safety Directives Letter No	F6/DFS/MS/BP/96/648 Dated 16/05/1996		
7	Date of Inspection	20-09-2018		
8	Name of the Inspecting Officers	Mehmood, ADO (SJ)		
9	Name & Designation of Officers from the building side	Sh. Joshi (Maintenance)		
10	Year of construction	1982		
11	Applicant letter No.	Outdoor Diary No. 12464 dated 30-08-2018		
S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC requirements	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	• Road width	Required	6 mtr	MR
	• Gate width	Required	4.75m & 5m	MR
	• Width of internal road	-NA-	-NA-	-NA-
2	Number, width, type & arrangement of exits.			
	a) Number of Staircase			
	➤ Upper floors.	02 Nos	Provided	MR
	➤ Basement floor.	-NA-	-NA-	-NA-
	b) Width of Staircase			
	➤ Upper floors	1.50 mtr	1.50 mtr each	MR
	➤ Basement floor	-NA-	-NA-	-NA-
	c) Protection of exits			
	➤ Fire check door	-NA-	-NA-	-NA-
	➤ Pressurization	-NA-	-NA-	-NA-
	d) No. of continuous staircase to terrace	Required	02 Nos	MR
	e) Width of corridor	Required	1.50 mtr	MR
	f) Door size	Required	1 mtr	MR
3	Compartmentation.			
	• Fire check door.	-NA-	-NA-	-NA-
	• Sealing of electrical shafts.	-NA-	-NA-	-NA-
	• Fire rating of shaft door.	-NA-	-NA-	-NA-
	• Water curtain	-NA-	-NA-	-NA-
	• Fire dampers.	-NA-	-NA-	-NA-
4.	Smoke Management system.			
	• Basement	30 ACPH	-NA-	-NA-
	• Upper floors	12 ACPH	Exhaust fan provided	MR
5.	Fire Extinguishers.			
	• Total numbers	Required	24 Nos	MR
	• Types	ABC / CO2	ABC & CO2	MR
	• ISI Marking	ISI marked	Provided	MR
6.	First Aid Hose Reels.			
	• Total numbers on each floor.	Required	02 Nos	MR
	• Length of hose-reel hose.	30m	Provided	MR
	• Nozzle Diameter	5mm	Provided	MR


7	Automatic fire detection & alarming system.			
	<ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooter's location 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
8.	MOEFA	Required	Provided	MR
9.	Public Address System	Required	Provided	MR
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> Basement Upper floors Sprinkler above false ceiling 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
11.	Internal Hydrants.			
	<ul style="list-style-type: none"> Size of Riser/Down-comer Number of Hydrant per floor Hose box. 	Required	150mm	MR
		Required	Two	MR
		Required	Two	MR
12.	Yard Hydrants.			
	<ul style="list-style-type: none"> Total number of hydrants. Hose box. 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
13.	Pumping arrangements.			
	<ul style="list-style-type: none"> Ground Level <ul style="list-style-type: none"> Discharge of main pump. Head of main pump. Number of main pumps. Jockey Pump output. Jockey Pump head. Standby Pump output. Standby Pump head. Auto Starting/Manual Stopping. Terrace Level <ul style="list-style-type: none"> Discharge of pump. Head of pump. Power supply. Auto starting of pump. 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		450 LPM	Provided	MR
		35 mtr	Provided	MR
		Required	Provided	MR
		Required	Provided	MR
14.	Captive water storage for fire fighting.			
	<ul style="list-style-type: none"> Underground tank capacity. <ul style="list-style-type: none"> Draw-off connection. Fire Service Inlet. Access to tank. Overhead tank capacity. 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		Required	Provided	MR
		-NA-	-NA-	-NA-
		10,000 Ltr	10,000 Ltr	MR
15.	Exit Signage.	Required	Provided	MR.
16.	Provision of Lifts.			
	<ul style="list-style-type: none"> Pressurization of lift shaft. Pressurization of lift lobby. Communication in lift car. Fireman's switch. Lift signage. 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
17.	Standby Power Supply	-NA-	-NA-	-NA-
18.	Refuge Area			
	<ul style="list-style-type: none"> Total area Location 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-

19.	Fire Control Room.	• Detector system panel.	-NA-	-NA-	-NA-
		• Flow switch panel.	-NA-	-NA-	-NA-
		• PA system panel.	-NA-	-NA-	-NA-
		• Battery backup.	-NA-	-NA-	-NA-
		• Building floor plan.	-NA-	-NA-	-NA-
		20.	Special Fire Protection System for the Protection of special Risk, if any.	-NA-	-NA-

The fire protection system provided in the building / premises were test checked at random and found functional at the time of inspection.


Keeping in view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules, the FSC issued vide letter No. F6/DFS/MS/School/2015/SZ/2120 dated 02/12/2015, renewal under rule 37 of the Delhi Fire Service Rules, 2010 is recommended.

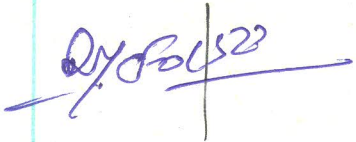
Accordingly DFA is put up for approval and signature please.



 Signature of the Inspecting Officer
 Name: Mehmood
 Design: ADO (SJ)


Red Roses Public School at D-Block, Saket, New Delhi-110017

DO (SD)

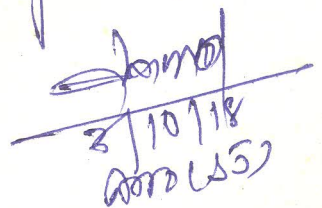

25/9/18



25/9/18


25/9

CFO s/p m.scell 
28/9

A B-1 letter put up for signature please


3/10/18
ADO (SJ)

CFO s/p m.scell 
4/10



88/CFO S2
S/A.