

FORM 'H'
FORM FOR ISSUING FIRE SAFETY CERTIFICATE
[Refer sub - rule (1) of rule 35]
GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE, CONNAUGHT PLACE
NEW DELHI

No. F6/DFS/MS/SCHOOL/WZ/2018/ 2259

Dated: / 05/10 /2018

FIRE SAFETY CERTIFICATE

Certified that the **Muni Mayaram Jain Model School**, Located at, **2nd & 3rd Floors, 2541, Jain Dharamshala, Jain Sathanak Marg, Tri Nagar Delhi-110035**. In a building comprised of, Ground+03 Upper Floor, was issued FSC vide Letter No. F6/DFS/MS/2010/2697, Dated-17/09/2010. The premises was re inspected by the officer concerned of this department on 18-09-2018 in the presence of **Ms. Ranu Bhandual (Principal)** and observed that all the fire prevention and fire safety arrangements provided in the premises found in good working condition. The premises have therefore deem complied with the fire prevention and fire safety requirements in accordance Circular 262-362 Dated 17-01-2005 and that the premises is fit for occupancy class "Educational" Group B(2nd & 3rd Floors) with effect from 05/10/18 for a period of **three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 05/10/18 at New Delhi by:


(Atul Garg)

Chief Fire Officer
Delhi Fire Service

Copy to:

1. The Principal, Muni Mayaram Jain Model School, 2541, Jain Dharamshala, Jain Sathanak Marg, Tri Nagar Delhi-110035.
2. Directorate of Education Old Secretariat Delhi – 110054

Following fire safety directives must be adhered to:-

1. All the fire safety arrangements provided therein shall be maintained in good working condition at all times.
2. Any loss of life or property due to non-functional fire safety measures shall be at the risk and responsibility of the management.
3. The trained staff should be available round the clock.
4. Any deviations w.r.t. construction shall be verified by the concerned building sanctioning agency.
5. The certificate may not be treated in any case for the regularization of the unauthorized construction, if any.
6. All the exit route shall be kept free from any obstruction.
7. The owner/ occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this certificate, six months prior to its expiry.
8. The owner/occupier shall submit a declaration every year in the form 'K' provided in the first schedule of Delhi Fire Service Rules 2010, form is available on www.dfs.delhigovt.nic.in.

INSPECTION REPORT

1. Name & address of the building: **Muni Mayaram Jain Model School**
Located at, **2541, Jain Dharamshala, Jain Sathanak Marg, Tri Nagar Delhi-110035.**
2. Type of Occupancy : Educational (Ground+03 Upper Floor)
Running School Activate at 2nd & 3rd Upper Floors.
3. Type of Case : Renewal
4. Details of previous NOC : F6/DFS/MS/2010/2697,Dated-17/09/2010
5. Fire Safety directives Letter No. : DOE Circular 262-362 Dated 17-01-2005
6. Date of inspection :18/09/2018
7. Name of the Inspecting Officer :Udai vir singh, ADO (WP)
8. Name and designation of Officer
from the building side :Ms. Ranu Bhandual (Principal)
9. Year of Construction : 1989
10. Applicant's letter No. :Nil dated 17/07/2018

No. of Students=123
No. of class rooms=10
Plot area=200 sqy
Covered area=200 sqy

S No	Minimum standards on fire prevention and fire safety U/R 33	DOE Circular 262-362 Dated 17-01-2005	Provided at site	Remarks MR/NMR
1.	Access of building			
	<ul style="list-style-type: none"> • Road width • Gate width • Width of internal road 	<ul style="list-style-type: none"> Accessible Accessible NA 	<ul style="list-style-type: none"> 6m Provided Provided(On Road) NA 	<ul style="list-style-type: none"> MR MR NA
2.	Number, width, Type & Arrangements of exits			
	<ul style="list-style-type: none"> a. Number of staircases <ul style="list-style-type: none"> • Upper floors • Basements b. Width of staircases <ul style="list-style-type: none"> • Upper floors • Basements c. Protection of exits <ul style="list-style-type: none"> • Fire check door • Pressurization d. No of continuous staircase to terrace e. Width Of Corridor f. Door Size 	<ul style="list-style-type: none"> 1 NA 1x1.5mtrs NA NA NA NA 1 Required 1 m 	<ul style="list-style-type: none"> 2 Provided NA Provided1x114cm&1x95cm NA NA NA NA Provided 160cm Provided 98cm (Old case) 	<ul style="list-style-type: none"> MR NA MR(Being old case) NA NA MR MR MR MR
3.	Compartmentation			
	<ul style="list-style-type: none"> • Fire check door • Sealing of electrical shafts • Fire Rating of shaft door • Water Curtain • Fire Dampers 	<ul style="list-style-type: none"> NA NA NA NA NA 	<ul style="list-style-type: none"> NA NA NA NA NA 	<ul style="list-style-type: none"> NA NA NA NA NA


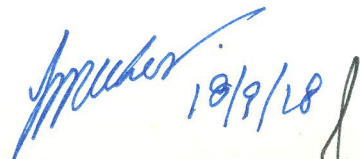


4.	Smoke managements Syst.			
	<ul style="list-style-type: none"> Basements Upper floors 	NA	NA	NA
		NA	NA	NA
5.	Fire Extinguishers			
	<ul style="list-style-type: none"> Total numbers Types IS marking 	04 nos. ABC & CO ₂ ISI marked	Provided	MR
			Provided	MR
			Provided	MR
6.	First – Aid Hose Reels			
	<ul style="list-style-type: none"> Total numbers on each floor Length of hose reel hose Nozzle diameter 	1	Provided	MR
		30m	Provided	MR
		5mm	Provided	MR
7.	Automatic fire detection and alarming system			
	<ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooters' Location 	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
8.	MOEFA	Required	Provided	MR
9.	Public Address System	Required	Provided	MR
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> Basements Upper Floor Sprinkler above false ceiling 	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
11.	Internal Hydrants:			
	<ul style="list-style-type: none"> Size of riser/down-comer Number of hyd/floor Hose Box 	1	Provided	MR
		1	Provided	MR
		1	Provided	MR
12.	Yard Hydrants			
	<ul style="list-style-type: none"> Total number of hydrants Hose Box 	NA	NA	NA
		NA	NA	NA
13.	Pumping Arrangements:			
	<ul style="list-style-type: none"> Ground Level Discharge of main pump ➤ Head of main pump ➤ Number of main pumps ➤ Jockey pump out put ➤ Jockey pump head ➤ Standby Pump out put ➤ Standby Pump Head Auto Staring/Manual stopping ➤ Pump House Access Terrace level ➤ Discharge of pump ➤ Head of the pump ➤ Power supply ➤ Auto starting of pump 	NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		NA	NA	NA
		450 LPM & 180 LPM	Provided	MR
		40Mtr	Provided	MR
		Required	Provided	MR
		Required	Provided	MR

14.	Captive water Storage for firefighting:			
	• Underground tank capacity	NA	NA	NA
	➤ Draw off connection	NA	NA	NA
	➤ Fire service inlet	NA	NA	NA
	➤ Access to tank	NA	NA	NA
	• Overhead Tank capacity	5000Ltr	Provided	MR
15	Exit Signage	Required	Provided	MR
16.	Provision of Lifts			
	➤ Pressurization of Lift Shaft	NA	NA	NA
	➤ Pressurization of lift lobby	NA	NA	NA
	➤ Communication in lift Car	NA	NA	NA
	➤ Fireman's Grounding Switch	NA	NA	NA
	➤ Lift Signage	NA	NA	NA
17.	Standby power supply	NA	NA	NA
18.	Refuge Area			
	➤ Total area	NA	NA	NA
	➤ Location	NA	NA	NA
19.	Fire control room			
	➤ Detector system panel	NA	NA	NA
	➤ Flow Switch Panel	NA	NA	NA
	➤ PA System Panel	NA	NA	NA
	➤ Battery backup	NA	NA	NA
	➤ Building Floor Plans			
20.	Special Fire Protection Systems for Protection of special Risks, if any;	NA	NA	NA

The fire protection systems provided in the building were test checked and found functional at the time of inspection.

In view of the deemed compliance of minimum standards on fire prevention and fire safety as required under the rules the NOC issued vide letter no. : F6/DFS/MS/2010/2697, Dated-17/09/2010 renewal under rule 35 of the Delhi Fire Service Rules 2010 is recommended.


Signature of the Inspecting Officer
Name Udai Vir Singh
Designation ADO/WP


 18/9/18

 20/9/18