

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI - 110 001

No. F.6/DFS/MS/Industrial/SZ/2018/ 2149

Dated: 5/10/18

FIRE SAFETY CERTIFICATE

Certified that the building situated at **Supreme Impex** situated at **D-6/5, Okhla, Industrial Area, Phase-II, New Delhi-110020** is comprised of Basement, Ground & Two Upper Floors was granted FSC by this department vide letter No. F6/DFS/MS/Indl/2014/SZ/1529 dated 08/12/2014 for Basement, Ground & 1st Floor. The premises was re- inspected by the officer concerned of this department on 27/09/2018 in the presence of Mr. Prabhu (Maintenance Incharge) and found that the **Basement, Ground & 1st Floor** of the said Industrial building have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the above mentioned floors of the building is fit for occupancy class "**Group G Industrial building**" with effect from 5/10/2018 for a period of **three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule-38 of the Delhi Fire Service Rules, 2010.

Issued on.....5/10/18.....at New Delhi by.


(Vipin Kental)
Chief Fire Officer
Tel: 011-23412225

Copy to:-

1. The Executive Engineer (Bldg.), SDMC, Jal Vihar, Lajpat Nagar, New Delhi-110024.
2. Sh. Prem Singh Rana, Supreme Impex, D-6/5, Okhla, Industrial Area, Phase-II, New Delhi-110020

Conditions for the validity of fire safety certificate:

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of firefighting system.
4. The owner/ occupier shall submit a declaration **every year** in **Form 'K'** provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on http://delhi.gov.in/wps/wcm/connect/doit_fire/FIRE/Home/Forms
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL-2016), if any.
6. "The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in **Form 'J'** [sub rule (1) of rule 37] along with a copy of this Certificate, **six months** prior to its expiry."

INSPECTION REPORT

1. Name & address of the building : Supreme Impex, D-6/5, Okhla, Industrial Area, Phase-II, New Delhi-20
2. Type of Occupancy : Industrial "Group-G"
3. Type of Case : Renewal
4. Details of Previous NOC : F6/DFS/MS/Indl./2014/SZ/1529 dated 08/12/2014 (Basement, GF & 1st F)
5. Fire Safety directives letter No : F6/DFS/MS/2007/2376 dated 27/08/2007 (Basement & Ground Floor)
F6/DFS/MS/BP/2015/504 dated 11/03/2015 (Basement, GF, 1st F & 2nd F)
6. Date of inspection : 27/09/2018
7. Name of Inspecting Officer : A. K. Malik
8. Name and designation of officer from the building side : Mr. Prabhu (Maintenance Incharge)
9. Year of Construction : Before 2005 & 2014 [**Basement + Ground + 2 Upper Floors**]
10. Applicant's letter No. : outdoor diary no. 12282 dated 29/08/2018

S. No.	Minimum Standards on fire prevention and fire safety U/R 33	BBL/NBC Requirement	Provided at site	Remarks MR/NMR
1.	Access to building			
	<ul style="list-style-type: none"> • Road width • Gate width • Width of internal road 	12m 4.5m NA	Provided Abut on Road NA	MR MR NA
2.	Number, Width, Type & Arrangement of Exits			
	a. Number of staircases			
	<ul style="list-style-type: none"> • Upper Floors • Basements 	Two Two	Provided Provided	MR MR
	b. Width of staircases			
	<ul style="list-style-type: none"> • Upper Floor • Basements 	1.2m 1.2m	1.2m & 1.04m 1.2m & 1m	MR (old case) NMR
	c. Protection of exits			
	<ul style="list-style-type: none"> • Fire check door • Pressurization 	Required NA Two	Provided NA Two	MR (old case) NA MR
	d. No. of continuous staircases to terrace	NA	NA	NA
	e. Width of Corridor	1.25m	Provided (final exit)	MR
	f. Door Size			
3.	Compartmentation			
	<ul style="list-style-type: none"> • Fire check door • Sealing of electrical shafts • Fire Rating of shaft door • Water Curtain • Fire Dampers 	Required Required NA NA NA	Provided Provided NA NA NA	MR MR NA NA NA
4.	Smoke Management System			
	<ul style="list-style-type: none"> • Basements • Upper floors 	Required Required	Exhaust Fan Natural Ventilation	MR MR
5.	Fire Extinguishers			
	<ul style="list-style-type: none"> • Total numbers • Types • IS marking 	26 No's ABC/W.CO2/CO2 ISI marked	Provided 10/10/6 Provided	MR MR MR
6.	First-Aid Hose Reels			
	<ul style="list-style-type: none"> • Total numbers on each floor • Length of hose reel hose • Nozzle diameter 	1 No's 30m 5mm	1 No's Provided Provided	MR MR MR
7.	Automatic fire detection and alarming system			
	<ul style="list-style-type: none"> • Type of detectors • Location of Main Panel • Location of Repeater Panel 	Smoke & Heat Ground Floor NA Required	Provided Main Gate NA Provided	MR MR NA MR

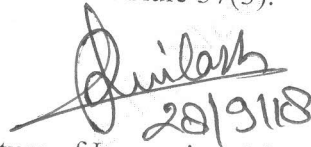
Protection of special Risks, if any:

provided near electric panel


Note:

The requirement of staircase width is revised as approved by the competent authority in last addition/alteration while renewal of NOC dated 25/03/2008 as the applicant in response to the letter dated 08/05/2018 (C/47) submitted an undertaking (C/55). The fire protection systems provided in the building were randomly tested, checked and found functional at the time of inspection. The shortcomings (except sr. no.1) communicated vide letter no. F6/DFS/MS/Ind./SZ/2017/3466 dated 22/12/2017 (C/42) found complied.

Keeping in view of the above substantial compliance of the minimum standards of fire prevention and fire safety measures as required under the rules it is recommended under Rule 37(2) to grant Fire Safety Certificate for Basement, Ground & 1st Floor only. Accordingly form 'H' in shape of DFA is put up for approval under Rule 37(3).


Signature of Inspecting Officer
Name: A. K. Malik
Designation: DO (SD)

Dy. CFO (SZ)



28/9

CFO syf

Miscell

FTM
u
3/x

Syfy f.p. is put up for bis please.


28/9/18
DO (SD)

CFO (SZ)

M. scull

u
ST10



62/CFO SL
31/9/18/SYD