

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS, DELHI FIRE SERVICE, CONNAUGHT PLACE
NEW DELHI-110001



No. F.6/DFS/MS/EH/SZ/2018/ 2300

Dated: 11/10/18

FIRE SAFETY CERTIFICATE

Certified that M/s **Aroma of Pind Restaurant** (A Unit of Aashirwad Hospitality Concept Pvt. Ltd) located at ground floor A-38, M.C.I.E, Mathura Road, New Delhi of a building comprised of basement, ground and one upper floor was issued Fire Safety Certificate by this department vide letter No. F6/DFS/MS/EH/2015/SZ/1719 dated 18/09/2015. The restaurant was re-inspected by the officer concerned of this department on 28/09/2018 in the presence of Mr. Vijay Rana of the restaurant and found that the said premises have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the premises is fit for occupancy class "**Assembly, Group-D**" (Eating House) with effect from 11/10/18 2018 for a period of **three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 11/10/18 at New Delhi by


(Vipin Kental)
Chief Fire Officer
Ph: 011-23412225


Copy to: -

1. Partner M/s Aroma of Pind Restt at GF, A-38, M.C.I.E, Mathura Road, New Delhi-110044
2. The DHO (CNZ), South MCD, Public Health Department, Lajpat Nagar, New Delhi-24

Conditions for the validity of Fire Safety Certificate: -

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire fighting system.
4. The owner/occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL-2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry.

INSPECTION REPORT				
1	Name & Address of the Building	M/s Aroma of Pind Restaurant (A Unit of Ashirwad Concept Hospitality Pvt. Ltd) at Ground Floor, A-38, M.C.I.E, Mathura Road, New Delhi-110044		
2	Type of Occupancy	Assembly, "Group-D" (Eating House)		
3	Building Comprised of	Basement, Ground plus one upper floor.		
4	Type of Case	Renewal		
5	Details of Previous NOC	F6/DFS/MS/EH/2015/SZ/1719 Dated 18/09/2015		
6	Fire Safety Directives Letter No	Nil.		
7	Date of Inspection	28-09-2018		
8	Name of the Inspecting Officers	Mehmood, ADO (SJ)		
9	Name & Designation of Officers from the building side	Mr. Vijay Rana		
10	Year of construction	1975	Restaurant located at ground floor only.	
11	Applicant letter No.	Outdoor Diary No. 12049 Dated 24-08-2018		
S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC requirements	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	• Road width	6 mts	Provided	MR
	• Gate width	-NA-	Accessible from road	-NA-
	• Width of internal road	-NA-	-NA-	-NA-
2	Number, width, type & arrangement of exits.			
	a) Number of Staircase			
	➤ Upper floors.	-NA-	-NA-	-NA-
	➤ Basement floor.	-NA-	-NA-	-NA-
	b) Width of Staircase			
	➤ Upper floors	-NA-	-NA-	-NA-
	➤ Basement floor	-NA-	-NA-	-NA-
	c) Protection of exits			
	➤ Fire check door	-NA-	-NA-	-NA-
	➤ Pressurization	-NA-	-NA-	-NA-
	d) No. of continuous staircase to terrace	-NA-	-NA-	-NA-
	e) Width of corridor	-NA-	-NA-	-NA-
	f) Door size	1.5 mts	1.5m x 2 Nos	MR
3	Compartmentation.			
	• Fire check door.	-NA-	-NA-	-NA-
	• Sealing of electrical shafts.	-NA-	-NA-	-NA-
	• Fire rating of shaft door.	-NA-	-NA-	-NA-
	• Water curtain	-NA-	-NA-	-NA-
	• Fire dampers.	-NA-	-NA-	-NA-
4.	Smoke Management system.			
	• Basement	30 ACPH	-NA-	-NA-
	• Upper floors / Restt. Area	12 ACPH	Exhaust fan provided	MR
5.	Fire Extinguishers.			
	• Total numbers	Required	08 Nos	MR
	• Types	ABC/CO2	ABC & CO2	MR
	• ISI Marking	ISI marked	Provided	MR
6.	First Aid Hose Reels.			
	• Total numbers on each floor.		02 Nos	MR
	• Length of hose-reel hose.	Hose-reels	Provided	MR
	• Nozzle Diameter		Provided	MR

M/s Aroma of Pind Restt at GF, A-38, M.C.I.E, Mathura Road, New Delhi-110044

7	Automatic fire detection & alarming system.			
	• Type of detectors	Required	Smoke & Heat	MR
	• Location of Main Panel	Required	Ground floor	MR
	• Location of Repeater Panel	-NA-	-NA-	-NA-
	• Alternate source of power	Required	Provided	MR
	• Hooter's location	Required	Provided	MR
8.	MOEFA	Required	Provided	MR
9.	Public Address System	-NA-	-NA-	-NA-
10.	Automatic Sprinkler System			
	• Basement	-NA-	-NA-	-NA-
	• Upper floors.	-NA-	-NA-	-NA-
	• Sprinkler above false ceiling	-NA-	-NA-	-NA-
11.	Internal Hydrants.			
	• Size of Riser/Down-comer	Required	100 mm	MR
	• Number of Hydrant per floor	Required	Provided	MR
	• Hose box.	Required	Provided	MR
12.	Yard Hydrants.			
	• Total number of hydrants.	-NA-	-NA-	-NA-
	• Hose box.	-NA-	-NA-	-NA-
13.	Pumping arrangements.			
	• Ground Level			
	➤ Discharge of main pump.	-NA-	-NA-	-NA-
	➤ Head of main pump.	-NA-	-NA-	-NA-
	➤ Number of main pumps.	-NA-	-NA-	-NA-
	➤ Jockey Pump output.	-NA-	-NA-	-NA-
	➤ Jockey Pump head.	-NA-	-NA-	-NA-
	➤ Standby Pump output.	-NA-	-NA-	-NA-
	➤ Standby Pump head.	-NA-	-NA-	-NA-
	➤ Auto Starting / Manual Stopping.	-NA-	-NA-	-NA-
	➤ Pump house access.	-NA-	-NA-	-NA-
	• Terrace Level			
	➤ Discharge of pump.	450 LPM	Provided	MR
	➤ Head of pump.	40m	Provided	MR
	➤ Power supply.	Required	Provided	MR
	➤ Auto starting of pump.	Required	Provided	MR
14.	Captive water storage for fire fighting.			
	• Underground tank capacity.	-NA-	-NA-	-NA-
	➤ Draw-off connection.	-NA-	-NA-	-NA-
	➤ Fire Service Inlet.	-NA-	-NA-	-NA-
	➤ Access to tank.	-NA-	-NA-	-NA-
	• Overhead tank capacity.	10,000 Ltr	Provided	MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			
	• Pressurization of lift shaft.	-NA-	-NA-	-NA-
	• Pressurization of lift lobby.	-NA-	-NA-	-NA-
	• Communication in lift car.	-NA-	-NA-	-NA-
	• Fireman's switch.	-NA-	-NA-	-NA-
	• Lift signage.	-NA-	-NA-	-NA-
17.	Standby Power Supply	Required	Provided	MR
18.	Refuge Area			
	• Total area	-NA-	-NA-	-NA-
	• Location	-NA-	-NA-	-NA-


M/s Aroma of Pind Restt at GF, A-38, M.C.I.E, Mathura Road, New Delhi-110044

19.	Fire Control Room.	• Detector system panel.	-NA-	-NA-	-NA-
		• Flow switch panel.	-NA-	-NA-	-NA-
		• PA system panel.	-NA-	-NA-	-NA-
		• Battery backup.	-NA-	-NA-	-NA-
		• Building floor plan.	-NA-	-NA-	-NA-
20.	Special Fire Protection System for the Protection of special Risk, if any.	Required	ABC type fire extinguishers provided for electrical panel	MR	

The fire protection system provided in the building/ premises were test checked at random and found functional at the time of inspection.


Keeping in view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules, the FSC issued vide letter No. F6/DFS/MS/EH/2015/SZ/1719 Dated 18/09/2015, renewal under rule 37 of the Delhi Fire Service Rules 2010, is recommended.


Accordingly DFA is put up for approval and signature please.


 Signature of the Inspecting Officer
 Name: Mehmood
 Design: ADO (SJ)

M/s Aroma of Pind Restt at GF, A-38, M.C.I.E, Mathura Road, New Delhi-110044

DO (SD)


4/10/18




4/10



CGO 15/11


m-scell

FTM

W
STP

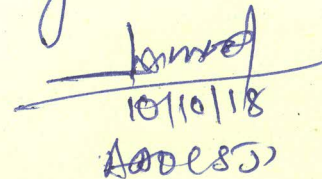
95/cfo/sz
11/10

A. r. z letter put up for signature please



m-scell

W
10/10


10/10/18
Address