

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE  
NEW DELHI-110001


No. F.6/DFS/MS/School/2018/SZ/ 2217

Dated: 3/10/18

**FIRE SAFETY CERTIFICATE**

Certified that **Kalashram School of Dance & Drama** located Opp. B-108, Gulmohar Park, New Delhi-110049, comprised of ground plus two upper floors owned/occupied by Kalashram Art Institute Management have complied with the fire prevention and fire safety requirements in accordance with rule 33 of Delhi Fire Service Rules, 2010 and verified by officer concern of this department on 05/09/2018 in the presence of Mr. Atul Sharma (Manager) and that the building/premises is fit for occupancy class "**Educational**" Group-B, as above with effect from the date of issue of this certificate for period of **Three years** in accordance with Rule 36 unless renewed under Rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under Rule 38 of the Delhi Fire Service Rules, 2010.

Issued 3/10/18 at New Delhi by

  
(Vipin Kental)  
Chief Fire Officer  
Tel: 011-23412225

Copy to: -

1. Secretary, Kalashram School of Dance & Drama, Opp. B-108, Gulmohar Park, New Delhi.

**Conditions for the validity of Fire Safety Certificate:**

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire fighting system.
4. The owner/occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in)
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL- 2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry.

## INSPECTION REPORT

S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	NBC / UBBL requirements	Provided at Site	Remarks MR/NMR
1	Name & Address of the Building	KALASHRAM SCHOOL OF DANCE & DRAMA, OPP. B-108, GULMOHAR PARK, NEW DELHI-49		
2	Type of Occupancy	Educational, Group-B (Institute)		
3	Building Comprised of	Ground + 02 upper floors.		
4	Type of Case	New		
5	Details of Previous NOC	Nil		
6	Fire Safety Directives Letter No	Nil		
7	Date of Inspection	05-09-2018		
8	Name of the Inspecting Officers	Mehmood, ADO (SJ)		
9	Name & Designation of Officers from the building side	Mr. Atul Sharma (Manager)		
10	Year of construction	2018		
11	Applicant letter No.	Outdoor Diary No. 11681 dated 16-08-2018		
<b>1</b>	<b>Access to Building.</b>			
	<ul style="list-style-type: none"> <li>Road width</li> <li>Gate width</li> <li>Width of internal road</li> </ul>	As per MPD	9 mtr	MR
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
<b>2</b>	<b>Number, width, type &amp; arrangement of exits.</b>			
	<b>a) Number of Staircase</b>			
	➤ Upper floors.	02 Nos	Provided	MR
	➤ Basement floor.	-NA-	-NA-	-NA-
	<b>b) Width of Staircase</b>			
	➤ Upper floors	1.5 mtr	1.5m each	MR
	➤ Basement floor	-NA-	-NA-	-NA-
	<b>c) Protection of exits</b>			
	➤ Fire check door	-NA-	-NA-	-NA-
	➤ Pressurization	-NA-	-NA-	-NA-
	<b>d) No. of continuous staircase to terrace</b>	One	Provided	MR
	<b>e) Width of corridor</b>	-NA-	-NA-	-NA-
	<b>f) Door size</b>	1.2m	Provided	MR
<b>3</b>	<b>Compartmentation.</b>			
	<ul style="list-style-type: none"> <li>Fire check door.</li> <li>Sealing of electrical shafts.</li> <li>Fire rating of shaft door.</li> <li>Water curtain</li> <li>Fire dampers.</li> </ul>	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
<b>4.</b>	<b>Smoke Management system.</b>			
	<ul style="list-style-type: none"> <li>Basement</li> <li>Upper floors</li> </ul>	30 ACPH	-NA-	-NA-
		12 ACPH	Natural Ventilation	MR
<b>5.</b>	<b>Fire Extinguishers.</b>			
	<ul style="list-style-type: none"> <li>Total numbers</li> <li>Types</li> <li>ISI Marking</li> </ul>	04 Nos	08 Nos	MR
		ABC / CO2	CO2 & ABC type	MR
		ISI marked	Provided	MR
<b>6.</b>	<b>First Aid Hose Reels.</b>			
	<ul style="list-style-type: none"> <li>Total numbers on each floor.</li> <li>Length of hose-reel hose.</li> <li>Nozzle Diameter</li> </ul>	One	Provided	MR
		30m	Provided	MR
		5mm	Provided	MR


Kalashram School of Dance &amp; Drama, Opp. B-108, Gulmohar Park, New Delhi-110049

<b>7.</b>	<b>Automatic fire detection &amp; alarming system.</b>			
	• Type of detectors	-NA-	-NA-	-NA-
	• Location of Main Panel	-NA-	-NA-	-NA-
	• Location of Repeater Panel	-NA-	-NA-	-NA-
	• Alternate source of power	-NA-	-NA-	-NA-
	• Hooter's location	-NA-	-NA-	-NA-
<b>8.</b>	<b>MOEFA</b>	-NA-	-NA-	-NA-
<b>9.</b>	<b>Public Address System</b>	-NA-	-NA-	-NA-
<b>10.</b>	<b>Automatic Sprinkler System</b>			
	• Basement	-NA-	-NA-	-NA-
	• Upper floors	-NA-	-NA-	-NA-
	• Sprinkler above false ceiling	-NA-	-NA-	-NA-
<b>11.</b>	<b>Internal Hydrants.</b>			
	• Size of Riser/Down-comer	-NA-	-NA-	-NA-
	• Number of Hydrant per floor	-NA-	-NA-	-NA-
	• Hose box.	-NA-	-NA-	-NA-
<b>12.</b>	<b>Yard Hydrants.</b>			
	• Total number of hydrants.	-NA-	-NA-	-NA-
	• Hose box.	-NA-	-NA-	-NA-
<b>13.</b>	<b>Pumping arrangements.</b>			
	• <b>Ground Level</b>			
	➤ Discharge of main pump.	-NA-	-NA-	-NA-
	➤ Head of main pump.	-NA-	-NA-	-NA-
	➤ Number of main pumps.	-NA-	-NA-	-NA-
	➤ Jockey Pump output.	-NA-	-NA-	-NA-
	➤ Jockey Pump head.	-NA-	-NA-	-NA-
	➤ Standby Pump output.	-NA-	-NA-	-NA-
	➤ Standby Pump head.	-NA-	-NA-	-NA-
	➤ Auto Starting / Manual Stopping.	-NA-	-NA-	-NA-
	➤ Pump house access.	-NA-	-NA-	-NA-
	• <b>Terrace Level</b>			
	➤ Discharge of pump.	450 LPM	Provided	MR
	➤ Head of pump.	40 mtr	Provided	MR
	➤ Power supply.	Required	Provided	MR
	➤ Auto starting of pump.	Required	Provided	MR
<b>14.</b>	<b>Captive water storage for fire fighting.</b>			
	• Underground tank capacity.	-NA-	-NA-	-NA-
	➤ Draw-off connection.	-NA-	-NA-	-NA-
	➤ Fire Service Inlet.	-NA-	-NA-	-NA-
	➤ Access to tank.	-NA-	-NA-	-NA-
	• Overhead tank capacity.	10,000 Ltr	Provided	MR
<b>15.</b>	<b>Exit Signage.</b>	Required	Provided	MR
<b>16.</b>	<b>Provision of Lifts.</b>			
	• Pressurization of lift shaft.	-NA-	-NA-	-NA-
	• Pressurization of lift lobby.	-NA-	-NA-	-NA-
	• Communication in lift car.	-NA-	-NA-	-NA-
	• Fireman's switch.	-NA-	-NA-	-NA-
	• Lift signage.	-NA-	-NA-	-NA-
<b>17.</b>	<b>Standby Power Supply</b>	-NA-	-NA-	-NA-
<b>18.</b>	<b>Refuge Area</b>			
	• Total area	-NA-	-NA-	-NA-
	• Location	-NA-	-NA-	-NA-

19.	<b>Fire Control Room.</b>	• Detector system panel.	-NA-	-NA-	-NA-
		• Flow switch panel.	-NA-	-NA-	-NA-
		• PA system panel.	-NA-	-NA-	-NA-
		• Battery backup.	-NA-	-NA-	-NA-
		• Building floor plan.	-NA-	-NA-	-NA-
20.	<b>Special Fire Protection System for the Protection of special Risk, if any.</b>	-NA-	ABC type fire extinguisher provided near electrical panel	-NA-	

The Fire protection systems provided in the building/premises were checked/ operated at random and found functional at the time of inspection. Keeping in view the substantial satisfactory compliance of the minimum standards on fire prevention and fire safety measures as required under the rules, it is recommended to issue Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules, 2010

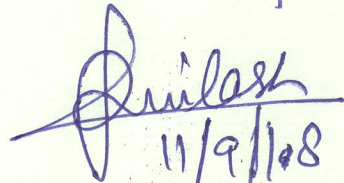
Accordingly DFA is put up for approval and signature please.

  
 Signature of the Inspecting Officer  
 Name: Mehmood  
 Design: ADO (SJ)

Kalashram School of Dance & Drama, Opp. B-108, Gulmohar Park, New Delhi-110049


DO (SD)

Generate the requirement as per VBBL-2016,  
1


  
 11/9/18

ADO  
SP

As per requirements of VBBL 2016, we  
generating the requirements,  
has submitted those

  
 28/9/18  
 ADO (SJ)

ADO (S)

  
 25/9/18

Dy. CPO (S2)

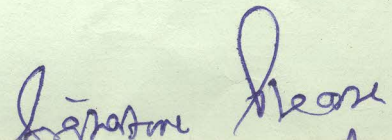
  
 25/9

FT M

CFO (S)

M.Scell

28/9





59/cfo S2  
11/11/18