

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI-110001**

No. F.6/DFS/MS/School/2018/SZ/ 2527

Dated: 14/11/18

FIRE SAFETY CERTIFICATE

Certified that the DAV Public School located at Plot No-3, Pocket-06, Jasola Vihar, New Delhi-110025 comprised of basement, ground plus two upper floors was granted Fire Safety Certificate by this department vide letter No. F.6/DFS/MS/2012/School/3349 dated 13/09/2012. The premises was re-inspected by officer concerned of this department on 26/10/2018 in presence of Mr. Jeevan Singh (Superintendent) and observed that the said School building have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the building/premises is fit for occupancy class "Educational Building" Group-B, with effect from the date of issue of this certificate for a period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 14/11/18 at New Delhi by

W. T. XI.
(Vipin Kental)
Chief Fire Officer

Copy to: -

1. The Principal, DAV Public School, Plot No-3, Pocket -06, Jasola Vihar, New Delhi- 110025
2. Directorate of Education, South MCD, Civic Centre, Minto Road, New Delhi-110002

Conditions for the validity of Fire Safety Certificate: -

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of firefighting system.
4. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL- 2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry.

N/-18

INSPECTION REPORT				
1	Name & Address of the Building	DAV Public School, Plot No-3, Pocket -06, Jasola Vihar, New Delhi- 110025		
2	Type of Occupancy	Educational, Group-B (School)		
3	Building Comprised of	Basement, Ground Plus Three Upper Floors		
4	Type of Case	Renewal		
5	Details of Previous NOC	F.6/DFS/MS/2012/School/3349 dated 13/09/2012.		
6	Fire Safety Directives Letter No	Nil		
7	Date of Inspection	26/10/2018		
8	Name of the Inspecting Officers	Mehmood, ADO (SJ)		
9	Name & Designation of Officers from the building side	Mr. Jeevan Singh (Superintendent)		
10	Year of construction	2004		
11	Applicant letter No.	DAV/PS/JV/1009 dated 01/10/2018		
S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC requirements	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	<ul style="list-style-type: none"> • Road width • Gate width • Width of internal road 	Required	17.5 mtr	MR
		6 mtr	6 mtr	MR
		-NA-	-NA-	-NA-
2	Number, width, type & arrangement of exits.			
	a) Number of Staircase			
	➤ Upper floors.	04 Nos	04 Nos	MR
	➤ Basement floor.	07 Nos	7 Nos	MR
	b) Width of Staircase			
	➤ Upper floors	1.5m	1.50 m each	MR
	➤ Basement floor	1.5m	1.50 m each	MR
	c) Protection of exits			
	➤ Fire check door	-NA-	-NA-	-NA-
	➤ Basement	Required	Provided	MR
	d) No. of continuous staircase to terrace	Required	Provided 02 nos	MR
	e) Width of corridor	1.5m	Provided	MR
	f) Door size	1 mtr	Provided	MR
3	Compartmentation.			
	<ul style="list-style-type: none"> • Fire check door. • Sealing of electrical shafts. • Fire rating of shaft door. • Water curtain • Fire dampers. 	Required	Provided	MR
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
4.	Smoke Management system.			
	<ul style="list-style-type: none"> • Basement • Upper floors 	30 ACPH	Exhaust Fan	MR
		12 ACPH	-NA-	-NA-
5.	Fire Extinguishers.			
	<ul style="list-style-type: none"> • Total numbers • Types • ISI Marking 	22 Nos	22 Nos	MR
		ABC/CO2	Provided	MR
		ISI mark	Provided	MR

6.	First Aid Hose Reels.			
	<ul style="list-style-type: none"> Total numbers on each floor. Length of hose-reel hose. Nozzle Diameter 	04 nos	Provided At each floor	MR
		30m	30m	MR
		5mm	5mm	MR
7	Automatic fire detection & alarming system.			
	<ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooter's location 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
8.	MOEFA	Required	Provided	MR
9.	Public Address System	Required	Provided	MR
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> Basement Upper floors Sprinkler above false ceiling 	Required	Provided	MR
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
11.	Internal Hydrants.			
	<ul style="list-style-type: none"> Size of Riser/Down-comer Number of Hydrant per floor Hose box. 	100mm	Provided 02 nos	MR
		02 nos	Provided	MR
		02 nos	Provided	MR
12.	Yard Hydrants.			
	<ul style="list-style-type: none"> Total number of hydrants. Hose box. 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
13.	Pumping arrangements.			
	<ul style="list-style-type: none"> Ground Level <ul style="list-style-type: none"> Discharge of main pump. Head of main pump. Number of main pumps. Jockey Pump output. Jockey Pump head. Standby Pump output. Standby Pump head. Auto Starting / Manual Stopping. Pump house access. Terrace Level <ul style="list-style-type: none"> Discharge of pump. Head of pump. Power supply. Auto starting of pump. 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		900LPM,180LPM	900LPM,180 LPM	MR
		25 mtr	25 mtr each	MR
		Required	Provided	MR
		Required	Provided	MR
14.	Captive water storage for firefighting.			
	<ul style="list-style-type: none"> Underground tank capacity. <ul style="list-style-type: none"> Draw-off connection. Fire Service Inlet. Access to tank. Overhead tank capacity. 	50,000 liter	Provided	MR
		Required	Provided	MR
		Required	Provided	MR
		Required	Provided	MR
		20,000 Ltr	20,000 liter	MR
		Required	Provided	MR
15.	Exit Signage.			
16.	Provision of Lifts.			
	<ul style="list-style-type: none"> Pressurization of lift shaft. Pressurization of lift lobby. Communication in lift car. Fireman's switch. Lift signage. 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
17.	Standby Power Supply	Required	Provided	MR

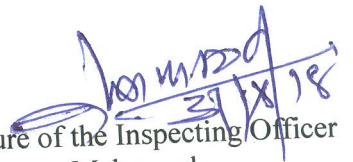
N/-20

18.	Refuge Area			
	• Total area	-NA-	-NA-	-NA-
	• Location	-NA-	-NA-	-NA-
19.	Fire Control Room.			
	• Detector system panel.	-NA-	-NA-	-NA-
	• Flow switch panel.	-NA-	-NA-	-NA-
	• PA system panel.	-NA-	-NA-	-NA-
	• Battery backup.	-NA-	-NA-	-NA-
	• Building floor plan.	-NA-	-NA-	-NA-
20.	Special Fire Protection System for the Protection of special Risk, if any.			

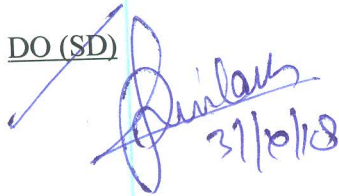
The fire protection system provided in the building / premises were test checked at random and found functional at the time of inspection.


Keeping in view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules, the FSC issued vide letter No. F.6/DFS/MS/2012/School/3349 dated 13/09/2012, renewal under rule 37 of the Delhi Fire Service Rules 2010, is recommended.

Accordingly DFA is put up for approval and signature please.



 Signature of the Inspecting Officer
 Name: Mehmood
 Design: ADO (SJ)

DO (SD)


 31/10/18


 31/10/18





 31/10
 M.S cell

F.M.

12/11/18

19/10/18
 12/11

A.O.T. Delhi for use for signature book


 12/11/18
 (SS)


 M.S cell
 12/11/18