

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI-110001

No. F.6/DFS/MS/GH/2018/SZ/ 2486

Dated: 8/11/18

FIRE SAFETY CERTIFICATE

Certified that M/s Dumpy's Inn located at B-1/16, Safdurjung Enclave, New Delhi-110029 comprised of Ground and two upper floors (ground floor-reception & 05 guest rooms, 1st & 2nd floor- 05 guest rooms each, total 15 guest rooms) was issued FSC by this department vide letter No. F6/MS/DFS/GH/2012/2873 dated 07-08-2012. The premises was re-inspected by officer concerned of this department on 19/10/2018 in the presence of Mr. Sanjeev Chadha (Manager) of the guest house and found that the said premises have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of Delhi Fire Service Rules, 2010 and that premises is fit for occupancy class "**Residential, Group-A**" (Lodging & Rooming House) as above with effect from the date of issue of this certificate for period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued 8/11/18 at New Delhi by


(Vipin Kental)
Chief Fire Officer
Ph: 011-23412225

Copy to: -

1. Dy. Health Officer, South MCD, Public Health Department, South Zone, Green Park, Aurobindo Marg, New Delhi-110016
2. M/s Dumpy's Inn at B-1/16, Safdarjung Enclave, New Delhi-110029

Conditions for the validity of Fire Safety Certificate:

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire fighting system.
4. The owner/occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL- 2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry.

INSPECTION REPORT


1	Name & Address of the Building	M/s Dumpy's Inn, B-1/16, Safdurjung Enclave, New Delhi-110029		
2	Type of Occupancy	Residential, "Group-A" (Guest House)		
3	Building Comprised of	Ground + 02 upper floors.		
4	Type of Case	Renewal		
5	Details of Previous NOC	F6/MS/DFS/GH/2012/2873 dated 07-08-2012		
6	Fire Safety Directives Letter No	Nil		
7	Date of Inspection	27-10-2018		
8	Name of the Inspecting Officers	Mehmood, ADO (SJ)		
9	Name & Designation of Officers from the building side	Mr. Sanjeev Chadha (Manager)		
10	Year of construction	1981	Ground floor (reception and 05 guest rooms, 1 st & 2 nd floor (05 rooms on each), Total- 15 Guest Rooms	
11	Applicant letter No.	DHO/SZ/2018/D.784 dated 13-08-2018		
S. No	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC requirements	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	<ul style="list-style-type: none"> • Road width • Gate width • Width of internal road 	Required -NA- -NA-	18 mtr -NA- -NA-	MR -NA- -NA-
2	Number, width, type & arrangement of exits.			
	a) Number of Staircase			
	➤ Upper floors.	Old Case	01 Nos	MR (Old Case)
	➤ Basement floor.	-NA-	-NA-	-NA-
	b) Width of Staircase			
	➤ Upper floors	Required	1.05m	MR(Old Case)
	➤ Basement floor	-NA-	-NA-	-NA-
	c) Protection of exits			
	➤ Fire check door	-NA-	-NA-	-NA-
	➤ Pressurization	-NA-	-NA-	-NA-
	d) No. of continuous staircase to terrace	Required	One	MR
	e) Width of corridor	-NA-	-NA-	-NA-
	f) Door size	1m	1m	MR
3	Compartmentation.			
	<ul style="list-style-type: none"> • Fire check door. • Sealing of electrical shafts. • Fire rating of shaft door. • Water curtain • Fire dampers. 	-NA- -NA- -NA- -NA- -NA-	-NA- -NA- -NA- -NA- -NA-	-NA- -NA- -NA- -NA- -NA-
4.	Smoke Management system.			
	<ul style="list-style-type: none"> • Basement • Upper floors 	30 ACPH 12 ACPH	-NA- Natural Ventilation	-NA- MR
5.	Fire Extinguishers.			
	<ul style="list-style-type: none"> • Total numbers • Types • ISI Marking 	Required ABC / CO2 ISI marked	11 Nos ABC & CO2 Provided	MR MR MR
6.	First Aid Hose Reels.			
	<ul style="list-style-type: none"> • Total numbers on each floor. • Length of hose-reel hose. • Nozzle Diameter 	One 30m 5mm	One 30m 5mm	MR MR MR

19.	Fire Control Room.	• Detector system panel.	-NA-	-NA-	-NA-
		• Flow switch panel.	-NA-	-NA-	-NA-
		• PA system panel.	-NA-	-NA-	-NA-
		• Battery backup.	-NA-	-NA-	-NA-
		• Building floor plan.	-NA-	-NA-	-NA-
20.	Special Fire Protection System for the Protection of special Risk, if any.	-NA-	-NA-	-NA-	

The fire protection system provided in the building / premises were test checked at random and found functional at the time of inspection.

Keeping in view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules, the FSC issued vide letter No. F6/MS/DFS/GH/2012/2873 dated 07-08-2012, renewal under rule 37 of the Delhi Fire Service Rules, 2010 is recommended.

Accordingly DFA is put up for approval and signature please.


 Signature of the Inspecting Officer
 Name: Mehmoed
 Design: ADO (SJ)

DO (SD)

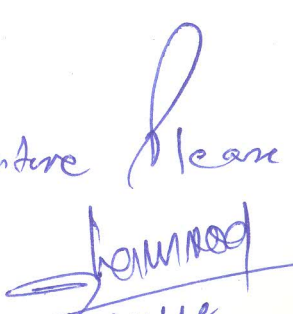


 29/11/18


 29/11/18

165/CF 52
31/X.15/11


 29/11/18



CFO-SP M.Scill FT/101
 A. G. T. Delhi put up for signature please

 29/11/18
 CFO-SP M.Scill FT/101

 29/11/18