

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEAD QUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI-110001

No. F.6 DFS/MS/CNG/2018/SZ/ 2485

Dated: 8/11/18

FIRE SAFETY CERTIFICATE

Certified that M/s Rajasthan Highway (CNG facility at existing RO) located at Plot No. 13/5, Delhi-Gurgaon Road, Kapashera Border, Samalka, New Delhi-110037, comprised of ground floor only have complied with the fire prevention and fire safety requirements in accordance with rule 33 of Delhi Fire Service Rules, 2010 and verified by officer concern of this department on 13/10/2018 in the presence of Mr. Anuj Yadav (Partner) and that the said premises is fit for occupancy class "**Hazardous, Group-J**" as above with effect from the date of issue of this certificate for period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 8/11/18 at New Delhi by


(Vipin Kental)
Chief Fire Officer
Ph. 011-23412225


Copy to: -

1. The Addl. Comm. of Police (Lic.), First floor, P.S. Defence Colony, New Delhi.-110049
2. Sh. Pradeep Ghosal, Chief Manager (Retail Services), Indian Oil Corporation Ltd, Delhi Division Office, World Trade Centre, Babar Road, New Delhi.
3. M/s Rajasthan Highway at Plot No. 13/5, Delhi-Gurgaon Road, Kapashera Border, Samalka, New Delhi-110037

Conditions for the validity of Fire Safety Certificate: -

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of firefighting system.
4. The owner/ occupier shall submit a declaration every year in Form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL-2016), if any.
6. "The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in Form 'J' [sub rule (1) of rule 37] along with a copy of this Certificate, six months prior to its expiry."

INSPECTION REPORT				
1	Name & Address of the Building	M/s Rajasthan Highway, Plot No-13/5, Delhi-Gurgaon Road, Kapashera Border, Samalka, New Delhi-110037 (Installation of CNG facility at existing RO)		
2	Type of Occupancy	Group-J Hazardous (CNG facility)		
3	Building Comprised of	Ground floor only.		
4	Type of Case	New		
5	Details of Previous NOC	Nil		
6	Fire Safety Directives Letter No	Nil		
7	Date of Inspection	13-10-2018		
8	Name of the Inspecting Officers	Mehmood (ADO/SJ)		
9	Name & Designation of Officers from the building side	Mr. Anuj Yadav (Partner)		
10	Year of construction	-NA-	Cascade-01, Compressor-01 & Dispenser-04	
11	Applicant letter No.			
S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	NBC / BBL Requirement	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	• Road width	9 mtr	Provided	MR
	• Gate width	N/A	N/A	N/A
	• Width of internal road	N/A	N/A	N/A
2	Number, width, type & arrangement of exits.			
	a) Number of Staircase			
	➤ Upper floors.	N/A	N/A	N/A
	➤ Basement.	N/A	N/A	N/A
	b) Width of Staircase			
	➤ Upper floors	N/A	N/A	N/A
	➤ Basement	N/A	N/A	N/A
	c) Protection of exits			
	➤ Fire check door	N/A	N/A	N/A
	➤ Pressurization	N/A	N/A	N/A
	d) No. of continuous staircase to terrace	N/A	N/A	N/A
	e) Width of corridor	N/A	N/A	N/A
	f) Door size	1m	Provided	MR
3	Compartmentation.			
	• Fire check door.	N/A	N/A	N/A
	• Sealing of electrical shafts.	N/A	N/A	N/A
	• Fire rating of shaft door.	N/A	N/A	N/A
	• Water curtain	N/A	N/A	N/A
	• Fire dampers.	N/A	N/A	N/A
4	Smoke Management system.			
	• Basement	N/A	N/A	N/A
	• Upper floors	N/A	N/A	N/A
5	Fire Extinguishers.			
	• Total numbers	Required	20 Nos	MR
	• Types	CO2/DCP	CO2 (50kg)-04, DCP (10kg)-10, CO2 (4.5kg)-06	MR
	• ISI Marking	ISI marked	Provided	MR
6	First Aid Hose Reels.			
	• Total numbers on each floor.	N/A	N/A	N/A
	• Length of hose-reel hose.	N/A	N/A	N/A
	• Nozzle Diameter	N/A	N/A	N/A

M/s Rajasthan Highway at Plot No-13/5, Delhi-Gurgaon Road, Kapashera Border, Samalka, New Delhi


7	Automatic fire detection & alarming system.			
	<ul style="list-style-type: none"> • Type of detectors • Location of Main Panel • Location of Repeater Panel • Alternate source of power • Hooter's location 	Gas & flame	Provided in compressors	MR
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		Required	Office	MR
8	MOEFA	N/A	N/A	N/A
9	Public Address System	N/A	N/A	N/A
10	Automatic Sprinkler System			
	<ul style="list-style-type: none"> • Basement • Upper floors • Sprinkler above false ceiling 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
11	Internal Hydrants.			
	<ul style="list-style-type: none"> • Size of Riser/Down-comer • Number of Hydrant per floor • Hose box. 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
12	Yard Hydrants.			
	<ul style="list-style-type: none"> • Total number of hydrants. • Hose box. 	N/A	N/A	N/A
		N/A	N/A	N/A
13	Pumping arrangements.			
	<ul style="list-style-type: none"> • Ground Level <ul style="list-style-type: none"> ➤ Discharge of main pump. ➤ Head of main pump. ➤ Number of main pumps. ➤ Jockey Pump output. ➤ Jockey Pump head. ➤ Standby Pump output. ➤ Standby Pump head. ➤ Auto Starting/Manual Stopping. ➤ Pump house access. • Terrace Level <ul style="list-style-type: none"> ➤ Discharge of pump. ➤ Head of pump. ➤ Power supply. ➤ Auto starting of pump. 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
14	Captive water storage for Fire Fighting.			
	<ul style="list-style-type: none"> • Underground tank capacity. <ul style="list-style-type: none"> ➤ Draw-off connection. ➤ Fire Service Inlet. ➤ Access to tank. • Overhead tank capacity. 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
15	No Smoking Signage.	Required	Provided in Hindi & English	MR
16	Provision of Lifts.			
	<ul style="list-style-type: none"> • Pressurization of lift shaft. • Pressurization of lift lobby. • Communication in lift car. • Fireman's switch. • Lift signage. 	N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
		N/A	N/A	N/A
17	Standby Power Supply	N/A	Provided DG Set	N/A
18	Refuge Area			
	<ul style="list-style-type: none"> • Total area • Location 	N/A	N/A	N/A
		N/A	N/A	N/A

19	Fire Control Room.				
		• Detector system panel.	N/A	N/A	N/A
		• Flow switch panel.	N/A	N/A	N/A
		• PA system panel.	N/A	N/A	N/A
		• Battery backup.	N/A	N/A	N/A
	• Building floor plan.	N/A	N/A	N/A	
20	Special Fire Protection System for the Protection of special Risk, if any.	Required	Co2 flooding system provided in compressor unit	MR	

The fire protection systems provided in the retail outlet area were checked/ tested at random and found functional at the time of inspection.

Keeping in view of the substantially satisfactory compliance of the minimum standards on fire prevention and fire safety measures as required under the rules, it is recommended to issue Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules, 2010

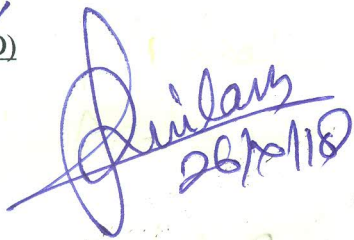
Accordingly DFA is put up for approval and signature please.



Signature of the Inspecting Officer
Name: Mehmood
Design: ADO (SJ)

M/s Rajasthan Highway at Plot No-13/5, Delhi-Gurgaon Road, Kapashera Border, Samalka, New Delhi

DO (SD)



26/10/18




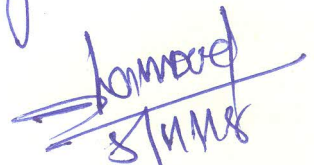
172/cfo s2
21/x. 15/11





CEO  m.scell  31/x.

A. B.T. Jethi  for Signature Please


21/10/18
ADO/SJ

 m.scell  31/x.