

GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS, DELHI FIRE SERVICE, NEW DELHI-110001

No. F.6/DFS/MS/EH/2018/SZ/ 2493

Dated: 8/11/18

FIRE SAFETY CERTIFICATE

Certified that M/s The GROGHEAD (A Unit of SAV Entertainment Company) running at second floor of a building comprised of basement, ground and 02 upper floors located at A-5, SF, Green Park, New Delhi owned/occupied by Unit of SAV Entertainment Company. The premises was inspected by the officer concerned of this department on 16-10-2018 in the presence of Mr. Manoj Pandey and found that the said restaurant have complied with the fire prevention and fire safety requirement in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the premises fit for occupancy class Group-D, Assembly Building (Restaurant) with effect from 8/11/2018 for a period of **three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules 2010.

Issued 8/11/18 at New Delhi by

W
S
K
(Vipin Kental)
Chief Fire Officer
Ph: 011-23412225

Copy to: -

1. M/s The GROGHEAD situated at A-5, 2nd Floor, Green Park, New Delhi-110016
2. DHO, South M.C.D, Public Health Department, South Zone, Aurobindo Marg, Green Park, New Delhi-110016

Conditions for the validity of Fire Safety Certificate:

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life property due to non- functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire fighting system.
4. The owner/occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or Alteration (Clause 1.4.3 of UBBL- 2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry.

INSPECTION REPORT				
1	Name & Address of the Building	The Groghead(Unit of SAV Entertainment Company), A-5,SF, Green Park, New Delhi		
2	Type of Occupancy	D, Assembly Building,(Restaurant)		
3	Building Comprised of	Basement, Ground + 02 upper floors, Restaurant is at Second floor.		
4	Type of Case	Renewal		
5	Details of Previous NOC	F.6/DFS/MS/EH/2015/SZ/1887 Dated 20-10-2015		
6	Fire Safety Directives Letter No	Nil		
7	Date of Inspection	16-10-2018		
8	Name of the Inspecting Officers	Mehmood, ADO (SJ)		
9	Name & Designation of Officers from the building side	Mr. Manoj Pandey (Manager)		
10	Year of construction	2009		
11	Applicant letter No.	Outdoor Diary No. 13665 Dated 24-09-2018		
S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC Requirement	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	• Road width	9 mtr	Provided	MR
	• Gate width	Abuts on Road	Approachable	-NA-
	• Width of internal road	-NA-	-NA-	-NA-
2	Number, width, type & arrangement of exits.			
	a) Number of Staircase			
	➤ Upper floors.	02	Provided	MR
	➤ Basement floor.	-NA-	-NA-	MR
	b) Width of Staircase			
	➤ Upper floors	1.5m	1.5m & 1.25m	MR (old case)
	➤ Basement floor	-NA-	-NA-	-NA-
	c) Protection of exits			
	➤ Fire check door	Required	Provided	MR
	➤ Pressurization	-NA-	-NA-	-NA-
	d) No. of continuous staircase to terrace	One	Provided 02 nos	MR
	e) Width of corridor	-NA-	-NA-	-NA-
	f) Door size	2m	Provided	MR
3	Compartmentation.			
	• Fire check door.	Required	Provided	MR
	• Sealing of electrical shafts.	Required	Provided	MR
	• Fire rating of shaft door.	-NA-	-NA-	-NA-
	• Water curtain	-NA-	-NA-	-NA-
	• Fire dampers.	-NA-	-NA-	-NA-
4.	Smoke Management system.			
	• Basement	30 ACPH	-NA-	-NA-
	• Upper floors	12 ACPH	Provided Exhaust Fans	MR
5.	Fire Extinguishers.			
	• Total numbers	Required	10 nos.	MR
	• Types	ABC / CO2	W.CO2 & ABC	MR
	• ISI Marking	ISI marked	Provided	MR
6.	First Aid Hose Reels.			
	• Total numbers on each floor.	01	Provided	MR
	• Length of hose-reel hose.	30m	Provided	MR
	• Nozzle Diameter	5mm	Provided	MR


The Groghead (Unit of SAV) Entertainment co. A-5 SF Green Park New Delhi

7	Automatic fire detection & alarming system.			
	<ul style="list-style-type: none"> • Type of detectors • Location of Main Panel • Location of Repeater Panel • Alternate source of power • Hooter's location 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
8.	MOEFA	Required	Provided	MR
9.	Public Address System	-NA-	-NA-	-NA-
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> • Basement • Upper floors • Sprinkler above false ceiling 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
11.	Internal Hydrants.			
	<ul style="list-style-type: none"> • Size of Riser/Down-comer • Number of Hydrant per floor • Hose box. 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
12.	Yard Hydrants.			
	<ul style="list-style-type: none"> • Total number of hydrants. • Hose box. 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
13.	Pumping arrangements.			
	<ul style="list-style-type: none"> • Ground Level <ul style="list-style-type: none"> ➤ Discharge of main pump. ➤ Head of main pump. ➤ Number of main pumps. ➤ Jockey Pump output. ➤ Jockey Pump head. ➤ Standby Pump output. ➤ Standby Pump head. ➤ Auto Starting / Manual Stopping. ➤ Pump house access. 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
	<ul style="list-style-type: none"> • Terrace Level <ul style="list-style-type: none"> ➤ Discharge of pump. ➤ Head of pump. ➤ Power supply. ➤ Auto starting of pump. 	450 LPM	Provided	MR
		40m	Provided	MR
		Required	Provided	MR
		Required	Provided	MR
14.	Captive water storage for fire fighting.			
	<ul style="list-style-type: none"> • Underground tank capacity. <ul style="list-style-type: none"> ➤ Draw-off connection. ➤ Fire Service Inlet. ➤ Access to tank. • Overhead tank capacity. 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		10,000 Ltr	Provided	MR
		Required	Provided	MR
15.	Exit Signage.			
16.	Provision of Lifts.			
	<ul style="list-style-type: none"> • Pressurization of lift shaft. • Pressurization of lift lobby. • Communication in lift car. • Fireman's switch. • Lift signage. 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
17.	Standby Power Supply	Required	Provided DG set	MR
18.	Refuge Area			
	<ul style="list-style-type: none"> • Total area • Location 	-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-

19.	Fire Control Room.			
	• Detector system panel.	-NA-	-NA-	-NA-
	• Flow switch panel.	-NA-	-NA-	-NA-
	• PA system panel.	-NA-	-NA-	-NA-
	• Battery backup.	-NA-	-NA-	-NA-
	• Building floor plan.	-NA-	-NA-	-NA-
20.	Special Fire Protection System for the Protection of special Risk, if any.			-NA-

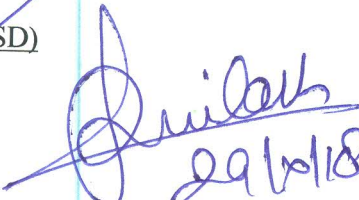
The fire protection systems provided in the premises were test checked at random and found functional at the time of inspection. Keeping in view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules, the fire safety certificate issued vide letter No. F.6/DFS/MS/EH/2015/SZ/1887 Dated 20-10-2015, renewal under rule 35 of the Delhi Fire Service Rules, 2010 is recommended.

Accordingly DFA is put up for approval and signature please.


 Signature of the Inspecting Officer
 Name: Mehmood
 Design: ADO (SJ)

The Groghead (Unit of SAV) Entertainment co. A-5 SF Green Park New Delhi

DO (SD)


29/10/18

dy. CP (S2)


29/10/18



164/cfs2
31/10/18


CPD-SM

m.scell

F7M.

W 30/10

A. D.T. letter put up for signature please


29/10/18
ADDO (S1)

CPD (S2)

m.scell

W 31/10