

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI-110001**

No. F.6/DFS/MS/CNG/2018/SZ/ 2568

Dated: 28/11/18.

FIRE SAFETY CERTIFICATE

Certified that M/s **United Engineers Service Station** (CNG facility at existing RO) located at Kalkaji, Opp. Nehru Place Bus Terminal, New Delhi-110019, comprised of ground and mezzanine floor only has already been issued with NOC by this department vide letter No. F5/(3A)/DFS/07/78 dated 22/02/2007. The premise was re-inspected by officer concerned of this department on 22/10/2018 in the presence of Mr. Suresh Vasvani (Manager) of the filling station and found that the premises have complied with the fire prevention and fire safety requirements in accordance with rule 33 & OISD-179 and that premises is fit for occupancy class "**Hazardous, Group-J**" as above with effect from the date of issue of this certificate for period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued 28/11/18 at New Delhi by

Ventat
(Vipin Kental)
Chief Fire Officer
Ph: 011-23412225

Copy to: -

1. The Addl. Comm. of Police (Lic.), First floor, P.S. Defence Colony, New Delhi.-110049
2. Sh. Pradeep Ghosal, Chief Manager (Retail Services), Indian Oil Corporation Ltd, Delhi Division Office, World Trade Centre, Babar Road, New Delhi.
3. M/s United Engineers Service Station at Kalkaji, Opp. Nehru Place Bus Terminal, New Delhi-110019

Conditions for the validity of Fire Safety Certificate:

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire fighting system.
4. The owner/occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or alteration (Clause 1.4.3 of UBBL-2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry.
7. Each installation shall have minimum two numbers hand held explosive meter in working condition at all the times.

INSPECTION REPORT				
1	Name & Address of the Building	M/s United Engineers Service Station (Retail Outlet of I.O.C.L) at Kalkaji, Opp. Nehru Place Bus Terminal, New Delhi-110019		
2	Type of Occupancy	Group-J Hazardous (CNG facility)		
3	Building Comprised of	Ground and Mezzanine floor.		
4	Type of Case	New / Installation of CNG Facility at existing RO		
5	Details of Previous NOC	Nil		
6	Fire Safety Directives Letter No	Nil		
7	Date of Inspection	22-10-2018		
8	Name of the Inspecting Officers	Mehmood, ADO (SJ)		
9	Name & Designation of Officers from the building side	Mr. Suresh Vasvani (Manager)		
10	Year of construction	Before 2007		
11	Applicant letter No.	Outdoor Diary No. 13433 dated 19-09-2018		
S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	NBC / BBL Requirement	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	• Road width	9 mtr	Provided	MR
	• Gate width	N/A	N/A	N/A
	• Width of internal road	N/A	N/A	N/A
2	Number, width, type & arrangement of exits.			
	a. Number of Staircase			
	➤ Upper floors.	N/A	N/A	N/A
	➤ Basement.	N/A	N/A	N/A
	b. Width of Staircase			
	➤ Upper floors	N/A	N/A	N/A
	➤ Basement	N/A	N/A	N/A
	c. Protection of exits			
	➤ Fire check door	N/A	N/A	N/A
	➤ Pressurization	N/A	N/A	N/A
	d. No. of continuous staircase to terrace	N/A	N/A	N/A
	e. Width of corridor	N/A	N/A	N/A
	f. Door size	1m	1m	MR
3	Compartmentation.			
	• Fire check door.	N/A	N/A	N/A
	• Sealing of electrical shafts.	N/A	N/A	N/A
	• Fire rating of shaft door.	N/A	N/A	N/A
	• Water curtain	N/A	N/A	N/A
	• Fire dampers.	N/A	N/A	N/A
4	Smoke Management system.			
	• Basement	N/A	N/A	N/A
	• Upper floors	N/A	N/A	N/A
5	Fire Extinguishers.			
	• Total numbers	15 No's	20 No's	MR
	• Types	ABC, CO2, DCP	CO2, DCP & ABC	MR
	• ISI Marking	ISI Marked	Provided	MR
6	First Aid Hose Reels.			
	• Total numbers on each floor.	N/A	N/A	N/A
	• Length of hose-reel hose.	N/A	N/A	N/A
	• Nozzle Diameter	N/A	N/A	N/A

M/s United Engineers Service Station, Kalkaji, Opp. Nehru Place Bus Terminal, New Delhi

7	Automatic fire detection & alarming system.			
	• Type of detectors	N/A	N/A	N/A
	• Location of Main Panel	N/A	N/A	N/A
	• Location of Repeater Panel	N/A	N/A	N/A
	• Alternate source of power	N/A	N/A	N/A
	• Hooter's location	N/A	N/A	N/A
8.	MOEFA	N/A	N/A	N/A
9.	Public Address System	N/A	N/A	N/A
10.	Automatic Sprinkler System			
	• Basement	N/A	N/A	N/A
	• Upper floors	N/A	N/A	N/A
	• Sprinkler above false ceiling	N/A	N/A	N/A
11.	Internal Hydrants.			
	• Size of Riser/Down-comer	N/A	N/A	N/A
	• Number of Hydrant per floor	N/A	N/A	N/A
	• Hose box.	N/A	N/A	N/A
12.	Yard Hydrants.			
	• Total number of hydrants.	N/A	N/A	N/A
	• Hose box.	N/A	N/A	N/A
13.	Pumping arrangements.			
	• Ground Level			
	➤ Discharge of main pump.	N/A	N/A	N/A
	➤ Head of main pump.	N/A	N/A	N/A
	➤ Number of main pumps.	N/A	N/A	N/A
	➤ Jockey Pump output.	N/A	N/A	N/A
	➤ Jockey Pump head.	N/A	N/A	N/A
	➤ Standby Pump output.	N/A	N/A	N/A
	➤ Standby Pump head.	N/A	N/A	N/A
	➤ Auto Starting / Manual Stopping.	N/A	N/A	N/A
	➤ Pump house access.	N/A	N/A	N/A
	• Terrace Level			
	➤ Discharge of pump.	N/A	N/A	N/A
	➤ Head of pump.	N/A	N/A	N/A
	➤ Power supply.	N/A	N/A	N/A
	➤ Auto starting of pump.	N/A	N/A	N/A
14.	Captive water storage for Fire Fighting.			
	• Underground tank capacity.	N/A	N/A	N/A
	➤ Draw-off connection.	N/A	N/A	N/A
	➤ Fire Service Inlet.	N/A	N/A	N/A
	➤ Access to tank.	N/A	N/A	N/A
	• Overhead tank capacity.	N/A	N/A	N/A
15.	Exit Signage/ No Smoking Signage	Required	Provided in Hindi & English	MR
16.	Provision of Lifts.			
	• Pressurization of lift shaft.	N/A	N/A	N/A
	• Pressurization of lift lobby.	N/A	N/A	N/A
	• Communication in lift car.	N/A	N/A	N/A
	• Fireman's switch.	N/A	N/A	N/A
	• Lift signage.	N/A	N/A	N/A
17.	Standby Power Supply	Required	Provided (DG Set)	MR
18.	Refuge Area			
	• Total area	N/A	N/A	N/A
	• Location	N/A	N/A	N/A


19.	Fire Control Room.			
	• Detector system panel.	N/A	N/A	N/A
	• Flow switch panel.	N/A	N/A	N/A
	• PA system panel.	N/A	N/A	N/A
	• Battery backup.	N/A	N/A	N/A
	• Building floor plan.	N/A	N/A	N/A
20.	Special Fire Protection System for the Protection of special Risk, if any.	N/A	N/A	N/A

CNG facility provided at existing retail outlet of I.O.C.L. from nearby I.G.C.L. pump. Hence, cascades, compressor etc not provided.

The fire protection system such as fire extinguishers of different type and capacity, fire buckets filled with dry loose sand provided at suitable places in the retail outlet area were checked and found functional at the time of inspection. "No Smoking" sign boards were found displayed both in Hindi & English at conspicuous places. No loose electrical wiring was seen in the premises.

Keeping in view of the substantially satisfactory compliance of the minimum standards on fire prevention and fire safety measures as required under the rules, it is recommended to issue Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules, 2010

.Accordingly DFA is put up for approval and signature please.

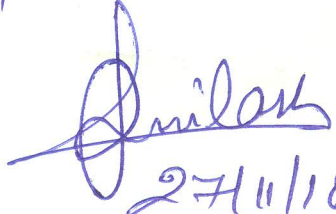

 Signature of the Inspecting Officer
 Name: Mehmood
 Design: ADO (SJ)

M/s Kailash Service Station, East of Kailash, Opp. Amar Colony Police Station, New Delhi

File called from ADO/SJ office on 27/11/18.

DO (SD)

This is case of Addition/Alteration as CNG facility is added to the existing petrol pump. The file may be sent to ADW for issue of directives under Rule 34(i).


 27/11/18
DO (SD)

*dy CO (S2)
on 2/11*

CO (S2)

file called from CO office and the matter was discussed with dy CO (S2) in presence with