

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS, DELHI FIRE SERVICE, CONNAUGHT PLACE
NEW DELHI-110001**

No. F.6/DFS/MS/EH/SZ/2018/ 2615

Dated: 4.11.2018

FIRE SAFETY CERTIFICATE

Certified that M/s Jamie's Italian (A Unit of Dolomite Restaurant Private Ltd.) located at T-301A, 3rd Floor Ambience Mall, Vasant Kunj, New Delhi-110070, comprised of three basements, ground + three upper floor, owned/occupied by Dolomite Restaurant Pvt. Ltd was granted FSC by this department vide letter No. F6/MS/DFS/EH/2015/SZ/1899 dated 23/10/2015. The restaurant was re-inspected by the officer concerned of this department on 15/11/2018 in the presence of Sh. Kunal Dewan and found that the said restaurant premises have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the premises fit for occupancy class "Assembly, Group-D" (Restaurant) with effect from 4.12.18..for a period of **three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under Rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 4/12/18 at New Delhi by

V
29/11/18
(Vipin Kental)
Chief Fire Officer
Ph: 011-23412225

Copy to: -

1. M/s Jamie's Italian (A Unit of Dolomite Restaurant Pvt. Ltd.) located at T-301A, 3rd Floor Ambience Mall, Vasant Kunj, New Delhi-110070
2. DHO (SZ), South MCD, Health Department, Aurobindo Marg, Green Park, New Delhi-16

Conditions for the validity of Fire Safety Certificate: -

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire fighting system.
4. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or alteration (Clause 1.4.3 of UBBL-2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry.

INSPECTION REPORT

1	Name & Address of the Building	M/s Jamie's Italian (A unit of Dolomite Restaurants Pvt. Ltd.)T-301, 3 rd Floor, Ambience Mall, Vasant Kunj, New Delhi-70		
2	Type of Occupancy	Assembly Building, (Restaurant)		
3	Building Comprised of	Three Basements + Ground + Three upper floor. (Restaurant at 3 rd floor).		
4	Type of Case	Renewal		
5	Details of Previous NOC	F6/DFS/MS/EH/2015/SZ/1899 dated 23-10-2015		
6	Fire Safety Directives Letter No	NIL		
7	Date of Inspection	15-11-2018		
8	Name of the Inspecting Officers	Mehmood, ADO (SJ)		
9	Name & Designation of Officers from the building side	Sh. Kunal Dewan, Head of Operation.		
10	Year of construction	2010		
11	Applicant letter No.	Outdoor Diary No. 15685 dated 26.10.2018		
S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC requirements	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	<ul style="list-style-type: none"> • Road width • Gate width • Width of internal road 	12 mtr 06 M 06 M	30 mtr 06 M 06 M	MR MR MR
2	Number, width, type & arrangement of exits.			
	a) Number of Staircase			
	➤ Upper floors.	02 Nos	02 Nos	MR
	➤ Basement floor.	-NA-	-NA-	-NA-
	b) Width of Staircase			
	➤ Upper floors	1.5m	1.5m (each)	MR
	➤ Basement floor	-NA-	-NA-	-NA-
	c) Protection of exits			
	➤ Fire check door	Required	Provided	MR
	➤ Pressurization	Required	Provided	MR
	d) No. of continuous staircase to terrace	Required	Provided by mall	MR
	e) Width of corridor	02 M	02 M	MR
	f) Door size	2m/90cm	1no=2m, 1no=90cm	MR
3	Compartmentation.			
	<ul style="list-style-type: none"> • Fire check door. • Sealing of electrical shafts. • Fire rating of shaft door. • Water curtain • Fire dampers. 	Required Required 01hr. -NA- Required	Provided Provided 01hr. -NA- Provided	MR MR MR -NA- MR
4.	Smoke Management system.			
	<ul style="list-style-type: none"> • Basement • Upper floors 	30 ACPH 12 ACPH	Provided Provided	MR MR
5.	Fire Extinguishers.			
	<ul style="list-style-type: none"> • Total numbers • Types • ISI Marking 	08 Nos ABC, Co2,WCo2 ISI marked	Provided Provided Provided	MR MR MR
6.	First Aid Hose Reels.			
	<ul style="list-style-type: none"> • Total numbers on each floor. • Length of hose-reel hose. • Nozzle Diameter 	02 nos. 30 mtr 5 mm	02 nos. 30 mtr 5 mtr	MR MR MR

M/s Jamie's Italian (A unit of Dolomite Restaurants Pvt. Ltd.)T-301, 3rd Floor, Ambience Mall, Vasant Kunj, new delhi

7	Automatic fire detection & alarming system.			
	<ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooter's location 	Smoke & Heat Ground Floor FCR Required One each floor	Smoke & Heat Ground Floor FCR Provided Provided	MR MR MR MR MR
8.	MOEFA	Required	Provided	MR
9.	Public Address System	Required	Provided	MR
10.	Automatic Sprinkler System			
	<ul style="list-style-type: none"> Basement Upper floors Sprinkler above false ceiling 	-NA- Required Required	-NA- Provided Provided	-NA- MR MR
11.	Internal Hydrants.			
	<ul style="list-style-type: none"> Size of Riser/Down-comer Number of Hydrant per floor Hose box. 	100 mm 02 nos. 02 nos.	100 mm 02 nos. 02 nos.	MR MR MR
12.	Yard Hydrants.			
	<ul style="list-style-type: none"> Total number of hydrants. Hose box. 	-NA- -NA-	-NA- -NA-	-NA- -NA-
13.	Pumping arrangements.			
	<ul style="list-style-type: none"> Ground Level <ul style="list-style-type: none"> Discharge of main pump. Head of main pump. Number of main pumps. Jockey Pump output. Jockey Pump head. Standby Pump output. Standby Pump head. Auto Starting / Manual Stopping. Pump house access. Terrace Level <ul style="list-style-type: none"> Discharge of pump. Head of pump. Power supply. Auto starting of pump. 	2850 LPM(Two) 70m(Two) 02 180 LPM(Two) 70m 2850 LPM 70m Required Required	2850 LPM(Three) 70m(Two)40m(1) 03 nos. 180 LPM(Two) 70m 2850 LPM 70m Provided Provided	MR MR MR MR MR MR MR MR MR MR
14.	Captive water storage for fire fighting.			
	<ul style="list-style-type: none"> Underground tank capacity. <ul style="list-style-type: none"> Draw-off connection. Fire Service Inlet. Access to tank. Overhead tank capacity. 	2,00,000 Ltr Required Required Required 20,000 Ltr	Provided Provided Provided Provided Provided	MR MR MR MR MR
15.	Exit Signage.	Required	Provided	MR
16.	Provision of Lifts.			
	<ul style="list-style-type: none"> Pressurization of lift shaft. Pressurization of lift lobby. Communication in lift car. Fireman's switch. Lift signage. 	Required Required Required Required Required	Provided Provided Provided Provided Provided	MR MR MR MR MR
17.	Standby Power Supply	Required	625 KVA(Two)	MR
18.	Refuge Area			
	<ul style="list-style-type: none"> Total area Location 	-NA- -NA-	-NA- -NA-	-NA- -NA-

N/-7


19.	Fire Control Room.	• Detector system panel.	-NA-	-NA-	-NA-
		• Flow switch panel.	-NA-	-NA-	-NA-
		• PA system panel.	-NA-	-NA-	-NA-
		• Battery backup.	-NA-	-NA-	-NA-
		• Building floor plan.	-NA-	-NA-	-NA-
20.	Special Fire Protection System for the Protection of special Risk, if any.	-NA-	-NA-	-NA-	

The fire protection system provided in the building/ premises were tested, checked at random and found functional at the time of inspection.

Keeping in view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules, the FSC issued vide letter No. F.6/DFS/MS/EH/2015/52/1899 dated 23/10/2015, renewal under rule 35 of the Delhi Fire Service Rules 2010, is recommended.

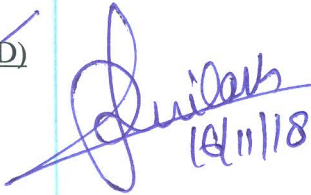
Accordingly DFA is put up for approval and signature please.

x


 Signature of the Inspecting Officer
 Name: Mehmood
 Design: ADO (SJ)

M/s Jamie's Italian (A unit of Dolomite Restaurants Pvt. Ltd.)T-301, 3rd Floor, Ambience Mall, Vasant Kunj, new delhi

DO (SD)


14/11/18



15/11/18


16/11



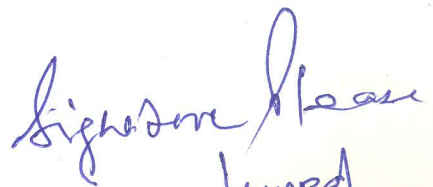
M.S cell


FTM.



22/11/18

220/cb s2
2/12


A.D.T. letter sent up for signature please




28/11/18
ADO (SJ)



M.S cell


29/11/18

