

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI  
HEADQUARTERS: DELHI FIRE SERVICE: NEW DELHI- 110001**

No. F.6/DFS/MS/School/2018/SZ/ 2718

Dated: ..... 14/12/18

**FIRE SAFETY CERTIFICATE**

Certified that the New Way Public School located at R-786/7, Fazal Chowk Abdul Hameed Road, Jogabai Extn, Jamia Nagar, Okhla, New Delhi-110025 was granted Fire Safety Certificate by this department vide letter No.F6/DFS/MS/School/2013/425 Dated 31/01/2013 for ground floor only. The school building was re-inspected by the officer concerned of this department on 27/10/2018 in presence of Mr. Rizwan Ahmed (Owner) of the school and found that the school management have added three upper floors and now the school building comprised of ground plus three upper floors have complied with the fire prevention and fire safety arrangements in accordance with rule 33 of Delhi Fire Service Rules, 2010 and that the building/premises is fit for occupancy class "Educational Building, Group-B" as above with effect from 14/12/2018 for a period of Three years in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the condition under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on ..... 14/12/18 ..... at New Delhi by

  
(Vipin Kental)  
Chief Fire Officer  
Ph: 011-23412225  


**Copy to: -**

1. The Principal, New Way Public School, R786/7, Fazal Chowk Abdul Hameed Road, Jogabai Extn, Jamia Nagar, Okhla, New Delhi-110025.
2. The Director of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi.

**Conditions for the validity of Fire Safety Certificate**

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangements provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life or property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of firefighting system.
4. This Certificate cannot be treated as regularization of unauthorized construction, if any.
5. The Owner/Occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules, 2010. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in).
6. The Owner/Occupier shall apply for renewal of this Fire Safety Certificate to the Director in the form 'J' [sub rule (1) of rule 37] along with copy of this certificate, six months prior to its expiry. The form is available on [www.dfs.delhigovt.nic.in](http://www.dfs.delhigovt.nic.in).

## INSPECTION REPORT

1	Name & Address of the Building	New Way Public School, R786/7, Fazal Chowk Abdul Hameed Road, Joga Bai Extn, Jamai Nagar, Okhla, New Delhi-110025		
2	Type of Occupancy	Educational "Group-B" (School)		
3	Building Comprised of	Ground + 03 upper floors. (old building is ground floor only but the school management added three upper floors and building is comprised of G+3 upper floors)		
4	Type of Case	Addition / Alteration		
5	Details of Previous NOC	F.6/DFS/MS/School/2013/425 dated 31-01-2013 (Ground Floor)		
6	Fire Safety Directives Letter No	Nil		
7	Date of Inspection	26-11-2018		
8	Name of the Inspecting Officers	Mehmood, ADO (SJ)		
9	Name & Designation of Officers from the building side	Mr. Rizwan Ahmed (Owner)		
10	Year of construction	2004, 2015		
11	Applicant letter No.	Nil dated 26.09.2018		
S. No	Minimum standards on Fire Prevention and Fire Safety U/R 33	NBC/BBL Requirements	Provided at Site	Remarks MR/NMR
1	<b>Access to Building.</b>			
	• Road width	6 mtr	6.5 mtr	MR
	• Gate width	5 mtr	5 mtr	N/A
	• Width of internal road	N/A	N/A	N/A
2	<b>Number, width, type &amp; arrangement of exits</b>			
	<b>a) Number of Staircase</b>			
	➤ Upper floors	One	Two	MR
	➤ Basement floor	N/A	N/A	N/A
	<b>b) Width of Staircase</b>			
	➤ Upper floors	1.5 mtr	1.80m & 1.30m	MR
	➤ Basement floor	N/A	N/A	N/A
	<b>c) Protection of exits</b>			
	➤ Fire check door	N/A	N/A	N/A
	➤ Pressurization	N/A	N/A	N/A
	<b>d) No. of continuous staircase to terrace</b>	One	Two	MR
	<b>e) Width of corridor</b>	1.5 mtr	Provided	MR
	<b>f) Door size</b>	1 mtr	Provided	MR
3	<b>Compartmentation.</b>			
	• Fire check door.	N/A	N/A	N/A
	• Sealing of electrical shafts.	N/A	N/A	N/A
	• Fire rating of shaft door.	N/A	N/A	N/A
	• Water curtain	N/A	N/A	N/A
	• Fire dampers.	NA	NA	NA
4.	<b>Smoke Management system.</b>			
	• Basement	30 ACPH	N/A	N/A
	• Upper floors	12 ACPH	N/A	N/A
5.	<b>Fire Extinguishers.</b>			
	• Total numbers	09 No's	10 No's	MR
	• Types	ABC / CO2	ABC & CO2	MR
	• ISI Marking	ISI marked	Provided	MR


<b>6.</b>	<b>First Aid Hose Reels.</b>			
	<ul style="list-style-type: none"> <li>Total numbers on each floor.</li> </ul>	One	Provided at each floor	MR
	<ul style="list-style-type: none"> <li>Length of hose-reel hose.</li> </ul>	30m	Provided	MR
	<ul style="list-style-type: none"> <li>Nozzle Diameter</li> </ul>	5mm	Provided	MR
<b>7</b>	<b>Automatic fire detection &amp; alarming system</b>			
	<ul style="list-style-type: none"> <li>Type of detectors</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>Location of Main Panel</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>Location of Repeater Panel</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>Alternate source of power</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>Hooter's location</li> </ul>	N/A	N/A	N/A
<b>8.</b>	<b>MOEFA</b>	N/A	N/A	N/A
<b>9.</b>	<b>Public Address System</b>	N/A	N/A	N/A
<b>10.</b>	<b>Automatic Sprinkler System</b>			
	<ul style="list-style-type: none"> <li>Basement</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>Upper floors</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>Sprinkler above false ceiling</li> </ul>	N/A	N/A	N/A
<b>11.</b>	<b>Internal Hydrants.</b>			
	<ul style="list-style-type: none"> <li>Size of Riser/Down-comer</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>Number of Hydrant per floor</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>Hose box.</li> </ul>	N/A	N/A	N/A
<b>12.</b>	<b>Yard Hydrants.</b>			
	<ul style="list-style-type: none"> <li>Total number of hydrants.</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>Hose box.</li> </ul>	N/A	N/A	N/A
<b>13.</b>	<b>Pumping arrangements.</b>			
	<ul style="list-style-type: none"> <li><b>Ground Level</b></li> </ul>			
	<ul style="list-style-type: none"> <li>➤ Discharge of main pump.</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>➤ Head of main pump.</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>➤ Number of main pumps.</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>➤ Jockey Pump output.</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>➤ Jockey Pump head.</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>➤ Standby Pump output.</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>➤ Standby pump head.</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>➤ Auto Starting/Manual Stopping.</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li><b>Terrace Level</b></li> </ul>			
	<ul style="list-style-type: none"> <li>➤ Discharge of pump.</li> </ul>	450 LPM	Provided	MR
	<ul style="list-style-type: none"> <li>➤ Head of pump.</li> </ul>	40 m	40 m	MR
	<ul style="list-style-type: none"> <li>➤ Power supply.</li> </ul>	Required	Provided	MR
	<ul style="list-style-type: none"> <li>➤ Auto starting of pump.</li> </ul>	Required	Provided	MR
<b>14.</b>	<b>Captive water storage for Fire Fighting.</b>			
	<ul style="list-style-type: none"> <li>Underground tank capacity.</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>➤ Draw-off connection.</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>➤ Fire Service Inlet.</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>➤ Access to tank.</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>Overhead tank capacity.</li> </ul>	10.000 Ltr	Provided	MR
<b>15.</b>	<b>Exit Signage.</b>	Required	Provided	MR
<b>16.</b>	<b>Provisions of Lifts.</b>			
	<ul style="list-style-type: none"> <li>Pressurization of lift shaft.</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>Pressurization of lift lobby.</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>Communication in lift car.</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>Fireman's switch.</li> </ul>	N/A	N/A	N/A
	<ul style="list-style-type: none"> <li>Lift signage.</li> </ul>	N/A	N/A	N/A
<b>17</b>	<b>Standby Power Supply</b>	N/A	N/A	N/A

18.	<b>Refuge Area</b>			
	• Total area	N/A	N/A	N/A
	• Location	N/A	N/A	N/A
19.	<b>Fire Control Room.</b>			
	• Detector System Panel.	N/A	N/A	N/A
	• Flow Switch Panel.	N/A	N/A	N/A
	• PA system Panel.	N/A	N/A	N/A
	• Battery backup	N/A	N/A	N/A
	• Building floor plan	N/A	N/A	N/A
20.	<b>Special Fire Protection System for the Protection of special Risk, if any.</b>	N/A	N/A	N/A

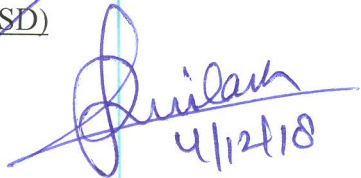
The school management has constructed/added three upper floors and now the building is comprised of ground plus three upper floors. Earlier the school building was granted FSC vide letter No. F6/DFS/MS/School/2013/425 dated 31.01.2013 for ground floor only.


Keeping in view the substantial compliance of the minimum standards on fire prevention and fire safety measures as required under the rule, it is recommended to grant Fire Safety Certificate under rule 35 of the Delhi Fire Service Rules, 2010.

Accordingly, DFA is put up for approval and signature please.

  
 Signature of the Inspecting Officer  
 Name: Mehmood  
 Designation: ADO (SJ)

DO (SD)

  
4/12/18

  
Dy. CPO (S2)

  
6/12




266/CPO/S2  
14/12/18

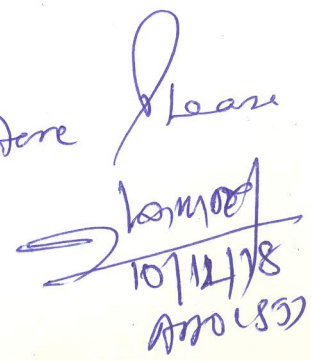



M.Scill

F2/M.


  
7/12

A.F.T. letter put up for signature please

  
10/12/18  
ADO (S2)



M.Scill

  
12/12