

**GOVERNMENT OF NATIONAL CAPITAL TERRITORY OF DELHI
HEADQUARTERS: DELHI FIRE SERVICE: CONNAUGHT PLACE
NEW DELHI-110001**

No. F.6/DFS/MS/School/2018/SZ/ 2752

Dated: 28/12/18

FIRE SAFETY CERTIFICATE

Certified that the DPS International located at P-37, Sector-VI, Pushp Vihar, M.B. Road Saket, New Delhi-110017, having three blocks, A-Blocks: B+G+3, B-Block: B+G+1 (Audi at 1st Floor of B-Block) and C-Block: B+G+2 (A & B blocks are interconnected upto 1st floor and C block interconnect with A block at first floor) was granted NOC by this department vide letter No. F6/MS/DFS/2003/1428 dated 03/07/2003 (school) and F6/MS/DFS/2004/670 dated 26/03/2004 (auditorium). The premises was re-inspected by officer concerned of this department on 01/12/2018 in presence of Mr. G.P. Sharma (Admin) and observed that the said School building have deemed complied with the fire prevention and fire safety requirements in accordance with rule 33 of the Delhi Fire Service Rules, 2010 and that the building/premises is fit for occupancy class "**Educational Building**" Group-B, with effect from the date of issue of this certificate for a period of **Three years** in accordance with rule 36 unless renewed under rule 37 or sooner cancelled under rule 40 and subject to compliance of the conditions under rule 38 of the Delhi Fire Service Rules, 2010.

Issued on 28/12/18 at New Delhi by

W
28/12
(Vipin Kental)
Chief Fire Officer
Ph: 011-23412225

Copy to: -

1. Principal, DPS International, P-37, Sec-VI, Pushp Vihar, M.B. Road, Saket, New Delhi-17
2. Directorate of Education, Govt. of NCT of Delhi, Old Secretariat, New Delhi-110054

Conditions for the validity of Fire Safety Certificate: -

1. All the means of escape/entry/exit shall be kept free from any obstruction.
2. All the fire safety arrangement provided therein shall be maintained in good working condition at all time as seen during inspection. Any loss of life property due to non-functional fire safety measures shall be at the responsibility of the management.
3. All the staff members must know the correct method of operation of fire fighting system.
4. The owner / occupier shall submit a declaration every year in form 'K' provided in the first schedule of Delhi Fire Service Rules 2010. The form is available on www.dfs.delhigovt.nic.in
5. This fire safety certificate may not in any way be treated as regularization (Clause 2.8 of UBBL-2016) of unauthorized construction or alteration (Clause 1.4.3 of UBBL- 2016), if any.
6. The owner/occupier shall apply for renewal of this Fire Safety Certificate to the Director in form 'J' [sub rule (I) of rule 37] along with a copy of this Certificate, six month prior to its expiry.

N/S


INSPECTION REPORT

1	Name & Address of the Building	DPS International, P-37, Sector-VI, Pushp Vihar, M.B. Road, Saket, New Delhi-110017		
2	Type of Occupancy	Educational, Group-B (School)		
3	Building Comprised of	School has three blocks. A-Bk: B+G+3, B-Bk: B+G+01 (Audi at FF of B-Bk) and C-Bk: B+G+02 (A&B Blocks are interconnected upto 1 st Floor & C Bk interconnected with A Block at 1 st floor)		
4	Type of Case	Renewal		
5	Details of Previous NOC	F.6/MS/DFS/2003/1498 dated 03/07/2003 (School) F.6/MS/DFS/2004/670 dated 26/03/2004 (Auditorium)		
6	Fire Safety Directives Letter No	F.6/DFS/MS/BP/2002/1105 dated 09/07/2002		
7	Date of Inspection	01/12/2018		
8	Name of the Inspecting Officers	Mehmood, ADO (SJ)		
9	Name & Designation of Officers from the building side	Mr. G.P. Sharma (Admin)		
10	Year of construction	2002		
11	Applicant letter No.	DPSI/Estate/0086 dated 26/10/2018		
S. No.	Minimum standards on Fire Prevention and Fire Safety U/R 33	Old NOC Requirement	Provided at Site	Remarks MR/NMR
1	Access to Building.			
	• Road width	6 mtr	10 mtr	MR
	• Gate width	5 mtr	Provided	MR
	• Width of internal road	-NA-	-NA-	-NA-
2	Number, width, type & arrangement of exits.			
	a) Number of Staircase			
	➤ Upper floors.	06 Nos (A&B Bk: 3 Nos GF to Terrace + 01 FF to Terrace & 02 in C Bk)	Provided (A & B Bk: 3 Nos GF to Terrace + 01 FF to Terrace & 02 in C Bk)	MR
	➤ Basement floor.	A&B Bk: 06 Nos C Bk: 02 Nos	A&B Block- 06 Nos C Block- 02 Nos	MR
	b) Width of Staircase			
	➤ Upper floors	1.5 mtr	A&B Bk: 1.40m, 1.85m, 1.85m & 1m, C Block: 1.40m each	MR (old case)
	➤ Basement floor	1.5 mtr	A&B Bk. 1.40m x 3, 1.20m, 1m and 0.90m, C block-1.40m x 2	MR (old case)
	c) Protection of exits			
	➤ Fire check door	Required	Provided	MR
	➤ Pressurization	-NA-	-NA-	-NA-
	d) No. of continuous staircase to terrace	04 No	Provided	MR
	e) Width of corridor	1.5m	Provided	MR
	f) Door size	Class rooms-1m Audi- 1.50m	Class room-1m Audi-1.60m, 2.05m & 2.05m	MR
3	Compartmentation.			
	• Fire check door.	Required	Provided	MR
	• Sealing of electrical shafts.	-NA-	-NA-	-NA-
	• Fire rating of shaft door.	-NA-	-NA-	-NA-
	• Water curtain	-NA-	-NA-	-NA-
	• Fire dampers.	-NA-	-NA-	-NA-
4	Smoke Management system.			
	• Basement	30 ACPH	Exhaust Fan	MR
	• Upper floors	12 ACPH	-NA-	-NA-

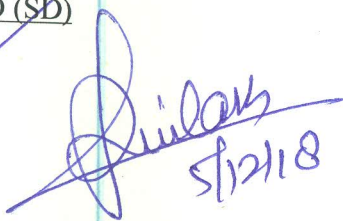
2/16

5	Fire Extinguishers. <ul style="list-style-type: none"> Total numbers Types ISI Marking 	Required	114 Nos	MR
		ABC/CO2	ABC & Co	MR
		ISI mark	Provided	MR
6	First Aid Hose Reels. <ul style="list-style-type: none"> Total numbers on each floor. Length of hose-reel hose. Nozzle Diameter 	A&B Bk-04 nos. C Bk-02 nos. Audi-02 nos.	A&B Bk-04 nos. C block-02 nos. Audi-02 nos.	MR
		30m	30m	MR
		5mm	5mm	MR
7	Automatic fire detection & alarming system. <ul style="list-style-type: none"> Type of detectors Location of Main Panel Location of Repeater Panel Alternate source of power Hooter's location 	Reqd. in basement	Smoke & Heat	MR
		-NA-	-NA-	-NA-
		-NA-	Ground floor	-NA-
		-NA-	-NA-	-NA-
		-NA-	-NA-	-NA-
		Reqd. in Audi	Provided	MR
8	MOEFA	-NA-	Provided	-NA-
9	Public Address System	-NA-	Provided	-NA-
10	Automatic Sprinkler System <ul style="list-style-type: none"> Basement Upper floors Sprinkler above false ceiling 	Required	Provided	MR
		-NA-	-NA-	-NA-
		-NA-	Provided	-NA-
11	Internal Hydrants. <ul style="list-style-type: none"> Size of Riser/Down-comer Number of Hydrant per floor Hose box. 	100mm	Provided	MR
		A&B block-04 nos. C block-02 nos. Auditorium-02 nos.	A&B block-04 nos. C block-02 nos. Auditorium-02 nos.	MR
		A&B block-04 nos. C block-02 nos. Auditorium-02 nos.	A&B block-04 nos. C block-02 nos. Auditorium-02 nos.	MR
12	Yard Hydrants. <ul style="list-style-type: none"> Total number of hydrants. Hose box. 	-NA-	04 Nos	-NA-
		-NA-	04 Nos	-NA-
13	Pumping arrangements. <ul style="list-style-type: none"> Ground Level <ul style="list-style-type: none"> Discharge of main pump. Head of main pump. Number of main pumps. Jockey Pump output. Jockey Pump head Standby Pump output. Standby Pump head. Auto Starting/Manual Stopping. Pump house access. Terrace Level <ul style="list-style-type: none"> Discharge of pump. Head of pump. Power supply. Auto starting of pump. 	1620 LPM	2280 LPM	MR
		50m	50m	MR
		One	Provided	MR
		180 LPM	180 LPM	MR
		50m	50m	MR
		1620 LPM	2280 LPM	MR
		50m	50m	MR
		Required	Provided	MR
		Required	Provided	MR
		A&B & C Bk	540 LPM + 540 LPM	MR
		40 mtr	43.5m each	MR
		Required	Provided	MR
		Required	Provided	MR
		14	Captive water storage for firefighting. <ul style="list-style-type: none"> Underground tank capacity. <ul style="list-style-type: none"> Draw-off connection. Fire Service Inlet. Access to tank. Overhead tank capacity. 	50,000 Ltr
-NA-	-NA-			-NA-
-NA-	-NA-			-NA-
-NA-	-NA-			-NA-
A&B Bk:40,000 Ltr C Block 20,000 Ltr	A&B Bk-40,000 Ltr C Bk 20,000 Ltr			MR

N/A

		Required	Provided	MR
15	Exit Signage.			
16	Provision of Lifts.			
	• Pressurization of lift shaft.	-NA-	-NA-	-NA-
	• Pressurization of lift lobby.	-NA-	-NA-	-NA-
	• Communication in lift car.	-NA-	-NA-	-NA-
	• Fireman's switch.	Required	Provided	MR
	• Lift signage.	-NA-	-NA-	-NA-
17	Standby Power Supply	Required	Provided	MR
18	Refuge Area			
	• Total area	-NA-	-NA-	-NA-
	• Location	-NA-	-NA-	-NA-
19	Fire Control Room.			
	• Detector system panel.	-NA-	-NA-	-NA-
	• Flow switch panel.	-NA-	-NA-	-NA-
	• PA system panel.	-NA-	-NA-	-NA-
	• Battery backup.	-NA-	-NA-	-NA-
	• Building floor plan.	-NA-	-NA-	-NA-
20	Special Fire Protection System for the Protection of special Risk, if any.			
<p>The fire protection system provided in the building / premises were test checked at random and found functional at the time of inspection. Keeping in view of the deemed compliance of the minimum standards of fire prevention and fire safety measures as required under the rules, the FSC issued vide letter No. F.6/MS/DFS/2003/1428 dated 03/07/2003 (School) and F.6/MS/DFS/2004/670 dated 26/03/2004 (Auditorium), renewal under rule 37 of the Delhi Fire Service Rules 2010, is recommended.</p> <p>Accordingly DFA is put up for approval and signature please.</p> <p style="text-align: right;">  Signature of the Inspecting Officer Name: Mehmood Design: ADO (SJ) </p>				

DO (SD)


5/12/18

247/CR/52
11/12/18-2742-18


6/12



Go (5/2)

pl speak
11/12

Sin School given under taking at basement one
At present basement one